

**FLUOROMONOMERS
MANUFACTURING PROCESS
VE SOUTH CARBON BED
REMOVAL EFFICIENCY AND
VE SOUTH STACK EMISSIONS TEST REPORT
TEST DATES: 16 AND 17 JULY 2019**

**THE CHEMOURS COMPANY
FAYETTEVILLE, NORTH CAROLINA**

Prepared for:



**THE CHEMOURS COMPANY
22828 NC Hwy 87 W
Fayetteville, North Carolina 28306**

Prepared by:



**WESTON SOLUTIONS, INC.
1400 Weston Way
P.O. Box 2653
West Chester, Pennsylvania 19380**

August 2019

W.O. No. 15418.002.016

TABLE OF CONTENTS

Section	Page
1. INTRODUCTION.....	1
1.1 FACILITY AND BACKGROUND INFORMATION	1
1.2 TEST OBJECTIVES	1
1.3 TEST PROGRAM OVERVIEW.....	1
2. SUMMARY OF TEST RESULTS	5
3. PROCESS DESCRIPTIONS	6
3.1 FLUOROMONOMERS	6
3.2 PROCESS OPERATIONS AND PARAMETERS	6
4. DESCRIPTION OF TEST LOCATIONS	7
4.1 VE SOUTH STACK.....	7
4.2 VE SOUTH CARBON BED INLET AND OUTLET	7
5. SAMPLING AND ANALYTICAL METHODS.....	11
5.1 STACK GAS SAMPLING PROCEDURES	11
5.1.1 Pre-Test Determinations	11
5.2 STACK PARAMETERS.....	11
5.2.1 EPA Method 0010.....	11
5.2.2 EPA Method 0010 Sample Recovery	14
5.2.3 EPA Method 0010 Sample Analysis.....	15
5.3 GAS COMPOSITION	17
6. DETAILED TEST RESULTS AND DISCUSSION	20

APPENDIX A	PROCESS OPERATIONS DATA
APPENDIX B	RAW AND REDUCED TEST DATA
APPENDIX C	LABORATORY ANALYTICAL REPORT
APPENDIX D	SAMPLE CALCULATIONS
APPENDIX E	EQUIPMENT CALIBRATION RECORDS
APPENDIX F	LIST OF PROJECT PARTICIPANTS

LIST OF FIGURES

Title	Page
Figure 4-1 VE South Stack Test Port and Traverse Point Location	8
Figure 4-2 VE South Carbon Bed Inlet and Schematic	9
Figure 4-3 VE South Carbon Bed Outlet and Schematic	10
Figure 5-1 EPA Method 0010 Sampling Train.....	12
Figure 5-2 HFPO Dimer Acid Sample Recovery Procedures for Method 0010	16
Figure 5-3 WESTON Sampling System.....	19

LIST OF TABLES

Title	Page
Table 1-1 Sampling Plan for VE South Carbon Bed Testing	3
Table 1-2 Sampling Plan for VE South Stack	4
Table 2-1 Summary of HFPO Dimer Acid VE South Carbon Bed and Stack Test Results.....	5
Table 6-1 Summary of HFPO Dimer Acid Test Data and Test Results Carbon Bed Inlet – Runs 1, 2, and 3	21
Table 6-2 Summary of HFPO Dimer Acid Test Data and Test Results Carbon Bed Outlet – Runs 1, 2, and 3	23
Table 6-3 Summary of HFPO Dimer Acid Test Data and Test Results VE South Stack – Runs 1, 2 and 3	25

1. INTRODUCTION

1.1 FACILITY AND BACKGROUND INFORMATION

The Chemours Fayetteville Works (Chemours) is located in Bladen County, North Carolina, approximately 10 miles south of the city of Fayetteville. Chemours operating areas on the site include the Fluoromonomers, IXM and Polymer Processing Aid (PPA) manufacturing areas, Wastewater Treatment, and Powerhouse.

Chemours contracted Weston Solutions, Inc. (Weston) to perform HFPO Dimer Acid Fluoride, captured as HFPO Dimer Acid, emission testing on the Vinyl Ethers (VE) South Carbon Bed and VE South stack at the facility. Testing was performed on 16 and 17 July 2019 and generally followed the “Emission Test Protocol” reviewed and approved by the North Carolina Department of Environmental Quality (NCDEQ). This report provides the results from the emission test program.

1.2 TEST OBJECTIVES

The specific objectives for this test program were as follows:

- Measure the emissions concentrations and mass emissions rates of HFPO Dimer Acid Fluoride from the VE South Carbon Bed inlet and outlet and VE South stack which are located in the Fluoromonomers process area.
- Calculate the Carbon Bed removal efficiency for HFPO Dimer Acid.
- Monitor and record process and emissions control data in conjunction with the test program.
- Provide representative emissions data.

1.3 TEST PROGRAM OVERVIEW

During the emissions test program, the concentrations and mass emissions rates of HFPO Dimer Acid were measured at three locations.

Tables 1-1 and 1-2 provide a summary of the test locations and the parameters that were measured along with the sampling/analytical procedures that were followed.

Section 2 provides a summary of test results. A description of the processes is provided in Section 3. Section 4 provides a description of the test locations. The sampling and analytical procedures are provided in Section 5. Detailed test results and discussion are provided in Section 6.

Appendix C includes the summary reports for the laboratory analytical results. The full laboratory data packages are provided separately in electronic format.

Table 1-1
Sampling Plan for VE South Carbon Bed Testing

Sampling Point & Location		VE South Carbon Bed				
Number of Tests:		6 (3 Carbon Bed inlet, 3 Carbon Bed outlet)				
Parameters To Be Tested:		HFPO Dimer Acid (HFPO-DA)	Volumetric Flow Rate and Gas Velocity	Carbon Dioxide	Oxygen	Water Content
Sampling or Monitoring Method		EPA M-0010	EPA M1 and M2 in conjunction with M-0010 tests	EPA M3/3A		EPA M4 in conjunction with M-0010 tests
Sample Extraction/ Analysis Method(s):		LC/MS/MS	NA ⁶	NA		NA
Sample Size		≥ 1.5m ³	NA	NA	NA	NA
Total Number of Samples Collected ¹		6	6	3	3	6
Reagent Blanks (Solvents, Resins) ¹		1 set	0	0	0	0
Field Blank Trains ¹		1 per source	0	0	0	0
Proof Blanks ¹		1 per train	0	0	0	0
Trip Blanks ^{1,2}		1 set	0	0	0	
Lab Blanks		1 per fraction ³	0	0	0	0
Laboratory or Batch Control Spike Samples (LCS)		1 per fraction ³	0	0	0	0
Laboratory or Batch Control Spike Sample Duplicate (LCSD)		1 per fraction ³	0	0	0	0
Media Blanks		1 set ⁴	0	0	0	0
Isotope Dilution Internal Standard Spikes		Each sample	0	0	0	0
Total No. of Samples		10 ⁵	6	3	3	6

Key:

¹ Sample collected in field.

² Trip blanks include one XAD-2 resin module and one methanol sample per sample shipment.

³ Lab blank and LCS/LCSD includes one set per analytical fraction (front half, back half and condensate).

⁴ One set of media blank archived at laboratory at media preparation.

⁵ Actual number of samples collected in field.

⁶ Not applicable.

Table 1-2
Sampling Plan for VE South Stack

Sampling Point & Location		VE South Stack			
Number of Tests:		3			
Parameters To Be Tested:	HFPO Dimer Acid (HFPO-DA)	Volumetric Flow Rate and Gas Velocity	Carbon Dioxide	Oxygen	Water Content
Sampling or Monitoring Method	EPA M-0010	EPA M1 and M2 in conjunction with M-0010 tests	EPA M3/3A		EPA M4 in conjunction with M-0010 tests
Sample Extraction/ Analysis Method(s):	LC/MS/MS	NA ⁶	NA		NA
Sample Size	≥ 1.5m ³	NA	NA	NA	NA
Total Number of Samples Collected ¹	3	3	3	3	3
Reagent Blanks (Solvents, Resins) ¹	0	0	0	0	0
Field Blank Trains ¹	0	0	0	0	0
Proof Blanks ¹	0	0	0	0	0
Trip Blanks ^{1,2}	0	0	0	0	0
Lab Blanks	1 per fraction ³	0	0	0	0
Laboratory or Batch Control Spike Samples (LCS)	1 per fraction ³	0	0	0	0
Laboratory or Batch Control Spike Sample Duplicate (LCSD)	1 per fraction ³	0	0	0	0
Media Blanks	1 set ⁴	0	0	0	0
Isotope Dilution Internal Standard Spikes	Each sample	0	0	0	0
Total No. of Samples	3 ⁵	3	3	3	3

Key:

¹ Sample collected in field.

² Trip blanks include one XAD-2 resin module and one methanol sample per sample shipment.

³ Lab blank and LCS/LCSD includes one set per analytical fraction (front half, back half and condensate).

⁴ One set of media blank archived at laboratory at media preparation.

⁵ Actual number of samples collected in field.

⁶ Not applicable.

2. SUMMARY OF TEST RESULTS

A total of three test runs each were performed on the VE South Carbon Bed inlet and outlet and VE South stack. Table 2-1 provides a summary of the HFPO Dimer Acid emissions test results and Carbon Bed removal efficiencies. Detailed test results summaries are provided in Section 6.

It is important to note that emphasis is being placed on the characterization of the emissions based on the stack test results. Research conducted in developing the protocol for stack testing HFPO Dimer Acid Fluoride, HFPO Dimer Acid Ammonium Salt and HFPO Dimer Acid realized that the resulting testing, including collection of the air samples and extraction of the various fraction of the sampling train, would result in all three compounds being expressed as simply the HFPO Dimer Acid. However, it should be understood that the total HFPO Dimer Acid results provided in Table 2-1 and in this report include a percentage of each of the three compounds.

**Table 2-1
Summary of HFPO Dimer Acid VE South Carbon Bed and Stack Test Results**

	Inlet		Outlet		Removal Efficiency	VE South Stack	
	g/sec	lb/hr	g/sec	lb/hr		g/sec	lb/hr
R1	4.17E-04	3.31E-03	6.01E-05	4.78E-04	85.6	3.04E-05	2.41E-04
R2	8.50E-05	6.75E-04	1.71E-05	1.36E-04	79.8	2.17E-05	1.72E-04
R3	3.69E-05	2.93E-04	1.95E-05	1.55E-04	47.1	1.58E-05	1.25E-04
Average	1.80E-04	1.43E-03	3.23E-05	2.56E-04	65.9	2.26E-05	1.80E-04

3. PROCESS DESCRIPTIONS

The Fluoromonomers area is included in the scope of this test program.

3.1 FLUOROMONOMERS

These facilities produce a family of fluorocarbon compounds used to produce Chemours products such as Nafion®[®], Krytox®, and Viton®, as well as sales to outside customers.

The VE South Waste Gas Scrubber and the Tower HVAC are vented to the carbon bed which then vents to the process stack (NEP-Hdr2). In addition, the following building air systems are vented to this stack:

- RV Catch Pots
- Nitrogen Supply to Catch Tanks
- Catalyst Feed Tank Pot Charge Vent

3.2 PROCESS OPERATIONS AND PARAMETERS

The following table is a summary of the operation and products from the specific areas tested.

Source	Operation/Product	Batch or Continuous
VE South	PMVE/PEVE	Semi-continuous – Condensation is continuous, Two Agitated Bed Reactors are batch for 30-40 mins at end of each run*, Refining (ether column) is batch

*Only one Agitated Bed Reactor was running due to cooling limiting capacity during testing.

During the test program, the following parameters were monitored by Chemours and are included in Appendix A.

- Fluoromonomers Processes
 - VE South Waste Gas Scrubber
 - Caustic recirculation flow rate

4. DESCRIPTION OF TEST LOCATIONS

4.1 VE SOUTH STACK

Two 6-inch ID test ports are installed on the 42-inch ID steel stack. The ports are placed 150 inches (3.6 diameters) from the location where the carbon bed vent enters the stack and 20 feet (5.7 diameters) from the stack exit.

Per EPA Method 1, a total of 24 traverse points (12 per axis) were used for M0010 isokinetic sampling. It should be noted that near the port locations are a number of small ducts leading to the stack. These are catch pots which, under normal operation, do not discharge to the stack. They are used to vent process gas to the stack in the event of a process upset. For the purpose of test port location, and given the fact that there is no flow from these catch pots, they are not considered a flow contributor or a disturbance.


See Figure 4-1 for a schematic of the test port and traverse point locations.

Note: All measurements at the test location were confirmed prior to sampling.

4.2 VE SOUTH CARBON BED INLET AND OUTLET

The fiberglass reinforced plastic (FRP) duct at the inlet of the carbon bed is 36-inch ID. The stainless steel duct at the outlet of the carbon bed is 41.5-inch ID. The test ports are located as shown below. Based on EPA Method 1, a total of 24 traverse points (12 per port) were required for HFPO Dimer Acid sampling at both locations. Figures 4-2 and 4-3 provide schematics of the Carbon Bed inlet and Carbon Bed outlet test port and traverse port locations, respectively.


Location	Distance from Flow Disturbance	
	Downstream (B)	Upstream (A)
Carbon Bed Inlet	35 inches > 0.97 duct diameters	41 inches > 1.1 duct diameters
Carbon Bed Outlet	12.5 feet > 4.2 duct diameters	31 feet > 10.3 duct diameters
VE South Stack	150 inches 3.6 duct diameters	20 feet 5.7 diameters

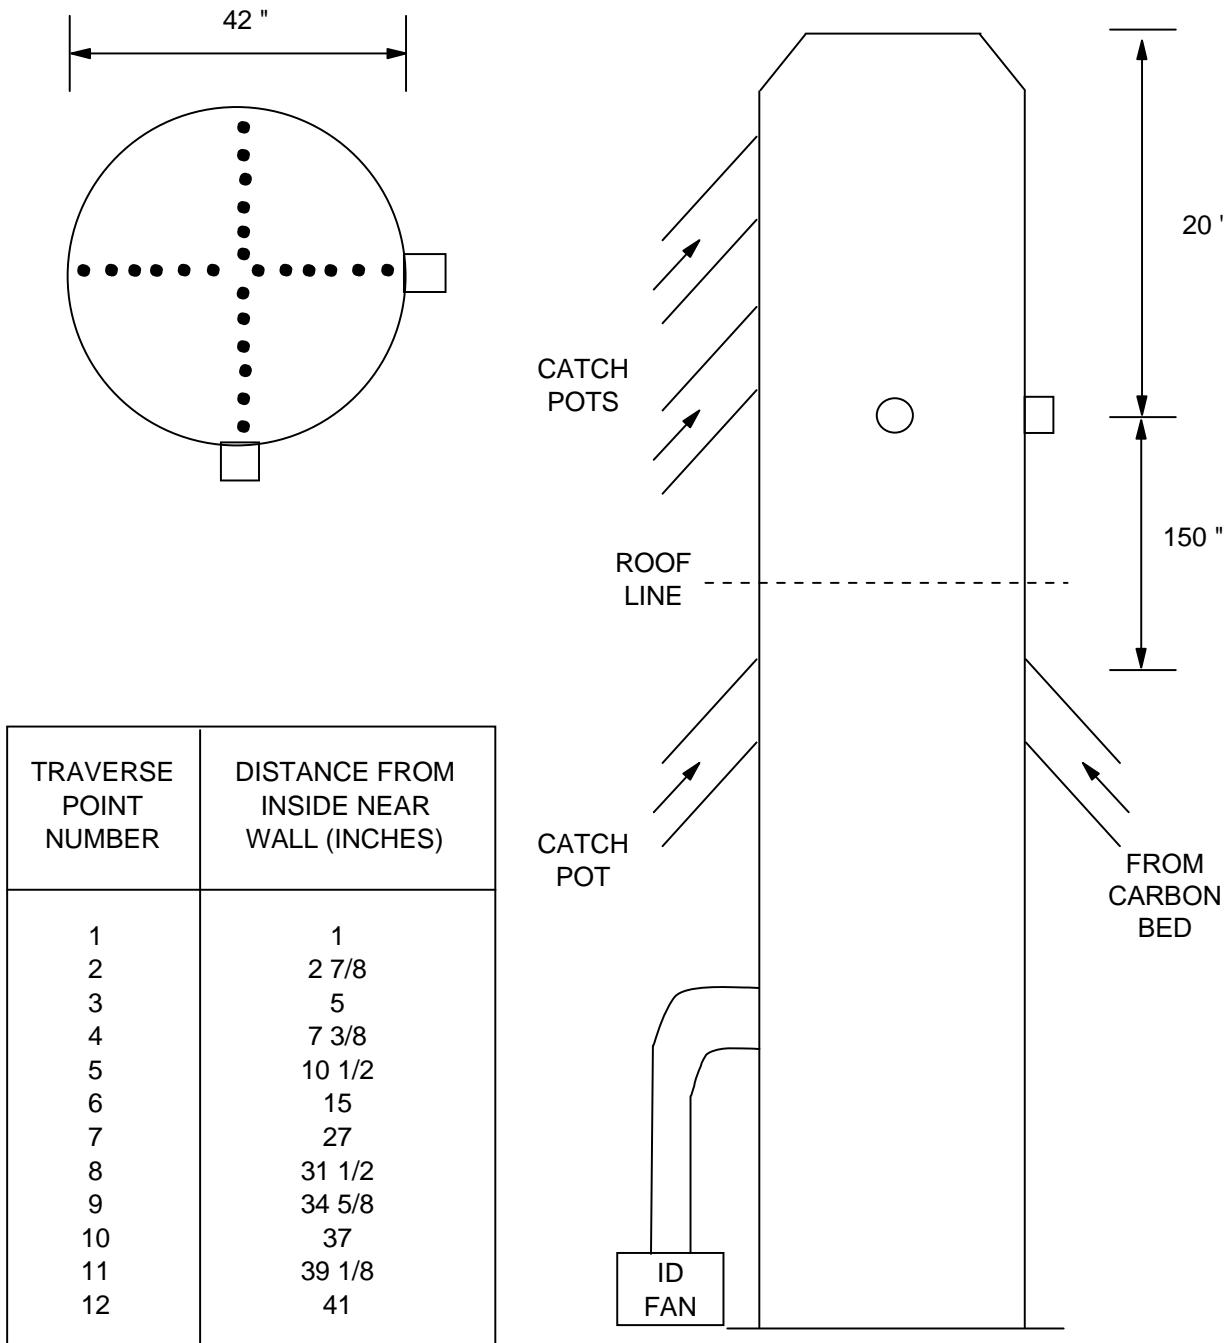


DRAWING NOT TO SCALE

**FIGURE 4-1
VE SOUTH STACK TEST PORT AND
TRAVERSE POINT LOCATION**

Top View

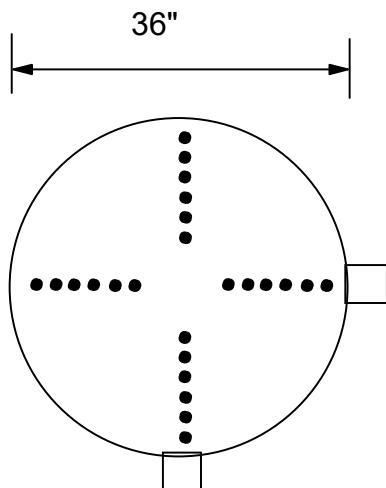


TRAVERSE POINT NUMBER	DISTANCE FROM INSIDE NEAR WALL (INCHES)
1	1
2	2 3/4
3	4 7/8
4	7 3/8
5	10 3/8
6	14 3/4
7	26 3/4
8	31 1/8
9	34 1/8
10	36 5/8
11	38 3/4
12	40 1/2

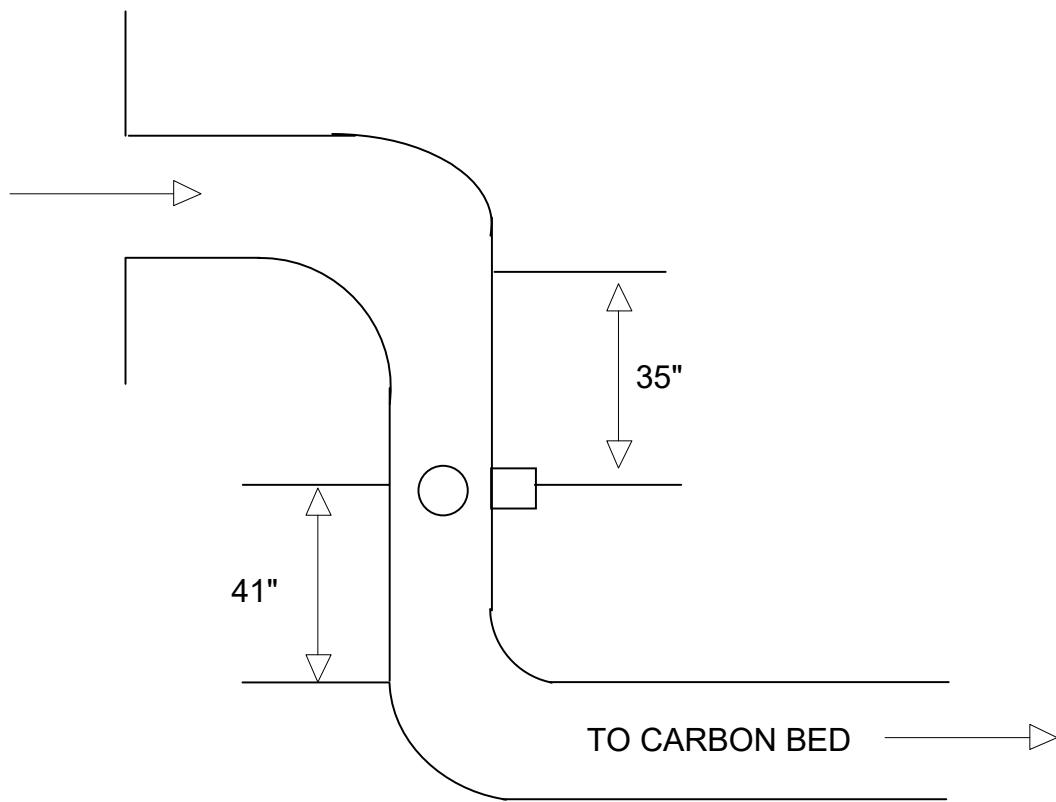


DRAWING NOT TO SCALE

**FIGURE 4-2
VE SOUTH CARBON BED INLET SCHEMATIC**

Side View

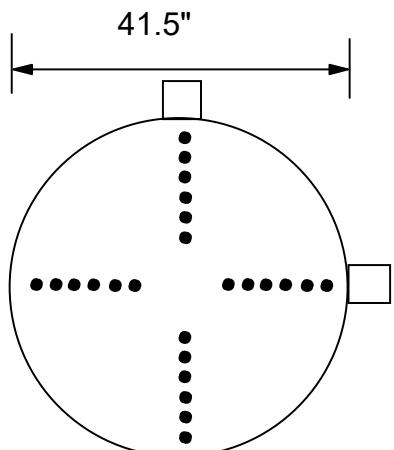

TRAVERSE POINT NUMBER	DISTANCE FROM INSIDE NEAR WALL (INCHES)
1	1
2	2 3/8
3	4 1/4
4	6 3/8
5	9
6	12 7/8
7	23 1/8
8	27
9	29 5/8
10	31 3/4
11	33 5/8
12	35

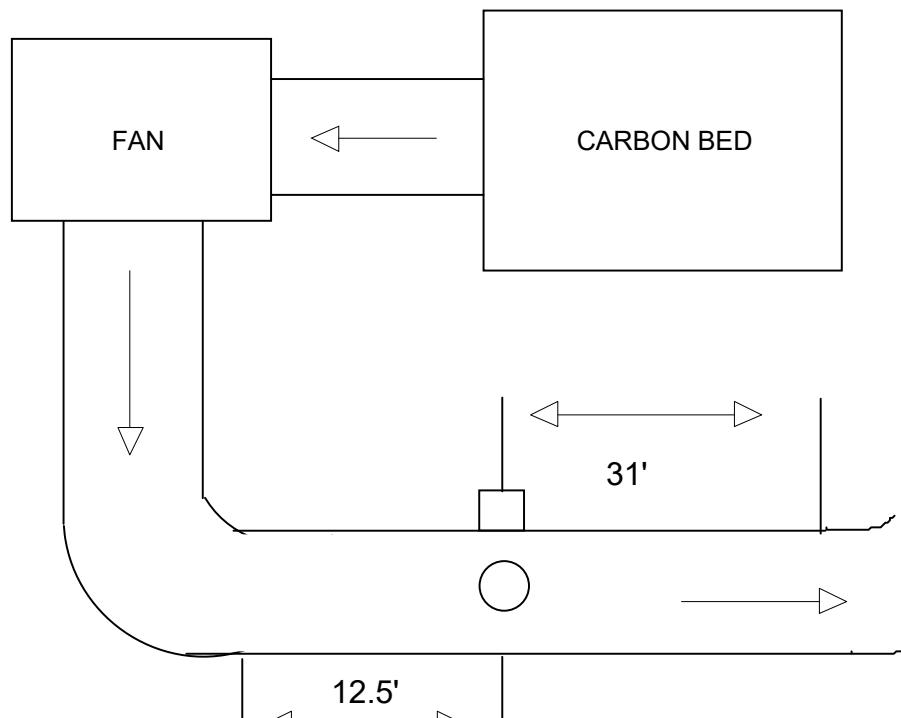

DRAWING NOT TO SCALE

**FIGURE 4-3
VE SOUTH CARBON BED OUTLET SCHEMATIC**

5. SAMPLING AND ANALYTICAL METHODS

5.1 STACK GAS SAMPLING PROCEDURES

The purpose of this section is to describe the stack gas emissions sampling trains and to provide details of the stack sampling and analytical procedures utilized during the emissions test program.

5.1.1 Pre-Test Determinations

Preliminary test data were obtained at each test location. Stack geometry measurements were measured and recorded, and traverse point distances verified. A preliminary velocity traverse was performed utilizing a calibrated S-type pitot tube and an inclined manometer to determine velocity profiles. Flue gas temperatures were observed with a calibrated direct readout panel meter equipped with a chromel-alumel thermocouple. Preliminary water vapor content was estimated by wet bulb/dry bulb temperature measurements.

A check for the presence or absence of cyclonic flow was conducted at each test location. The cyclonic flow checks were negative ($< 20^\circ$) verifying that the test locations were acceptable for testing.


Preliminary test data was used for nozzle sizing and sampling rate determinations for isokinetic sampling procedures.

Calibration of probe nozzles, pitot tubes, metering systems, and temperature measurement devices was performed as specified in Section 5 of EPA Method 5 test procedures.

5.2 STACK PARAMETERS

5.2.1 EPA Method 0010

The sampling train utilized to perform the HFPO Dimer Acid sampling at all three locations was an EPA Method 0010 train (see Figure 5-1). The Method 0010 consisted of a borosilicate nozzle that attached directly to a heated borosilicate probe. In order to minimize possible thermal degradation of the HFPO Dimer Acid, the probe and particulate filter were heated above stack temperature to minimize water vapor condensation before the filter. The probe was connected directly to a heated borosilicate filter holder containing a solvent extracted glass fiber filter.

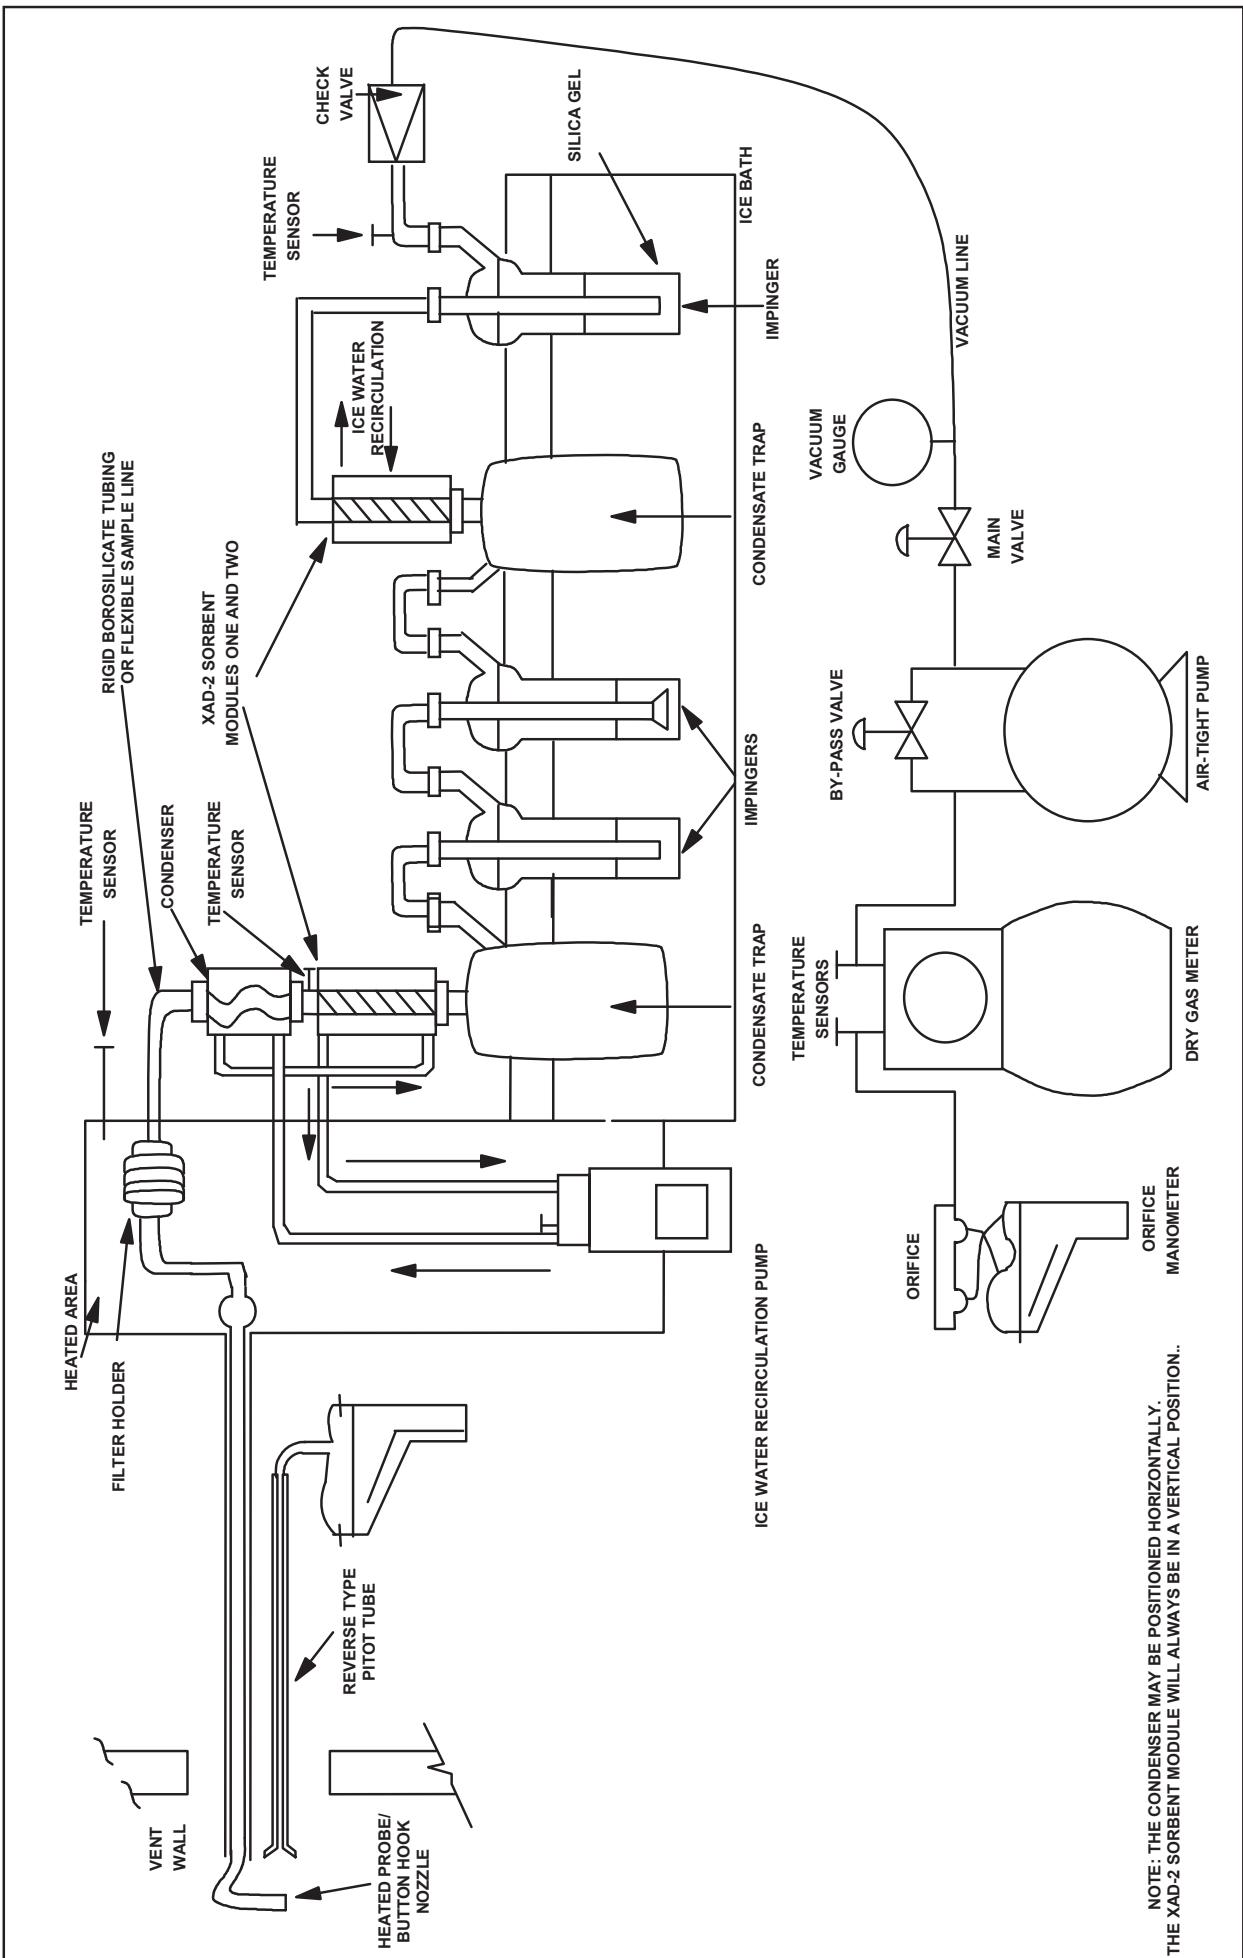

**FIGURE 5-1
EPA METHOD 0010 SAMPLING TRAIN**

A section of borosilicate glass or flexible polyethylene tubing connected the filter holder exit to a Grahm (spiral) type ice water-cooled condenser, an ice water-jacketed sorbent module containing approximately 40 grams of XAD-2 resin. The XAD-2 resin tube was equipped with an inlet temperature sensor. The XAD-2 resin trap was followed by a condensate knockout impinger and a series of two impingers that contained 100 mL of high-purity distilled water. The train also included a second XAD-2 resin trap behind the impinger section to evaluate possible sampling train breakthrough. Each XAD-2 resin trap was connected to a 1-liter condensate knockout trap. The final impinger contained 300 grams of dry pre-weighed silica gel. All impingers and the condensate traps were maintained in an ice bath. Ice water was continuously circulated in the condenser and the XAD-2 module to maintain method-required temperature. A control console with a leakless vacuum pump, a calibrated orifice, and dual inclined manometers was connected to the final impinger via an umbilical cord to complete the sample train.

HFPO Dimer Acid Fluoride (CAS No. 2062-98-8) that is present in the stack gas is expected to be captured in the sampling train along with HFPO Dimer Acid (CAS No. 13252-13-6). HFPO Dimer Acid Fluoride underwent hydrolysis instantaneously in water in the sampling train and during the sample recovery step, and was converted to HFPO Dimer Acid such that the amount of HFPO Dimer Acid emissions represented a combination of both HFPO Dimer Acid Fluoride and HFPO Dimer Acid.

During sampling, gas stream velocities were measured by attaching a calibrated S-type pitot tube into the gas stream adjacent to the sampling nozzle. The velocity pressure differential was observed immediately after positioning the nozzle at each traverse point, and the sampling rate adjusted to maintain isokineticity at $100\% \pm 10$. Flue gas temperature was monitored at each point with a calibrated panel meter and thermocouple. Isokinetic test data was recorded at each traverse point during all test periods, as appropriate. Leak checks were performed on the sampling apparatus according to reference method instructions, prior to and following each run, component change (if required) or during midpoint port changes.

5.2.2 EPA Method 0010 Sample Recovery

At the conclusion of each test, the sampling train was dismantled, the openings sealed, and the components transported to the field laboratory trailer for recovery.

A consistent procedure was employed for sample recovery:

1. The two XAD-2 covered (to minimize light degradation) sorbent modules (1 and 2) were sealed and labeled.
2. The glass fiber filter(s) were removed from the holder with tweezers and placed in a polyethylene container along with any loose particulate and filter fragments.
3. The particulate adhering to the internal surfaces of the nozzle, probe and front half of the filter holder were rinsed with a solution of methanol and ammonium hydroxide into a polyethylene container while brushing a minimum of three times until no visible particulate remained. Particulate adhering to the brush was rinsed with methanol/ammonium hydroxide into the same container. The container was sealed.
4. The volume of liquid collected in the first condensate trap was measured, the value recorded, and the contents poured into a polyethylene container.
5. All train components between the filter exit and the first condensate trap were rinsed with methanol/ammonium hydroxide. The solvent rinse was placed in a separate polyethylene container and sealed.
6. The volume of liquid in impingers one and two, and the second condensate trap, were measured, the values recorded, and the sample was placed in the same container as Step 4 above, then sealed.
7. The two impingers, condensate trap, and connectors were rinsed with methanol/ammonium hydroxide. The solvent sample was placed in a separate polyethylene container and sealed.
8. The silica gel in the final impinger was weighed and the weight gain value recorded.
9. Site (reagent) blank samples of the methanol/ammonium hydroxide, XAD resin, filter and distilled water were retained for analysis.

Each container was labeled to clearly identify its contents. The height of the fluid level was marked on the container of each liquid sample to provide a reference point for a leakage check during transport. All samples were maintained cool.

During the Carbon Bed inlet and outlet test campaign, a Method 0010 blank train was set up near the test location, leak-checked and recovered along with the respective sample train. Following sample recovery, all samples were transported to TestAmerica Laboratories, Inc. (TestAmerica) for sample extraction and analysis.

See Figure 5-2 for a schematic of the Method 0010 sample recovery process.

5.2.3 EPA Method 0010 Sample Analysis


Method 0010 sampling trains resulted in four separate analytical fractions for HFPO Dimer Acid analysis according to SW-846 Method 3542:

- Front-half Composite—comprised of the particulate filter, and the probe, nozzle, and front-half of the filter holder solvent rinses;
- Back-half Composite—comprised of the first XAD-2 resin material and the back-half of the filter holder with connecting glassware solvent rinses;
- Condensate Composite—comprised of the aqueous condensates and the contents of impingers one and two with solvent rinses;
- Breakthrough XAD-2 Resin Tube—comprised of the resin tube behind the series of impingers.

The second XAD-2 resin material was analyzed separately to evaluate any possible sampling train HFPO-DA breakthrough.

The front-half and back-half composites and the second XAD-2 resin material were placed in polypropylene wide-mouth bottles and tumbled with methanol containing 5% NH₄OH for 18 hours. Portions of the extracts were processed analytically for the HFPO dimer acid by liquid chromatography and dual mass spectroscopy (HPLC/MS/MS). The condensate composite was concentrated onto a solid phase extraction (SPE) cartridge followed by desorption from the cartridge using methanol. Portions of those extracts were also processed analytically by HPLC/MS/MS.

HFPO DIMER ACID SAMPLE RECOVERY PROCEDURES FOR METHOD 0010

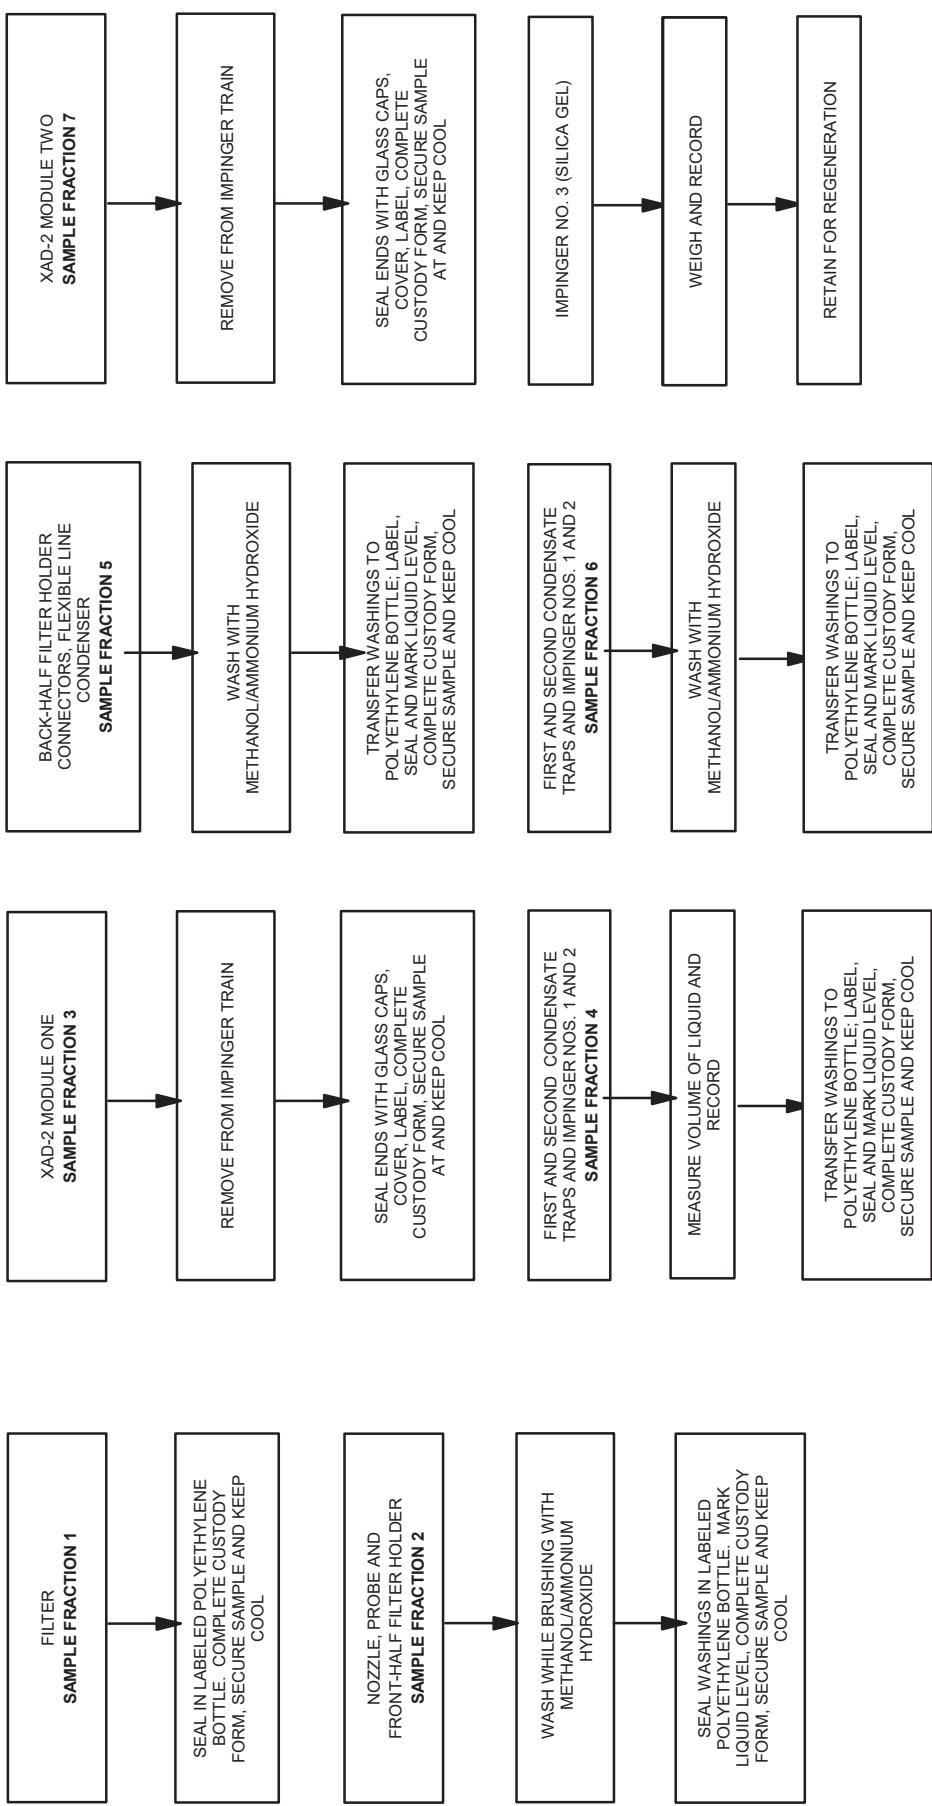

Samples were spiked with isotope dilution internal standard (IDA) at the commencement of their preparation to provide accurate assessments of the analytical recoveries. Final data was corrected for IDA standard recoveries.

TestAmerica developed detailed procedures for the sample extraction and analysis for HFPO Dimer Acid. These procedures were incorporated into the test protocol.

5.3 GAS COMPOSITION

The Weston mobile laboratory equipped with instrumental analyzers was used to measure carbon dioxide (CO₂) and oxygen (O₂) concentrations. A diagram of the Weston sampling system is presented in Figure 5-3.

For the VE South stack test campaign, the sample was collected at the exhaust of the Method 0010 sampling system. At the end of the line, a tee permitted the introduction of calibration gas. The sample was drawn through a heated Teflon® sample line to the sample conditioner. The output from the sampling system was recorded electronically, and one minute averages were recorded and displayed on a data logger.

Each analyzer was set up and calibrated internally by introduction of calibration gas standards directly to the analyzer from a calibration manifold. The calibration manifold is designed with an atmospheric vent to release excess calibration gas and maintained the calibration at ambient pressure. The direct calibration sequence consisted of alternate injections of zero and mid-range gases with appropriate adjustments until the desired responses were obtained. The high-range standards were then introduced in sequence without further adjustment.

The sample line integrity was verified by performing a bias test before and after each test period. The sampling system bias test consisted of introducing the zero gas and one up-range calibration standard in excess to the valve at the probe end when the system was sampling normally. The excess calibration gas flowed out through the probe to maintain ambient sampling system pressure. Calibration gas supply was regulated to maintain constant sampling rate and pressure. Instrument bias check response was compared to internal calibration responses to insure sample line integrity and to calculate a bias correction factor after each run using the ratio of the measured concentration of the bias gas certified by the calibration gas supplier.

The oxygen and carbon dioxide content of each stack gas was measured according to EPA Method 3A procedures which incorporate the latest updates of EPA Method 7E. A Servomex Model 4900 analyzer (or equivalent) was used to measure oxygen content. A Servomex Model 4900 analyzer (or equivalent) was used to measure carbon dioxide content of the stack gas. Both analyzers were calibrated with EPA Protocol gases prior to the start of the test program and performance was verified by sample bias checks before and after each test run.

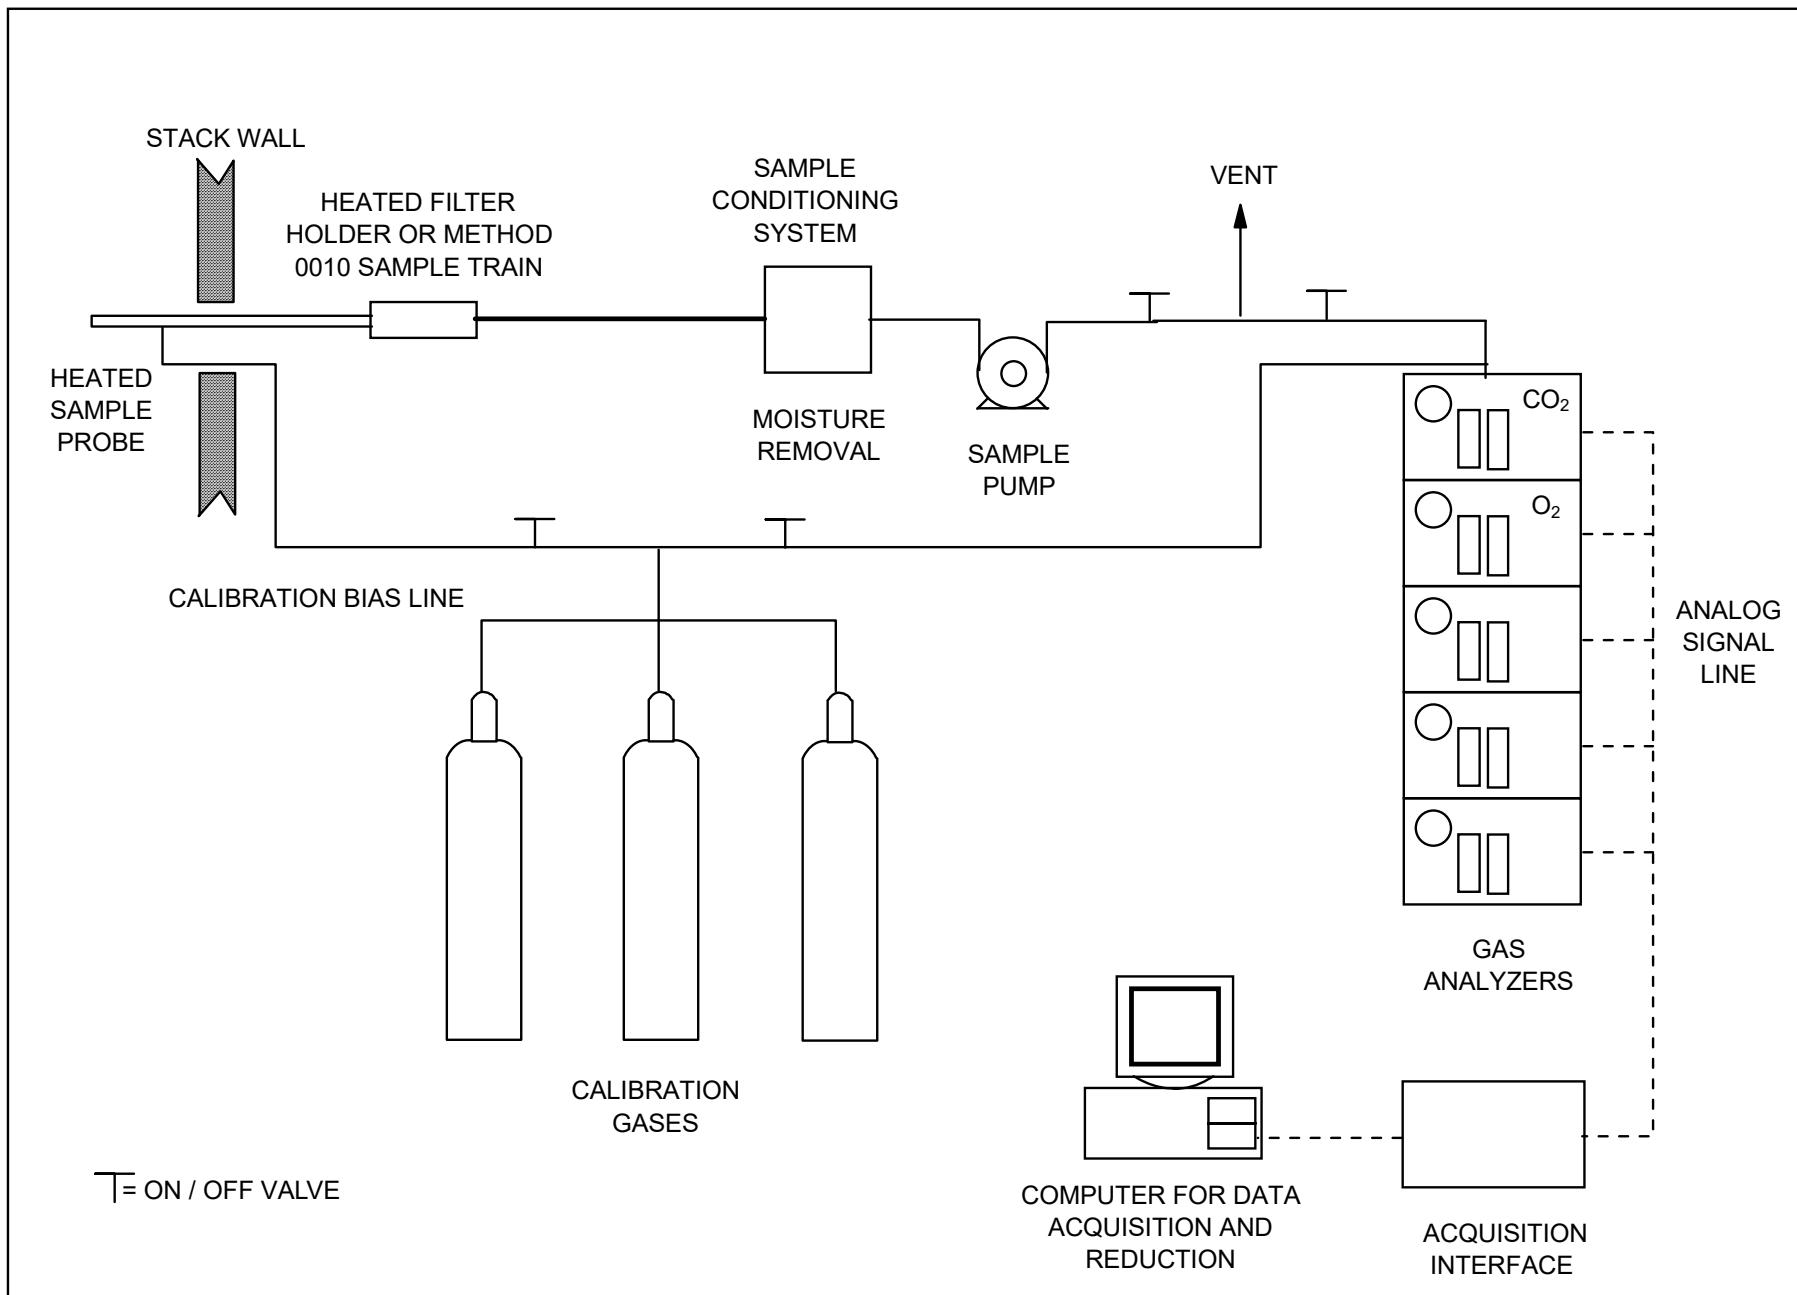


FIGURE 5-5
WESTON SAMPLING SYSTEM

6. DETAILED TEST RESULTS AND DISCUSSION

Each test was a minimum of 96 minutes in duration. A total of three test runs were performed simultaneously at each location.

Chemours is continuing to investigate the differences in gas stream velocity and volumetric flow exiting the carbon bed and exiting the stack.

Tables 6-1 through 6-3 provide detailed test data and test results for the VE South Carbon Bed inlet, the Carbon Bed outlet and the VE South stack, respectively.

The carbon bed removal efficiency was calculated based upon the HFPO Dimer Acid inlet and outlet mass emission rates in lb/hr.

The Method 3A sampling on the VE South stack indicated that the O₂ and CO₂ concentrations were at ambient air levels (20.9% O₂, 0% CO₂), therefore, 20.9% O₂ and 0% CO₂ values were used in all calculations.

TABLE 6-1
CHEMOURS - FAYETTEVILLE, NC
SUMMARY OF HFPO DIMER ACID TEST DATA AND TEST RESULTS
VES CARBON BED INLET

Test Data

	1 VES CBed Inlet	2 VES CBed Inlet	3 VES CBed Inlet
Run number			
Location	VES CBed Inlet	VES CBed Inlet	VES CBed Inlet
Date	07/16/19	07/17/19	07/17/19
Time period	1605-1841	0905-1058	1250-1502

SAMPLING DATA:

Sampling duration, min.	96.0	96.0	96.0
Nozzle diameter, in.	0.160	0.160	0.160
Cross sectional nozzle area, sq.ft.	0.000140	0.000140	0.000140
Barometric pressure, in. Hg	30.06	30.09	30.06
Avg. orifice press. diff., in H ₂ O	0.97	1.00	1.02
Avg. dry gas meter temp., deg F	102.0	93.6	102.8
Avg. abs. dry gas meter temp., deg. R	562	554	563
Total liquid collected by train, ml	29.5	28.2	48.7
Std. vol. of H ₂ O vapor coll., cu.ft.	1.39	1.33	2.29
Dry gas meter calibration factor	1.0066	1.0066	1.0066
Sample vol. at meter cond., dcf	50.909	51.412	51.767
Sample vol. at std. cond., dscf ⁽¹⁾	48.469	49.741	49.222
Percent of isokinetic sampling	99.7	101.2	101.1

GAS STREAM COMPOSITION DATA:

CO ₂ , % by volume, dry basis	0.0	0.0	0.0
O ₂ , % by volume, dry basis	20.9	20.9	20.9
N ₂ , % by volume, dry basis	79.1	79.1	79.1
Molecular wt. of dry gas, lb/lb mole	28.84	28.84	28.84
H ₂ O vapor in gas stream, prop. by vol.	0.028	0.026	0.045
Mole fraction of dry gas	0.972	0.974	0.955
Molecular wt. of wet gas, lb/lb mole	28.53	28.55	28.35

GAS STREAM VELOCITY AND VOLUMETRIC FLOW DATA:

Static pressure, in. H ₂ O	-5.50	-5.50	-5.50
Absolute pressure, in. Hg	29.66	29.69	29.66
Avg. temperature, deg. F	100	92	97
Avg. absolute temperature, deg.R	560	552	557
Pitot tube coefficient	0.84	0.84	0.84
Total number of traverse points	24	24	24
Avg. gas stream velocity, ft./sec.	66.5	66.1	67.5
Stack/duct cross sectional area, sq.ft.	7.07	7.07	7.07
Avg. gas stream volumetric flow, wacf/min.	28214	28035	28617
Avg. gas stream volumetric flow, dscf/min.	25641	25919	25674

⁽¹⁾ Standard conditions = 68 deg. F. (20 deg. C.) and 29.92 in Hg (760 mm Hg)

*Run 3 conducted prior to Run 2

TABLE 6-1 (cont.)
CHEMOURS - FAYETTEVILLE, NC
SUMMARY OF HFPO DIMER ACID TEST DATA AND TEST RESULTS
VES CARBON BED INLET

TEST DATA

Run number	1 VES CBed	2 VES CBed	3 VES CBed
Location	Inlet	Inlet	Inlet
Date	07/16/19	07/17/19	07/17/19
Time period	1605-1841	0905-1058	1250-1502

LABORATORY REPORT DATA, ug.

HFPO Dimer Acid	47.37	9.79	4.25
-----------------	-------	------	------

EMISSION RESULTS, ug/dscm.

HFPO Dimer Acid	34.51	6.95	3.05
-----------------	-------	------	------

EMISSION RESULTS, lb/dscf.

HFPO Dimer Acid	2.15E-09	4.34E-10	1.90E-10
-----------------	----------	----------	----------

EMISSION RESULTS, lb/hr.

HFPO Dimer Acid	3.31E-03	6.75E-04	2.93E-04
-----------------	----------	----------	----------

EMISSION RESULTS, g/sec.

HFPO Dimer Acid	4.17E-04	8.50E-05	3.69E-05
-----------------	----------	----------	----------

TABLE 6-2
CHEMOURS - FAYETTEVILLE, NC
SUMMARY OF HFPO DIMER ACID TEST DATA AND TEST RESULTS
VES CARBON BED OUTLET

Test Data

	1 VES CBed Outlet	2 VES CBed Outlet	3 VES CBed Outlet
Run number			
Location	07/16/19	07/17/19	07/17/19
Date	1605-1841	0905-1058	1250-1502
Time period			

SAMPLING DATA:

Sampling duration, min.	96.0	96.0	96.0
Nozzle diameter, in.	0.202	0.202	0.202
Cross sectional nozzle area, sq.ft.	0.000223	0.000223	0.000223
Barometric pressure, in. Hg	30.06	30.09	30.06
Avg. orifice press. diff., in H ₂ O	1.26	1.31	1.32
Avg. dry gas meter temp., deg F	104.7	96.0	107.1
Avg. abs. dry gas meter temp., deg R	565	556	567
Total liquid collected by train, ml	34.0	24.2	46.4
Std. vol. of H ₂ O vapor coll., cu.ft.	1.60	1.14	2.19
Dry gas meter calibration factor	1.0069	1.0069	1.0069
Sample vol. at meter cond., dcf	58.439	58.943	59.828
Sample vol. at std. cond., dscf ⁽¹⁾	55.427	56.835	56.507
Percent of isokinetic sampling	97.3	98.5	99.2

GAS STREAM COMPOSITION DATA:

CO ₂ , % by volume, dry basis	0.0	0.0	0.0
O ₂ , % by volume, dry basis	20.9	20.9	20.9
N ₂ , % by volume, dry basis	79.1	79.1	79.1
Molecular wt. of dry gas, lb/lb mole	28.84	28.84	28.84
H ₂ O vapor in gas stream, prop. by vol.	0.028	0.020	0.037
Mole fraction of dry gas	0.972	0.980	0.963
Molecular wt. of wet gas, lb/lb mole	28.53	28.62	28.43

GAS STREAM VELOCITY AND VOLUMETRIC FLOW DATA:

Static pressure, in. H ₂ O	2.40	2.40	2.40
Absolute pressure, in. Hg	30.24	30.27	30.24
Avg. temperature, deg. F	100	98	100
Avg. absolute temperature, deg.R	560	558	560
Pitot tube coefficient	0.84	0.84	0.84
Total number of traverse points	24	24	24
Avg. gas stream velocity, ft./sec.	48.0	47.9	48.5
Stack/duct cross sectional area, sq.ft.	9.39	9.39	9.39
Avg. gas stream volumetric flow, wacf/min.	27061	27013	27311
Avg. gas stream volumetric flow, dscf/min.	25043	25357	25032

⁽¹⁾ Standard conditions = 68 deg. F. (20 deg. C.) and 29.92 in Hg (760 mm Hg)

*Run 3 conducted prior to Run 2

TABLE 6-2 (cont.)
CHEMOURS - FAYETTEVILLE, NC
SUMMARY OF HFPO DIMER ACID TEST DATA AND TEST RESULTS
VES CARBON BED OUTLET

TEST DATA

Run number	1	2	3
Location	VES CBed Outlet	VES CBed Outlet	VES CBed Outlet
Date	07/16/19	07/17/19	07/17/19
Time period	1605-1841	0905-1058	1250-1502

LABORATORY REPORT DATA, ug.

HFPO Dimer Acid	7.99	2.30	2.65
-----------------	------	------	------

EMISSION RESULTS, ug/dscm.

HFPO Dimer Acid	5.09	1.43	1.65
-----------------	------	------	------

EMISSION RESULTS, lb/dscf.

HFPO Dimer Acid	3.18E-10	8.94E-11	1.03E-10
-----------------	----------	----------	----------

EMISSION RESULTS, lb/hr.

HFPO Dimer Acid	4.78E-04	1.36E-04	1.55E-04
HFPO Dimer Acid (From Inlet Data)	3.31E-03	6.75E-04	2.93E-04

EMISSION RESULTS, g/sec.

HFPO Dimer Acid	6.01E-05	1.71E-05	1.95E-05
-----------------	----------	----------	----------

Carbon Bed Removal Efficiency, %	85.6	79.8	47.1
----------------------------------	------	------	------

TABLE 6-3
CHEMOURS - FAYETTEVILLE, NC
SUMMARY OF HFPO DIMER ACID TEST DATA AND TEST RESULTS
VE SOUTH STACK

Test Data

	1	2	3
Run number	VE South Stack	VE South Stack	VE South Stack
Location	07/16/19	07/17/19	07/17/19
Date	1605-1841	0905-1058	1250-1502
Time period			

SAMPLING DATA:

Sampling duration, min.	96.0	96.0	96.0
Nozzle diameter, in.	0.190	0.190	0.190
Cross sectional nozzle area, sq.ft.	0.000197	0.000197	0.000197
Barometric pressure, in. Hg	30.00	30.07	30.07
Avg. orifice press. diff., in H ₂ O	0.79	0.79	0.76
Avg. dry gas meter temp., deg F	98.5	87.9	99.0
Avg. abs. dry gas meter temp., deg. R	558	548	559
Total liquid collected by train, ml	45.5	45.1	41.9
Std. vol. of H ₂ O vapor coll., cu.ft.	2.1	2.1	2.0
Dry gas meter calibration factor	1.0008	1.0008	1.0008
Sample vol. at meter cond., dcf	50.910	49.525	50.263
Sample vol. at std. cond., dscf ⁽¹⁾	48.374	48.079	47.822
Percent of isokinetic sampling	106.3	105.3	105.2

GAS STREAM COMPOSITION DATA:

CO ₂ , % by volume, dry basis	0.0	0.0	0.0
O ₂ , % by volume, dry basis	20.9	20.9	20.9
N ₂ , % by volume, dry basis	79.1	79.1	79.1
Molecular wt. of dry gas, lb/lb mole	28.84	28.84	28.84
H ₂ O vapor in gas stream, prop. by vol.	0.042	0.042	0.040
Mole fraction of dry gas	0.958	0.958	0.960
Molecular wt. of wet gas, lb/lb mole	28.38	28.38	28.41

GAS STREAM VELOCITY AND VOLUMETRIC FLOW DATA:

Static pressure, in. H ₂ O	2.50	2.50	2.50
Absolute pressure, in. Hg	30.18	30.25	30.25
Avg. temperature, deg. F	100	97	100
Avg. absolute temperature, deg.R	560	557	560
Pitot tube coefficient	0.84	0.84	0.84
Total number of traverse points	24	24	24
Avg. gas stream velocity, ft./sec.	44.1	43.9	43.8
Stack/duct cross sectional area, sq.ft.	9.62	9.62	9.62
Avg. gas stream volumetric flow, wacf/min.	25447	25348	25293
Avg. gas stream volumetric flow, dscf/min.	23157	23242	23134

⁽¹⁾ Standard conditions = 68 deg. F. (20 deg. C.) and 29.92 in Hg (760 mm Hg)

TABLE 6-3 (cont.)
CHEMOURS - FAYETTEVILLE, NC
SUMMARY OF HFPO DIMER ACID TEST DATA AND TEST RESULTS
VE SOUTH STACK

TEST DATA

	1	2	3
Run number			
Location	VE South Stack	VE South Stack	VE South Stack
Date	07/16/19	07/17/19	07/17/19
Time period	1605-1841	0905-1058	1250-1502

LABORATORY REPORT DATA, ug.

HFPO Dimer Acid	3.8080	2.6950	1.9560
-----------------	--------	--------	--------

EMISSION RESULTS, ug/dscm.

HFPO Dimer Acid	2.78	1.98	1.44
-----------------	------	------	------

EMISSION RESULTS, lb/dscf.

HFPO Dimer Acid	1.74E-10	1.24E-10	9.02E-11
-----------------	----------	----------	----------

EMISSION RESULTS, lb/hr.

HFPO Dimer Acid	2.41E-04	1.72E-04	1.25E-04
-----------------	----------	----------	----------

EMISSION RESULTS, g/sec.

HFPO Dimer Acid	3.04E-05	2.17E-05	1.58E-05
-----------------	----------	----------	----------

APPENDIX A
PROCESS OPERATIONS DATA

Date: 7/16/19

Time	1500				1600				1700				1800				1900																	
Stack Testing					RUN 1: 1605 - 1841																													
VES Product	PM/PE																																	
VES Precursor																																		
VES Condensation (HFPO)																																		
VES ABR (East)																																		
VES ABR (West)												Burnout																						
VES Refining																																		
VES WGS Recirculation Flow	18500 kg/h																																	
Dimer ISO venting																																		

Date: 7/17/19

Time	800	900	1000	1100	1200	1300	1400	1500	1600
Stack Testing			RUN 2: 0905 - 1058				RUN 3: 1250 - 1502		
VES Product							PM/PE		
VES Precursor									
VES Condensation (HPO)									
VES ABR (East)									
VES ABR (West)		Burnout							
VES Refining									
VES WGS Recirculation Flow							18500 kg/h		
Dimer ISO venting									

APPENDIX B
RAW AND REDUCED TEST DATA

Sample and Velocity Traverse Point Data Sheet - Method 1

Client Chemours
 Location/Plant Fayetteville
 Source VES CB Out

Operator 070/5m/16
 Date 7-16-19
 W.O. Number _____

Duct Type	<input type="checkbox"/> Circular	<input type="checkbox"/> Rectangular Duct	Indicate appropriate type
Traverse Type	<input checked="" type="checkbox"/> Particulate Traverse	<input type="checkbox"/> Velocity Traverse	<input type="checkbox"/> CEM Traverse

Distance from far wall to outside of port (in.) = C.	<u>55.5</u>
Port Depth (in.) = D	<u>17</u> <u>36"</u>
Depth of Duct, diameter (in.) = C-D	<u>38.5</u> <u>36"</u> <u>41.5</u>
Area of Duct (ft ²)	<u>24.9, 39</u>
Total Traverse Points	<u>24</u>
Total Traverse Points per Port	<u>12</u>
Port Diameter (in.) —(Flange-Threaded-Hole)	
Monorail Length	
Rectangular Ducts Only	
Width of Duct, rectangular duct only (in.)	<u>X</u>
Total Ports (rectangular duct only)	<u>X</u>
Equivalent Diameter = $(2^*L^*W)/(L+W)$	<u>X</u>

Traverse Point Locations			
Traverse Point	% of Duct	Distance from Inside Duct Wall (in)	Distance from Outside of Port (in)
1	.021	0.875	14.875
2	.067	2.785	16.785
3	.113	4.897	18.897
4	.177	7.35	21.35
5	.250	10.375	24.375
6	.356	14.77	28.77
7	.644	26.73	40.73
8	.750	31.125	45.125
9	.873	34.155	48.155
10	.882	36.60	50.6
11	.933	38.72	52.72
12	.979	40.63	54.63

52.72

CEM 3 Point (Long Measurement Line) Stratification Point Locations

1	0.167		
2	0.50		
3	0.833		


Note: If stack dia < 12 inch use EPA Method 1A
 (Sample port upstream of pitot port)

Note: If stack dia >24" then adjust traverse point to 1 inch from wall
 If stack dia <24" then adjust traverse point to 0.5 inch from wall

Traverse Point Location Percent of Stack -Circular												
Number of Traverse Points												
T	1	2	3	4	5	6	7	8	9	10	11	12
r	14.6	6.7	4.4	3.2	2.6	2.1						
a	85.4	25	14.6	10.5	8.2	6.7						
v		75	29.6	19.4	14.6	11.8						
e			93.3	70.4	32.3	22.6	17.7					
c				85.4	67.7	34.2	25					
s					95.6	80.6	65.8	35.6				
e						89.5	77.4	64.4				
i							96.8	85.4	75			
P								91.8	82.3			
o									97.4	88.2		
n										93.3		
t											97.9	

Flow Disturbances			
Upstream - A (ft)	<u>31'</u>	Downstream - B (ft)	<u>12' 6"</u>
Upstream - A (duct diameters)	<u>10.3</u>	Downstream - B (duct diameters)	<u>4.2</u>

Diagram of Stack

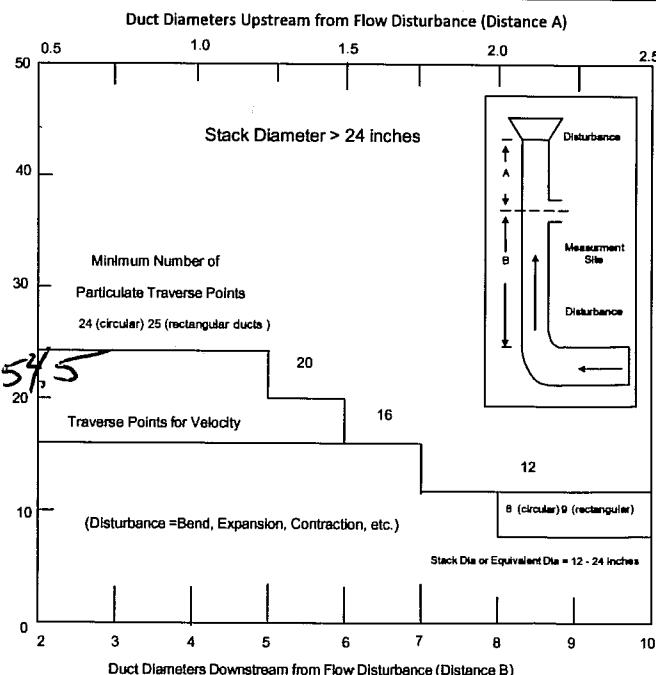

Traverse Point Location Percent of Stack -Rectangular												
Number of Traverse Points												
T	1	2	3	4	5	6	7	8	9	10	11	12
r	25.0	16.7	12.5	10.0	8.3	7.1	6.3	5.6	5.0	4.5	4.2	
a	75.0	50.0	37.5	30.0	25.0	21.4	18.8	16.7	15.0	13.6	12.5	
v		83.3	62.5	50.0	41.7	35.7	31.3	27.8	25.0	22.7	20.8	
e			87.5	70.0	58.3	50.0	43.3	38.9	35.0	31.8	29.2	
c				90.0	75.0	64.3	56.3	50.0	45.0	40.9	37.5	
s					91.7	78.6	68.8	61.1	55.0	50.0	45.8	
e						92.9	81.3	72.2	65.0	59.1	54.2	
i							93.8	83.3	75.0	68.2	62.5	
P								94.4	85.0	77.3	70.8	
o									95.0	86.4	79.2	
n										95.5	87.5	
t											95.8	

WESTERN

Sample and Velocity Traverse Point Data Sheet - Method 1

Client Chenour
 Location/Plant Project No. 110
 Source VES C13 Inlet

Operator _____
 Date 7-16-19
 W.O. Number _____

Duct Type	<input type="checkbox"/> Circular	<input type="checkbox"/> Rectangular Duct	Indicate appropriate type
Traverse Type	<input checked="" type="checkbox"/> Particulate Traverse	<input type="checkbox"/> Velocity Traverse	<input type="checkbox"/> CEM Traverse

Distance from far wall to outside of port (in.) = C	<u>49.5</u>
Port Depth (in.) = D	<u>9.5+4</u>
Depth of Duct, diameter (in.) = C-D	<u>36</u>
Area of Duct (ft ²)	<u>7.063</u>
Total Traverse Points	<u>24</u>
Total Traverse Points per Port	<u>12</u>
Port Diameter (in.) --(Flange-Threaded-Hole)	
Monorail Length	<u>9'</u>
Rectangular Ducts Only	
Width of Duct, rectangular duct only (in.)	X
Total Ports (rectangular duct only)	X
Equivalent Diameter = $(2L \cdot W)/(L+W)$	X

Traverse Point Locations			
Traverse Point	% of Duct	Distance from Inside Duct Wall (in)	Distance from Outside of Port (in)
1	.021	1	<u>14 1/2</u>
2	.067	<u>2 3/8</u>	<u>15 7/8</u>
3	.113	<u>4 1/4</u>	<u>17 7/8</u>
4	.177	<u>6 3/8</u>	<u>19 7/8</u>
5	.250	<u>9</u>	<u>22 1/2</u>
6	.356	<u>12 7/8</u>	<u>26 7/8</u>
7	.444	<u>23 1/8</u>	<u>36 5/8</u>
8	.75	<u>27</u>	<u>40 1/2</u>
9	.823	<u>29 3/8</u>	<u>43</u>
10	.882	<u>31 3/4</u>	<u>45 1/4</u>
11	.933	<u>33 5/8</u>	<u>47</u>
12	.979	<u>35</u>	<u>48 1/2</u>

CEM 3 Point(Long Measurement Line) Stratification Point Locations			
1	0.167	2	0.50
1	0.167		
2	0.50		
3	0.833		

Note: If stack dia < 12 inch use EPA Method 1A



(Sample port upstream of pitot port)

Note: If stack dia >24" then adjust traverse point to 1 inch from wall

If stack dia <24" then adjust traverse point to 0.5 inch from wall

Traverse Point Location Percent of Stack -Circular												
Number of Traverse Points												
	1	2	3	4	5	6	7	8	9	10	11	12
T	14.6	6.7		4.4	3.2		2.6		2.1			
r	85.4	25		14.6	10.5		8.2		6.7			
a			75		29.6		19.4		14.6		11.8	
v				93.3	70.4		32.3		22.6		17.7	
L					85.4		67.7		34.2		25	
e						95.6		80.6		65.8		35.6
r							89.5		77.4		64.4	
s								96.8		85.4		75
a									91.8		82.3	
s										97.4		88.2
t											93.3	
P												97.9
o												
n												
i												
n												
t												

Flow Disturbances	
Upstream - A (ft)	<u>41</u>
Downstream - B (ft)	<u>35</u>
Upstream - A (duct diameters)	<u>1.14</u>
Downstream - B (duct diameters)	<u>0.97</u>

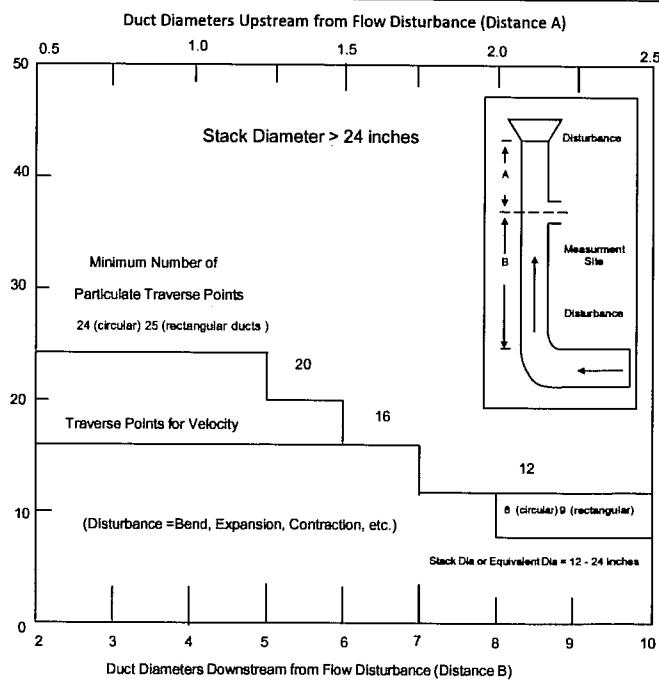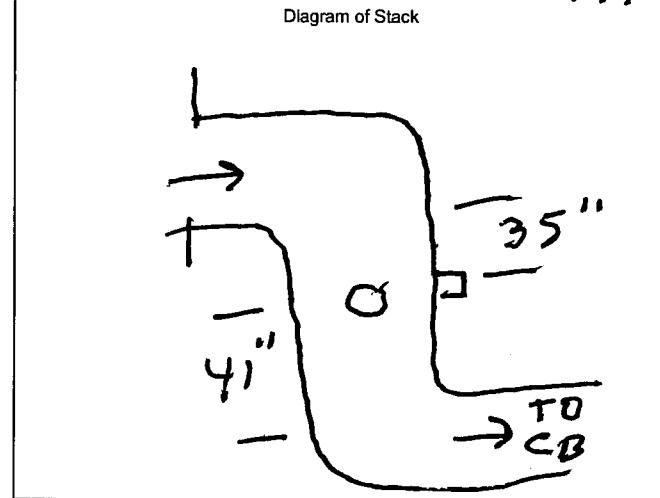

Duct Diameters Downstream from Flow Disturbance (Distance B)

Traverse Point Location Percent of Stack -Rectangular												
Number of Traverse Points												
	1	2	3	4	5	6	7	8	9	10	11	12
T	25.0	16.7	12.5	10.0	8.3	7.1	6.3	5.6	5.0	4.5	4.2	
r	75.0	50.0	37.5	30.0	25.0	21.4	18.8	16.7	15.0	13.6	12.5	
a			83.3	62.5	50.0	41.7	35.7	31.3	27.8	25.0	22.7	20.8
v				87.5	70.0	58.3	50.0	43.8	38.9	35.0	31.8	29.2
L					90.0	75.0	64.3	56.3	50.0	45.0	40.9	37.5
e						91.7	70.6	68.8	61.1	55.0	50.0	45.8
s							92.9	81.3	72.2	65.0	59.1	54.2
a								93.8	83.3	75.0	68.2	62.5
s									94.4	85.0	77.3	70.8
t										95.0	86.4	79.2
P											95.5	87.5
o												95.8
n												
i												
n												
t												

WESTERN

CHEMOURS - FAYETTEVILLE, NC
INPUTS FOR HFPO DIMER ACID CALCULATIONS
VES CARBON BED INLET

Test Data

	1	2	3
Run number	VES CBed Inlet	VES CBed Inlet	VES CBed Inlet
Location	07/16/19	07/17/19	07/17/19
Date	1605-1841	0905-1058	1250-1502
Time period	JDO/NG	KA/NG	KA/NG
Operator			

Inputs For Calcs.


Sq. rt. delta P	1.13927	1.14111	1.15441
Delta H	0.9663	0.9988	1.0171
Stack temp. (deg.F)	99.6	91.7	97.1
Meter temp. (deg.F)	102.0	93.6	102.8
Sample volume (act.)	50.909	51.412	51.767
Barometric press. (in.Hg)	30.06	30.09	30.06
Volume H ₂ O imp. (ml)	12.0	10.0	25.0
Weight change sil. gel (g)	17.5	18.2	23.7
% CO ₂	0.0	0.0	0.0
% O ₂	20.9	20.9	20.9
% N ₂	79.1	79.1	79.1
Area of stack (sq.ft.)	7.068	7.068	7.068
Sample time (min.)	96.0	96.0	96.0
Static pressure (in.H ₂ O)	-5.50	-5.50	-5.50
Nozzle dia. (in.)	0.160	0.160	0.160
Meter box cal.	1.0066	1.0066	1.0066
Cp of pitot tube	0.84	0.84	0.84
Traverse points	24	24	24

Determination of Stack Gas Velocity - Method 2

Client Chemours
 Location/Plant Fergusonville
 Source VES CB In
 Run Number PRK
 Time 1315-1340
 Barometric Press, in Hg (Pb) 30.03
 Static Press, in H₂O (Pstatic) -2.7
 Source Moisture, % (BWS) 2.2%
 O₂, % 20.9
 CO₂, % 0.0

Operator JDO/JNG
 Date 7/16/19
 Pitot Coeff (Cp) .840
 Stack Area, ft² (As) 7.068
 Pitot Tube/Thermo ID P706

AS
 7,068



Cyclonic Flow Determination		Traverse Location		Leak Check good ? Y / N		Leak Check good ? Y / N		Leak Check good ? Y / N	
Delta P at 0°	Angle yielding zero Delta P	Port	Point	Delta P	Source Temp, F° (Ts)	Delta P	Source Temp, F° (Ts)	Delta P	Source Temp, F° (Ts)
.05	3	X	1	1.1	101				
0	0		2	1.3	101				
0	0		3	1.2	101				
0	0		4	1.1	100				
-1	6		5	1.2	100				
0	0		6	1.3	99				
0	0		7	1.4	99				
.05	5		8	1.5	99				
0	0		9	1.4	98				
0	0		10	1.5	98				
0	0		11	1.7	98				
0	0		12	1.6	98				
 .05 S		Y		1	3.1	99			
0	0		2	3.3	99				
0	0		3	2.1	99				
0	0		4	2.0	99				
-1	8		5	1.3	99				
0	0		6	1.7	99				
0	0		7	1.2	98				
0	0		8	1.0	98				
0	0		9	.80	98				
.05	5		10	.79	98				
0	0		11	.72	98				
0	0		12	.60	98				
Avg Angle	15	Avg Delta P & Temp		1.39	99				
		Avg $\sqrt{\Delta P}$		1.1609	✓				
		Average gas stream velocity, ft/sec.		67.1	✓				
		Vol. flow rate @ actual conditions, wacf/min		28700					
		Vol. flow rate at standard conditions, dscf/min		26400					

$$MWd = (0.32 \cdot O_2) + (0.44 \cdot CO_2) + (0.28 \cdot (100 - (CO_2 + O_2)))$$

$$MWs = (MWd \cdot (1 - (BWS/100))) + (18 \cdot (BWS/100))$$

$$Tsa = Ts + 460$$

$$Ps = Pb + (Pstatic/13.6)$$

$$Vs = 85.48 \cdot Cp \cdot \text{avg } \sqrt{\Delta P} \cdot \sqrt{Tsa/(Ps \cdot MWs)}$$

$$Qs(\text{act}) = 60 \cdot Vs \cdot As$$

$$Qs(\text{std}) = 17.64 \cdot (1 - (BWS/100)) \cdot (Ps/Tsa) \cdot Qs(\text{act})$$

- Note: Micromanometer is required if:
- (A) The average Delta P readings are less than 0.05 inches of water.
 - (B) For traverses of 12 or more points, more than 10% of the Delta P readings are below 0.05 inches of water.
 - (C) For traverses of less than 12 points, more than one Delta P reading is below 0.05 inches of water.

MWd = Dry molecular weight source gas, lb/lb-mole.

MWs = Wet molecular weight source gas, lb/lb-mole.

Tsa = Source Temperature, absolute(oR)

Ps = Absolute stack static pressure, inches Hg.

Vs = Average gas stream velocity, ft/sec.

Qs(act) = Volumetric flow rate of wet stack gas at actual, wacf/min

Qs(std) = Volumetric flow rate of dry stack gas at standard conditions, dscf/min

1.31
WESTON
CORPORATIONS

ISOKINETIC FIELD DATA SHEET

Client Chemours
 W.O.# 15418.002.016
 Project ID Chemours % Moisture
 Mode/Source ID Carbon Bed Impinger Vol (ml)
 Samp. Loc. ID IN Silica gel (g)
 Run No.ID 1 CO₂, % by Vol
 Test Method ID M0010 O₂, % by Vol
 Date ID 16 JULY 2019 Temperature (°F)
 Source/Location VE South CB Inlet Meter Temp (°F)
 Sample Date 7-16-19 Static Press (in H₂O)
 Baro. Press (in Hg) 30.06 ✓
 Operator 2001NG Ambient Temp (°F) 98.4

Stack Conditions
 Assumed Actual
 200 200
 300 300
 0 0
 20.9 20.9
 100 100
 100 100
 -5 -5.9
 Avg Nozzle Dia (in) 0.84
 Area of Stack (ft²) 160, 161, 160
 Sample Time 9:06 AM
 Total Traverse Pts 24 (13)

EPA Method 0010 - HFPO Dimer Acid

31 31
 1.0066 ✓
 1.953
 0.706 Baro
 0.84 Baro
 160, 161, 160
 160 ✓
 1.068 ✓
 9.6 24 (13) ✓

Page 1 of 1

K Factor	.73	Initial	Mid-Point	Final
Sample Train (ft ³)				
Leak Check @ (in Hg)				
Pilot leak check good	yes / no	yes / no	yes / no	yes / no
Pilot Inspection good	yes / no	yes / no	yes / no	yes / no
Method 3 System good	yes / no	yes / no	yes / no	yes / no
Temp Check				
Meter Box Temp				
Reference Temp				
Pass/Fail (+/- 2°)				
Temp Change Response				
Pre-Test Set				
Post-Test Set				
Pass / Fail				
Pass / Fail				

TRAVERSE POINT NO.	SAMPLE TIME (min)	CLOCK TIME (plant time)	VELOCITY PRESSURE Delta P (in H ₂ O)	ORIFICE PRESSURE Delta H (in H ₂ O)	DRY GAS METER READING (ft)	STACK TEMP (°F)	DGM OUTLET TEMP (°F)	PROBE TEMP (°F)	FILTER BOX TEMP (F)	IMPIINGER EXIT TEMP (°F)	SAMPLE TRAIN VAC (in Hg)	XAD EXIT TEMP (F)	Comments
0	1605				991.907								
Y 1	4	1605	2.1	1.53	94.4	100	101	121	129	60	5	54	
2	3		2.1	1.53	97.0	100	102	123	129	69	5	46	
3	12		2.0	1.46	800.3	100	102	123	121	66	5	46	
4	16		1.8	1.31	2.2	102	102	122	124	67	7.5	47	
5	20		1.6	1.31	4.9	100	103	122	123	64	45	48	
6	24		1.7	1.24	7.4	99	102	123	123	66	45	48	
7	28		1.2	1.89	9.7	98	102	122	123	66	4	49	
8	32		0.83	1.69	11.2	99	102	124	123	66	4	52	
9	36		0.65	1.43	12.7	100	103	124	123	66	3	52	
10	40		0.25	1.40	14.1	100	102	124	122	66	3.5	49	
11	44		0.53	1.40	15.3	101	102	125	123	66	2.5	42	
12	48	1653	0.50	1.37	816.231	101	103	126	123	66	2	48	
0	1753				816.917								816.917
X 1	4	1753	1.7	1.24	19.3	100	102	126	123	66	5	49	
2	8		1.7	1.24	21.1	99	102	126	124	66	5	49	
3	12		1.5	1.0	24.0	99	123	126	124	66	5	49	
4	16		1.5	1.0	26.0	99	123	126	124	66	5	48	
5	20		1.5	1.0	28.3	99	9107	125	123	67	5	49	
6	24		1.5	1.0	30.6	99	103	125	124	67	5	49	
7	28		1.3	.95	32.4	99	102	126	126	67	5	49	
8	32		1.3	.95	35.3	99	102	126	126	67	5	50	
9	36		1.2	.88	37.4	99	102	126	126	67	4	49	
10	40		1.0	1.00	39.0	99	102	126	126	67	4	49	
11	44	1751	1.1	1.00	41.0	103	102	126	126	67	4	49	
12	48		1.1	1.00	442.782	100	103	126	126	66	4	49	
WESTEN	1841		Avg Delta P	Avg Delta H	Total Volume	Avg Ts	Avg Tm	Min/Max	Min/Max	Max	Max Vac	Min/Max	
			1.346	0.966	30.909	99.78	103						
			Avg Sqrt Delta P	Avg Sqrt Del H	Comments:								
			11.139	19655									

CB Inlet R1

EPA Method 0010 from EPA SW-846

Initial final scale check was 0.025, 99.7 Iso
 dows probe. The flexible single line model the line, so the
 line valve was repositioned slightly and the 12.5632 electron
 scale was good.

CB Inlet

ISOKINETIC FIELD DATA SHEET

Client Chemours
W.O.# 15418.002.016
Project ID Chemours
Mode/Source ID Carbon Bed
Samp. Loc. ID IN
Run No.ID 2
Test Method ID M0010
Date ID 15JUL2019
Source/Location VE South CB/Inlet
Sample Date 7/17/19 ✓
Baro. Press (in Hg) 30.09 ✓
Operator KDG/NG ✓

	Chemours	Stack Conditions	Assumed	Actual
	15418.002.016	% Moisture		
	Carbon Bed	Impinger Vol (ml)		
	IN	Silica gel (g)		
	2	CO2, % by Vol	0	
	M0010	O2, % by Vol	20.9	
	15JUL2019	Temperature (°F)	100	91.667
	VE South CB/Inlet	Meter Temp (°F)	100	93.583
	7/17/19	Static Press (in H ₂ O)	-50	5.5 ✓
	KDG/NG ✓	Ambient Temp (°F)	87	

EPA Method 0010 - HFPO Dimer Acid

Meter Box ID 31
Meter Box Y
Meter Box Del H
Probe ID / Length
Probe Material
Pitot / Thermocouple ID
Pitot Coefficient
Nozzle ID
Nozzle Measurements
Avg Nozzle Dia (in)
Area of Stack (ft²)
Sample Time
Total Traverse Pts

1.0066 ✓
1953
1706
0.84 ✓
.160
.160 ✓
.160
1.068 ✓
96 ✓
24 ✓

Sample Train (ft³)
Leak Check @ (in Hg)
Pitot leak check good
Pitot Inspection good
Method 3 System good
Temp Check
Meter Box Temp
Reference Temp
Pass/Fail (+/- 2°)
Temp Change Response

K Factor .73	Initial	Mid-Point	Final
0.009	0.005	0.003	
15"	6"	6"	
yes / no	yes / no	yes / no	
yes / no	yes / no	yes / no	
yes / no	yes / no	yes / no	
Pre-Test Set	Post-Test Set		
Pass / Fail	Pass / Fail		
yes / no	yes / no		

TRAVERSE POINT NO.	SAMPLE TIME (min)	CLOCK TIME (plant time)	VELOCITY PRESSURE Delta P (in H ₂ O)	ORIFICE PRESSURE Delta H (in H ₂ O)	DRY GAS METER READING (ft ³)	STACK TEMP (°F)	DGM OUTLET TEMP (°F)	PROBE TEMP (°F)	FILTER BOX TEMP (F)	IMPINGER EXIT TEMP (°F)	SAMPLE TRAIN VAC (in Hg)	XAD EXIT TEMP (F)	COMMENTS
	0	0905 ✓			849.375								
Y 1	4		2.1	.5	846.8	90	87	126	133	66	5	59	
2	8		2.1	.5	848.8	90	88	125	129	65	5	50	
3	12		2.1	.5	851.5	90	88	126	126	63	5	53	
4	16		2.0	.5	854.1	90	89	124	125	63	5	47	
5	20		1.9	.4	856.7	90	90	125	126	64	5	44	
6	24		1.7	.2	859.5	90	90	126	125	65	5	45	24.500
7	28		1.1	.80	861.1	91	91	124	124	NA 866	3	48	
8	32		-.72	.53	862.8	91	91	124	125	67	2	47	
9	36		.56	.41	864.1	92	92	126	126	66	2	46	
10	40		.45	.33	865.4	92	92	126	126	65	2	46	
11	44		.45	.33	866.7	92	93	126	125	65	2	47	
12	48	0953	.42	.31	867.875	94	93	126	124	66	2	48	
	0				868.012								.137
X 1	4	1010	1.8	1.3	NA 867-870.6	92	95	125	126	66	5	52	
2	8		1.7	1.2	873.1	92	95	124	125	65	5	49	
3	12		1.6	1.2	875.5	92	95	125	125	65	5	46	
4	16		1.6	1.2	877.8	92	96	126	125	65	5	49	
5	20		1.6	1.2	880.2	92	96	126	125	66	5	49	
6	24		1.6	1.2	882.6	92	97	125	125	66	5	48	
7	28		1.6	1.2	885.0	92	97	126	125	65	5	49	
8	32		1.2	.88	887.0	92	98	125	125	65	4	45	
9	36		1.2	.88	889.0	92	98	126	125	66	4	47	
10	40		1.1	.80	891.0	93	98	126	125	65	4	45	
11	44		1.1	.80	893.0	93	98	126	124	66	4	47	
12	48	1058 ✓	1.1	.80	894.924	94	99	125	125	66	4	49	
			Avg Delta P 1.367 ✓	Avg Delta H .999 ✓	Total Volume 51.412 ✓	Avg Ts 91.667 ✓	Avg Tm 93.583 ✓	Min/Max 124/126	Min/Max 124/133	Max TA 68.66	Max Vac 5	Min/Max 45/58	
			Avg Sqrt Delta P 1.141 ✓	Avg Sqrt Del H .976 ✓	Comments ✓								

67 EPA Method 0010 from EPA SW-846

2.6% H₂O 101.2 TDS
25900 disches

WESTON

ISOKINETIC FIELD DATA SHEET

Client	Chemours
W.O.#	15418.002.016
Project ID	Chemours
Mode/Source ID	Carbon Bed
Samp. Loc. ID	IN
Run No.ID	3
Test Method ID	M0010
Date ID	15.JUL.2019
Source/Location	VF South CB Inlet
Sample Date	7/17/19 ✓
Baro. Press (In Hg)	103.004 30.06 ✓
Operator	KATNG ✓

Stack Conditions	
Assumed	Actual
% Moisture	
Carbon Bed	Impinger Vol (ml)
IN	Silica gel (g)
3	CO ₂ , % by Vol
M0010	O ₂ , % by Vol
15.JUL.2019	Temperature (°F)
VF South CB Inlet	Meter Temp (°F)
7/17/19 ✓	Static Press (In H ₂ O)
103.004	-5.0
30.06 ✓	-5.5 ✓
KATNG ✓	Ambient Temp (°F)
97	

EPA Method 0010 - HFPO Dimer Acid

31
 1.0060 ✓
 1.993
 0.706
 0.84 ✓
 .160 ✓
 .160 .160 .160
 , 160 ✓
 2.068 ✓
 96 ✓
 24 ✓

Sample Train (ft³)

Leak Check @ (In Hg)

Pitot leak check good

Pitot Inspection good

Method 3 System good

Temp Check

Meter Box Temp

Reference Temp

Pass/Fail (+/- 2°)

Temp Change Response

K Factor	.73	Initial	Mid-Point	Final
0.006	-0.05	0.008		
15"	6"			
yes / no	yes / no	yes / no		
yes / no	yes / no	yes / no		
yes / no	yes / no	yes / no		
Pre-Test Set	Post-Test Set			
Meter Box Temp				
Reference Temp				
Pass / Fail	Pass / Fail			
yes / no	yes / no			

TRAVERSE POINT NO.	SAMPLE TIME (min)	CLOCK TIME (plant time)	VELOCITY PRESSURE Delta P (In H ₂ O)	ORIFICE PRESSURE Delta H (In H ₂ O)	DRY GAS METER READING (ft ³)	STACK TEMP (°F)	DGM OUTLET TEMP (°F)	PROBE TEMP (°F)	FILTER BOX TEMP (F)	IMPIINGER EXIT TEMP (°F)	SAMPLE TRAIN VAC (In Hg)	XAD EXIT TEMP (F)		COMMENTS
0	1250 ✓				945.237	96	103	123	123	66	5	60		
X 1	4		1.8	1.3	897.8	96	102	125	126	66	5	52		
2	3		1.8	1.3	900.2	96	102	126	127	65	5	50		
3	12		1.7	1.2	902.8	96	102	124	126	66	5	54		
4	16		1.6	1.2	905.2	96	102	124	126	66	5	52		
5	20		1.6	1.2	907.6	96	103	125	126	66	5	52		27.085
6	24		1.5	1.1	909.9	96	103	124	125	65	5	52		
7	23		1.3	.95	911.0	96	103	125	126	66	4	53		
8	32		1.3	.95	914.3	96	103	125	126	65	4	50		
9	36		1.3	.95	916.3	96	103	124	125	64	4	52		
10	40		1.2	.88	918.3	96	103	125	126	64	4	53		
11	44		1.2	.88	920.3	97	103	125	125	65	4	54		
12	43	1338	1.1	.80	922.322	97	103	126	125	66	4	50		
0					922.593									.271
Y 1	4	1414	2.2	1.6	925.3	98	103	124	126	67	6	55		
2	3		2.2	1.6	928.0	97	103	126	125	65	6	43		
3	12		2.1	1.5	930.7	97	103	125	125	65	6	45		
4	16		2.0	1.5	933.3	97	103	124	126	64	6	46		
5	20		1.9	1.4	936.0	98	103	125	125	64	6	45		21.975
6	24		1.7	1.2	938.4	98	103	125	124	65	5	45		
7	28		1.2	.88	940.3	98	103	126	125	66	4	49		
8	32		.78	.57	942.0	98	102	126	126	66	3	49		
9	36		.63	.46	943.4	99	103	125	125	65	3	46		
10	40		.48	.35	944.7	99	103	124	125	65	2	47		
11	44		.45	.33	946.0	99	102	124	125	65	2	49		
12	43	1502 ✓	.43	.31	947.275	99	103	125	125	66	2	50		
			Avg Delta P	Avg Delta H	Total Volume	Avg Ts	Avg Tm	Min/Max	Min/Max	Max	Max Vac	Min/Max		
			1.394 ✓	1.018 ✓	51.767	97.125	102.75 ✓	123/126	123/127	67	6	45/60		
			Avg Sqrt Delta P	Avg Sqrt Del H	Comments:									
			1.154 ✓	.986 ✓										

EPA Method 0010 from EPA SW-846

WESTON
INSTRUMENTS

1.017

37

AMM

VES CB INLET

SAMPLE RECOVERY FIELD DATA

EPA Method 0010 - HFPO Dimer Acid

Client
Location/PlantChemours
Fayetteville, NCW.O. #
Source & Location

15418.002.016

VE South CB Inlet

Run No. 1Sample Date 7-16-19Recovery Date 7-19-19

Sample I.D. Chemours - Carbon Bed - IN - 1 - M0010 -

Analyst

7/16/19/P6

Filter Number

ND

Impinger													
Contents	Empty	HPLC H2O	HPLC H2O	1	2	3	4	5	6	7	Imp.Total	8	Total
Final	13	100	100	0							317.5		
Initial	0	100	100	0							300		
Gain	13	0	0	0						13	17.5	29.5	

Impinger Color all clear Labeled? / Sealed? /

Silica Gel Condition blue 95%

Run No. 2Sample Date 7/17/19Recovery Date 7/17/19

Sample I.D. Chemours - Carbon Bed - IN - 2 - M0010 -

Analyst

7/17/19/P6

Filter Number

ND

Impinger													
Contents	Empty	HPLC H2O	HPLC H2O	1	2	3	4	5	6	7	Imp.Total	8	Total
Final	10	100	100	0							318.2		
Initial	0	100	100	0							300		
Gain	10	0	6	0						10	18.2	29.2	

Impinger Color all clear Labeled? / Sealed? /

Silica Gel Condition blue 95%

Run No. 3Sample Date 7/17/19Recovery Date 7/17/19

Sample I.D. Chemours - Carbon Bed - IN - 3 - M0010 -

Analyst

7/17/19/P6

Filter Number

ND

Impinger													
Contents	Empty	HPLC H2O	HPLC H2O	1	2	3	4	5	6	7	Imp.Total	8	Total
Final	20	100	100	5							323.7		
Initial	0	100	100	0							300		
Gain	20	0	0	5						25	23.7	40.7	

Impinger Color all clear Labeled? / Sealed? /

Silica Gel Condition blue 90%

Check COC for Sample IDs of Media Blanks

WESTON
SOLUTIONS

VE South BT

SAMPLE RECOVERY FIELD DATA

Client
Location/Plant

*Cheniere
Fayettville*

W.O. #
Source & Location

C8 Is/0.07 BT

Run No.

2

Sample Date

7-17-19

Recovery Date

7-17-19

Sample I.D.

Blank Train

Analyst

JDO/SR

Filter Number

NM

Contents	Impinger							Imp.Total	8	Total
	1	2	3	4	5	6	7			
Final	0	100	100	0					300	
Initial	0	100	100	0					300	
Gain	0	0	0	0					0	0

Impinger Color *All clear* Labeled?

Silica Gel Condition *LL 100%* Sealed?

Contents	Impinger							Imp.Total	8	Total
	1	2	3	4	5	6	7			
Final										
Initial										
Gain										

Impinger Color _____ Labeled? _____

Silica Gel Condition _____ Sealed? _____

Contents	Impinger							Imp.Total	8	Total
	1	2	3	4	5	6	7			
Final										
Initial										
Gain										

Impinger Color _____ Labeled? _____

Silica Gel Condition _____ Sealed? _____

Check COC for Sample IDs of Media Blanks



CHEMOURS - FAYETTEVILLE, NC
INPUTS FOR HFPO DIMER ACID CALCULATIONS
VES CARBON BED OUTLET

Test Data

	1	2	3
Run number	VES CBed Outlet	VES CBed Outlet	VES CBed Outlet
Location	07/16/19	07/17/19	07/17/19
Date	1605-1841	0905-1058	1250-1502
Time period	JM	JM	JM
Operator			

Inputs For Calcs.

Sq. rt. delta P	0.83005	0.83224	0.83619
Delta H	1.2600	1.3092	1.3200
Stack temp. (deg.F)	100.2	97.6	100.3
Meter temp. (deg.F)	104.7	96.0	107.1
Sample volume (act.)	58.439	58.943	59.828
Barometric press. (in.Hg)	30.06	30.09	30.06
Volume H ₂ O imp. (ml)	20.0	10.0	30.0
Weight change sil. gel (g)	14.0	14.2	16.4
% CO ₂	0.0	0.0	0.0
% O ₂	20.9	20.9	20.9
% N ₂	79.1	79.1	79.1
Area of stack (sq.ft.)	9.390	9.390	9.390
Sample time (min.)	96.0	96.0	96.0
Static pressure (in.H ₂ O)	2.40	2.40	2.40
Nozzle dia. (in.)	0.202	0.202	0.202
Meter box cal.	1.0069	1.0069	1.0069
Cp of pitot tube	0.84	0.84	0.84
Traverse points	24	24	24

Determination of Stack Gas Velocity - Method 2

Client	<u>Cheniere</u>	Operator	<u>MJ/15</u>	Pitot Coeff (Cp)	<u>.840</u>
Location/Plant	<u>Egyptville</u>	Date	<u>7/16/19</u>	Stack Area, ft ² (As)	<u>9,383</u>
Source	<u>VE's CB OUT</u>	W.O. Number		Pitot Tube/Thermo ID	
Run Number	<u>PLK</u>	Time	<u>1350-1400 ✓</u>		
Barometric Press, in Hg (Pb)	<u>30.07 ✓</u>				
Static Press, in H ₂ O (Pstatic)	<u>+0.54 ✓</u>				
Source Moisture, % (BWS)	<u>~2% ✓</u>				
O ₂ , %	<u>20.9 ✓</u>				
CO ₂ , %	<u>0.0 ✓</u>				

Cyclonic Flow Determination		Traverse Location		Leak Check good ?		Leak Check good ?		Leak Check good ?	
Delta P at 0°	Angle yielding zero Delta P	Port	Top Point	Delta P	Source Temp, F° (Ts)	Delta P	Source Temp, F° (Ts)	Delta P	Source Temp, F° (Ts)
0	—	1	1	0.33	109				
0	—	2	2	0.45	107				
0.01	25	3	3	0.50	106				
0	—	4	4	0.55	105				
0.01	25	5	5	0.62	104				
0	—	6	6	0.70	103				
0	—	7	7	0.77	102				
0	—	8	8	0.85	102				
0	—	9	9	0.91	101				
0.02	25	10	10	0.94	101				
0.01	25	11	11	1.00	101				
-0.02	25	12	12	1.00	101				
				0.25					
-0.01	25	1	1	0.250	114				
0	—	2	2	0.32	114				
0	—	3	3	0.41	112				
-0.02	25	4	4	0.45	110				
0	—	5	5	0.48	110				
0	—	6	6	0.54	108				
-0.02	25	7	7	0.72	106				
0	—	8	8	0.85	107				
0.02	25	9	9	0.92	102				
0.01	25	10	10	0.95	101				
0	—	11	11	0.98	101				
0	—	12	12	1.0	101				
Avg Angle		Avg Delta P & Temp	66.735		20.1087083				
		avg √Delta P	0.76676		0.84160				
		Average gas stream velocity, ft/sec.	47.24						
		Vol. flow rate @ actual conditions, wacf/min	26300		210025				
		Vol. flow rate at standard conditions, dscf/min	24700		246031				

$$MWd = (0.32 * O_2) + (0.44 * CO_2) + (0.28 * (100 - (CO_2 + O_2)))$$

$$MWs = (MWd * (1 - (BWS/100))) + (18 * (BWS/100))$$

$$Tsa = Ts + 460$$

$$Ps = Pb + (Pstatic/13.6)$$

$$Vs = 85.49 * Cp * \text{avg } \sqrt{\Delta P} * \sqrt{Tsa/(Ps * MWs)}$$

$$Qs(\text{act}) = 60 * Vs * As$$

$$Qs(\text{std}) = 17.64 * (1 - (BWS/100)) * (Ps/Tsa) * Qs(\text{act})$$

MWd = Dry molecular weight source gas, lb/lb-mole.

MWs = Wet molecular weight source gas, lb/lb-mole.

Tsa = Source Temperature, absolute(oR)

Ps = Absolute stack static pressure, inches Hg.

Vs = Average gas stream velocity, ft/sec.

Qs(act) = Volumetric flow rate of wet stack gas at actual, wacf/min

Qs(std) = Volumetric flow rate of dry stack gas at standard conditions, dscf/min

Note: Micromanometer is required if:

(A) The average Delta P readings are less than 0.05 inches of water.

(B) For traverses of 12 or more points, more than 10% of the Delta P readings are below 0.05 inches of water.

(C) For traverses of less than 12 points, more than one Delta P reading is below 0.05 inches of water.



ISOKINETIC FIELD DATA SHEET

Client	Chemours
W.O.#	15418.002.016
Project ID	Chemours
Mode/Source ID	Carbon Bed
Sample Loc. ID	OUT
Run No.ID	1
Test Method ID	M0010
Date ID	15JUL2019
Source/Location	VE South CB Outlet
Sample Date	7/16/16 ✓
Baro. Press (in Hg)	30.06 ✓
Operator	Mills ✓

Stack Conditions	
Assumed	Actual
% Moisture	2
Impinger Vol (ml)	
Silica gel (g)	
CO2, % by Vol	0
O2, % by Vol	20.9
Temperature (°F)	110
Meter Temp (°F)	105
Static Press (in H ₂ O)	+2.4
Ambient Temp (°F)	+2.7

EPA Method 0010 - HFPO Dimer Acid

INC 12
1.0069 1.8812 1.0072 1.0071
STT Boro P33 0.84 ✓
0.202 0.204 0.203 0.202
9.39 ✓
96 ✓
24 ✓

Page 11 of 11

K Factor	Initial	Mid-Point	Final
1.78	0.006	0.007	0.008
15	✓	✓	✓
yes / no	yes / no	yes / no	yes / no
yes / no	yes / no	yes / no	yes / no
yes / no	yes / no	yes / no	yes / no
Temp Check	Pre-Test Set	Post-Test Set	
Meter Box Temp	107	96	
Reference Temp	706	96	
Pass/Fail (+/- 2°)	Pass / Fail	Pass / Fail	
Temp Change Response	yes / no	yes / no	

TRAVERSE POINT NO.	SAMPLE TIME (min)	CLOCK TIME (plant time)	VELOCITY PRESSURE Delta P (in H ₂ O)	ORIFICE PRESSURE Delta H (in H ₂ O)	DRY GAS METER READING (ft ³)	STACK TEMP (°F)	DGM OUTLET TEMP (°F)	PROBE TEMP (°F)	FILTER BOX TEMP (F)	IMPINGER EXIT TEMP (°F)	SAMPLE TRAIN VAC (in Hg)	XAD EXIT TEMP (F)	COMMENTS
1	0	1607	220.813										
2	4	0.412	0.75	222.8	101	106	132	136	68	2.0	65		
3	8	0.48	0.85	225.2	101	107	131	140	68	2.0	55		
4	12	0.52	0.93	227.1	101	108	128	140	68	2.0	77		
5	16	0.58	1.04	229.5	100	108	125	138	65	2.0	45		
6	20	0.50	1.04	231.8	101	108	123	135	65	2.0	46		
7	24	0.28	1.27	234.1	100	107	122	131	65	2.5	76		
8	28	0.76	1.36	236.8	100	107	124	128	64	2.5	45		
9	32	0.82	1.47	239.3	99	107	123	125	62	3	44		
10	36	0.87	1.56	242.0	99	106	123	123	63	3	46		
11	40	0.99	1.59	244.8	99	105	122	130	63	3	46		
12	44	0.93	1.67	247.5	102	106	121	128	64	3	46		
13	48	0.95	1.70	250.443	100	106	122	129	64	3	46	29.570	
14	0	1653	250.625	—	—	—	—	—	—	—	—	—	
15	4	0.98	1.73	253.3	100	103	121	119	68	3.5	58		
16	8	0.97	1.68	256.1	100	103	123	123	67	3.5	45		
17	12	0.95	1.70	259.0	100	103	122	120	62	3.5	73		
18	16	0.93	1.67	261.6	100	102	122	126	61	3.5	47		
19	20	0.97	1.56	264.9	100	102	121	127	60	3.5	43		
20	24	0.81	1.45	267.2	101	102	123	125	59	3.0	73		
21	28	0.63	1.13	269.4	100	102	122	127	58	3.0	47		
22	32	0.55	0.98	271.4	100	102	123	127	60	3.0	46		
23	36	0.48	0.85	273.3	100	103	122	122	61	3.0	47		
24	40	0.44	0.79	275.3	100	103	122	121	62	2.5	49		
25	44	0.42	0.75	277.3	100	103	123	120	62	2.0	50		
26	48	0.42	0.75	279.4	100	103	123	120	62	2.0	51	18.889	
Avg Delta P		Avg Delta H		Total Volume	Avg Ts	Avg Tm	Min/Max	Min/Max	Max	Max Vac	Min/Max		
0.70416		1.26000		58.439	100.17	104.61							
Avg Sqrt Delta P		Avg Sqrt Del H		Comments:									
0.83049		1.11022											

EPA Method 0010 from EPA SW-846

97.41°
25043 dsctrn

WESTON
SOLUTIONS

OX

ISOKINETIC FIELD DATA SHEET

	Chemours	Stack Conditions	Assumed	Actual
Client W.O.#	15418.002.016			
Project ID	Chemours	% Moisture	2	
Mode/Source ID	Carbon Bed	Impinger Vol (ml)		
Sampl. Loc. ID	OUT	Silica gel (g)		
Run No.ID	2	CO2, % by Vol		
Test Method ID	M0010	O2, % by Vol	20.9	
Date ID	15JUL2019	Temperature (°F)	100	
Source/Location	VE South CB Outlet	Meter Temp (°F)	105	
Sample Date	7/17/19 ✓	Static Press (in H ₂ O)	2.1	2.4 ✓
Baro. Press (in Hg)	30.09 ✓	Ambient Temp (°F)		
Operator	MT/18 ✓			

EPA Method 0010 - HFPO Dimer Acid

Meter Box ID	W/C 12
Meter Box Y	1.0069 ✓
Meter Box Del H	1.8812
Probe ID / Length	5 ft
Probe Material	Boro
Pitot / Thermocouple ID	P335
Pitot Coefficient	0.84 ✓
Nozzle ID	
Nozzle Measurements	
Avg Nozzle Dia (in)	0.202
Area of Stack (ft ²)	0.202 ✓
Sample Time	9.39 ✓
Total Traverse Pts	96 ✓
	24 ✓

C B OUTLET A2

K Factor	1.83	Initial	Mid-Point	Final
Leak Check @ (in Hg)	15	0.003	0.005	0.004
Pitot leak check good	yes / no	yes / no	yes / no	yes / no
Pitot Inspection good	yes / no	yes / no	yes / no	yes / no
Method 3 System good	yes / no	yes / no	yes / no	yes / no
Temp Check				
Meter Box Temp		86		
Reference Temp			98	
Pass/Fail (+/- 2°)				
Temp Change Response				
Pass / Fail				
Temp Change Response				

TRAVERSE POINT NO.	SAMPLE TIME (min)	CLOCK TIME (plant time)	VELOCITY PRESSURE Delta P (in H ₂ O)	ORIFICE PRESSURE Delta H (in H ₂ O)	DRY GAS METER READING (ft ³)	STACK TEMP (°F)	DGM OUTLET TEMP (°F)	PROBE TEMP (°F)	FILTER BOX TEMP (F)	IMPINGER EXIT TEMP (°F)	SAMPLE TRAIN VAC (in Hg)	XAD EXIT TEMP (F)		COMMENTS
1	0	0905 ✓			280.149									
2	4		0.44	0.84	282.7	97	91	121	125	68	2.0	63		
3	8		0.48	0.89	281.0	97	91	121	127	65	2.0	45		
4	12		0.54	1.00	286.6	97	91	120	126	63	2.5	43		
5	20		0.58	1.07	288.8	97	92	121	124	60	2.5	46		
6	24		0.61	1.13	291.2	97	93	121	124	60	2.5	46		
7	28		0.67	1.24	293.6	97	93	121	125	60	2.5	46		
8	32		0.79	1.46	296.7	98	94	122	126	61	3.0	45		
9	36		0.82	1.52	298.9	98	94	122	126	61	3.0	43		
10	40		0.90	1.66	304.4	97	95	121	126	60	3.0	42		
11	44		0.95	1.76	302.1	97	96	122	126	60	3.5	41		29.834
12	48	0953	0.93	1.72	310.003	97	96	122	125	59	3.5	42		
13	0	1010			310.168									
14	4		0.98	1.81	313.0	98	98	121	132	68	4.0	49		
15	8		0.95	1.76	315.8	98	98	121	127	63	4.0	46		
16	12		0.94	1.74	318.7	98	98	121	130	60	4.0	42		
17	16		0.91	1.66	321.3	98	98	121	126	60	4.0	41		
18	20		0.96	1.59	324.3	98	99	121	125	61	4.0	41		
19	24		0.61	1.49	326.9	98	99	121	122	60	3.5	41		
20	28		0.63	1.16	329.0	98	99	121	124	60	3.5	40		
21	32		0.57	1.05	331.7	98	99	121	127	60	3.0	41		
22	36		0.50	0.93	333.5	98	99	122	130	60	3.0	42		
23	40		0.45	0.83	335.7	98	99	121	130	60	2.5	42		29.084
24	44		0.41	0.76	337.3	98	99	121	131	60	2.5	42		
25	48	1050	0.39	0.72	341.257	98	99	121	127	62	2.0	44		
			Avg Delta P	Avg Delta H	Total Volume	Avg Ts	Avg Tm	Min/Max	Min/Max	Max	Max Vac	Min/Max		
			7075 ✓	1.309 ✓	58.943	97.3	96.04							
			Avg Sqrt Delta P	Avg Sqrt Del H	Comments:		97.10							
			.8773	1.13224										

EPA Method 0010 from EPA SW-846

WESTON

ISOKINETIC FIELD DATA SHEET

Client Chemours
 W.O.# 15418.002.016
 Project ID Chemours
 Mode/Source ID Carbon Bed
 Samp. Loc. ID OUT
 Run No.ID 3
 Test Method ID M0010
 Date ID 15JUL2019
 Source/Location VE South CB Outlet
 Sample Date 7/17/19 ✓
 Baro. Press (in Hg) 30.06 ✓
 Operator Mills ✓

Stack Conditions	
Assumed	Actual
% Moisture	2
Impinger Vol (ml)	
Silica gel (g)	
CO ₂ , % by Vol	0.0
O ₂ , % by Vol	20.9
Temperature (°F)	105
Meter Temp (°F)	105
Static Press (in H ₂ O)	+2.4
Ambient Temp (°F)	+2.4

EPA Method 0010 - HFPO Dimer Acid

1 Battler

WC12
1.0069 ✓

1.8812
5FT

Boro
P375

0.84 ✓

0.202 0.202 0.203

0.202
9.39 ✓

96 ✓


24 ✓

Total Traverse Pts

K Factor		
Initial	Mid-Point	Final
0.006	0.006	0.006
15	10	6
yes / no	yes / no	yes / no
yes / no	yes / no	yes / no
yes / no	yes / no	yes / no
Pre-Test Set	99	105
Post-Test Set	100	106
Easa / Fail	Easa / Fail	Easa / Fail
yes / no	yes / no	yes / no

TRAVERSE POINT NO.	SAMPLE TIME (min)	CLOCK TIME (plant time)	VELOCITY PRESSURE Delta P (in H ₂ O)	ORIFICE PRESSURE Delta H (in H ₂ O)	DRY GAS METER READING (ft ³)	STACK TEMP (°F)	DGM OUTLET TEMP (°F)	PROBE TEMP (°F)	FILTER BOX TEMP (F)	IMPINGER EXIT TEMP (°F)	SAMPLE TRAIN VAC (in Hg)	XAD EXIT TEMP (F)	COMMENTS
1	0	1250 ✓	0.21	0.21	339.420	105	106	123	129	69	2.0	61	
2	8	1250 ✓	0.47	0.81	341.6	101	106	122	127	66	2.0	50	
3	13	1250 ✓	0.54	1.00	343.7	101	106	121	127	64	3.0	44	
4	16	1250 ✓	0.58	1.07	345.8	101	106	121	130	64	3.0	44	
5	20	1250 ✓	0.60	1.11	348.1	101	106	121	130	64	3.0	44	
6	24	1250 ✓	0.65	1.20	350.5	101	107	120	129	62	3.0	43	
7	28	1250 ✓	0.70	1.20	352.9	100	107	122	124	62	3.0	44	
8	33	1250 ✓	0.75	1.20	355.6	100	107	122	123	63	3.0	44	
9	37	1250 ✓	0.76	1.21	358.0	100	107	122	121	57	3.5	43	
10	40	1250 ✓	0.94	1.74	360.7	100	107	122	122	62	3.5	44	
11	44	1250 ✓	0.96	1.78	363.5	100	107	121	119	63	4	45	
12	48	1250 ✓	0.98	1.81	366.6	100	107	121	119	63	4	41	
13	53	1250 ✓	0.98	1.81	369.400	99	107	122	124	64	4	43	
14	0	1338	—	—	369.907	99	107	122	122	62	3.5	44	
15	1	1414	0.96	1.76	372.7	100	106	124	127	68	4	50	29.980
16	8	1414	0.95	1.76	375.6	99	107	123	129	65	4	44	
17	12	1414	0.93	1.72	378.5	99	107	121	127	63	4	44	
18	16	1414	0.90	1.66	381.3	100	108	121	125	63	4	46	
19	20	1414	0.85	1.57	384.1	100	108	122	126	64	4	43	
20	24	1414	0.82	1.52	386.7	100	108	123	122	64	4	44	
21	28	1414	0.65	1.70	389.3	100	108	121	121	64	3.5	50	
22	33	1414	0.57	1.05	391.6	100	108	121	121	65	3.0	43	
23	36	1414	0.52	0.96	393.6	100	108	122	122	65	3.0	43	
24	40	1414	0.48	0.89	395.8	100	108	122	119	65	3.0	43	29.848
25	44	1414	0.44	0.81	397.9	100	108	121	121	65	3.0	43	
26	48	1414	0.42	0.78	399.755	100	107	122	120	65	3.0	43	
Avg Delta P		0.71467	Avg Delta H		1.3200 ✓	Total Volume	Avg Ts	Avg Tm	Min/Max	Min/Max	Max Vac	Min/Max	
Avg Sqrt Delta P		0.63649	Avg Sqrt Del H		1.3674 ✓	Comments:							

WESTON



TOP view

EPA Method 0010 from EPA SW-846

VES CB Outlet

SAMPLE RECOVERY FIELD DATA

EPA Method 0010 - HFPO Dimer Acid

Client

Location/Plant

Chemours

Fayetteville, NC

W.O. #

15418.002.016

Source & Location

VE South CB Outlet

Run No.	1			Sample Date	7-16-19			Recovery Date	7-16-19	
Sample I.D.	Chemours - Carbon Bed - OUT - 1 - M0010 -			Analyst	Dno/Jm/P6			Filter Number	N21	
Impinger										
Contents	1	2	3	4	5	6	7	Imp.Total	8	Total
Final	15	105	100	0						Silica Gel
Initial	0	100	100	0					300	
Gain	15	5	0	0				20	14	34
Impinger Color	all clear			Labeled?	✓				✓	
Silica Gel Condition	blue 95%			Sealed?	✓				✓	
Run No.	2			Sample Date	7-17-19			Recovery Date	7-17-19	
Sample I.D.	Chemours - Carbon Bed - OUT - 2 - M0010 -			Analyst	Dno/Jm/P6			Filter Number	N21	
Impinger										
Contents	1	2	3	4	5	6	7	Imp.Total	8	Total
Final	10	100	100	6						Silica Gel
Initial	0	100	100	0					300	
Gain	10	0	0	0				10	14.2	24.2
Impinger Color	all clear			Labeled?	✓				✓	
Silica Gel Condition	blue 90%			Sealed?	✓				✓	
Run No.	3			Sample Date	7-17-19			Recovery Date	7-17-19	
Sample I.D.	Chemours - Carbon Bed - OUT - 3 - M0010 -			Analyst	Dno/Jm/P6			Filter Number	N21	
Impinger										
Contents	1	2	3	4	5	6	7	Imp.Total	8	Total
Final	20	110	100	0						Silica Gel
Initial	0	100	100	0					300	
Gain	20	10	0	0				20	16.4	46.4
Impinger Color	all clear			Labeled?	✓				✓	
Silica Gel Condition	blue 90%			Sealed?	✓				✓	

Check COC for Sample IDs of Media Blanks



CHEMOURS - FAYETTEVILLE, NC
INPUTS FOR HFPO DIMER ACID CALCULATIONS
VE SOUTH STACK

Test Data

	1	2	3
Run number			
Location	VE South Stack	VE South Stack	VE South Stack
Date	07/16/19	07/17/19	07/17/19
Time period	1605-1841	0905-1058	1250-1502
Operator	MW	MW	MW

Inputs For Calcs.

Sq. rt. delta P	0.75906	0.75894	0.75569
Delta H	0.7854	0.7854	0.7642
Stack temp. (deg.F)	100.3	97.4	100.4
Meter temp. (deg.F)	98.5	87.9	99.0
Sample volume (act.)	50.910	49.525	50.263
Barometric press. (in.Hg)	30.00	30.07	30.07
Volume H ₂ O imp. (ml)	33.0	31.0	29.0
Weight change sil. gel (g)	12.5	14.1	12.9
% CO ₂	0.0	0.0	0.0
% O ₂	20.9	20.9	20.9
% N ₂	79.1	79.1	79.1
Area of stack (sq.ft.)	9.620	9.620	9.620
Sample time (min.)	96.0	96.0	96.0
Static pressure (in.H ₂ O)	2.50	2.50	2.50
Nozzle dia. (in.)	0.190	0.190	0.190
Meter box cal.	1.0008	1.0008	1.0008
Cp of pitot tube	0.84	0.84	0.84
Traverse points	24	24	24

33 12.5

ISOKINETIC FIELD DATA SHEET

 Client Chemours
 W.O.# 15418.002.016

 Project ID Chemours % Moisture
 Mode/Source ID VE South - Scrubber Impinger Vol (ml)

Samp. Loc. ID STK Silica gel (g)

 Run No.ID 1 CO₂, % by Vol

 Test Method ID M0010 O₂, % by Vol

Date ID 15JUL2019 Temperature (°F)

Source/Location VE South Stack Meter Temp (°F)

 Sample Date 7/16/19 Static Press (in H₂O)

Baro. Press (in Hg) 30.00 ✓

Operator MW WINKELEY Ambient Temp (°F)

Stack Conditions

Assumed

Actual

EPA Method 0010 - HFPO Dimer Acid

Meter Box ID 27

Meter Box Y 1,0203 J

Meter Box Del H 1,6330

Probe ID / Length 700

Probe Material Boro

Pitot / Thermocouple ID P700

Pitot Coefficient 0.84 ✓

Nozzle ID 0.190

Nozzle Measurements 0.300

Avg Nozzle Dia (in) 0.190 ✓

Area of Stack (ft²) 9.62 ✓

Sample Time 96 ✓

Total Traverse Pts 24 ✓

Page ____ of ____

K Factor 1.36

Initial	Mid-Point	Final
0.001	0.001	0.001
✓	✓	✓
yes / no	yes / no	yes / no
✓	✓	✓
yes / no	yes / no	yes / no
✓	✓	✓
yes / no	yes / no	yes / no
Pre-Test Set	Post-Test Set	
102	100	
102	99	
Pass / Fail	Pass / Fail	
✓	✓	
yes / no	yes / no	

TRAVERSE POINT NO.	SAMPLE TIME (min)	CLOCK TIME (plant time)	VELOCITY PRESSURE Delta P (in H ₂ O)	ORIFICE PRESSURE Delta H (in H ₂ O)	DRY GAS METER READING (ft ³)	STACK TEMP (°F)	DGM OUTLET TEMP (°F)	PROBE TEMP (°F)	FILTER BOX TEMP (F)	IMPINGER EXIT TEMP (°F)	SAMPLE TRAIN VAC (in Hg)	XAD EXIT TEMP (F)		COMMENTS
A 1	0	1605.5			4996.715									
2	4		0.60	0.82	4991.216	101	101	111	110	67	2	67		
3	8		0.60	0.82	501.021	101	101	110	110	66	2	66		
4	12		0.56	0.76	503.330	101	101	110	110	66	2	66		
5	16		0.59	0.80	505.25	101	101	110	110	66	2	66		
6	20		0.70	0.95	507.54	101	101	110	110	66	2	66		24.985
7	24		0.54	0.73	509.99	101	101	110	110	64	2	64		
8	28		0.50	0.68	511.74	101	101	110	110	64	2	64		
9	32		0.51	0.69	513.60	100	101	110	110	64	2	64		
10	36		0.50	0.68	515.33	100	101	111	111	64	2	64		
11	40		0.53	0.70	517.41	100	101	111	111	64	2	65		
12	44		0.55	0.74	519.60	100	98	111	111	64	2	65		
13	48	1653	0.55	0.74	521.700	100	98	111	111	64	2	65		
		1753			521.800									1.37
B 1	4		0.55	0.75	523.80	100	97	111	111	64	2	64		New K - reading
2	8		0.55	0.75	526.72	100	97	110	110	67	3	67		
3	12		0.60	0.82	528.20	100	96	110	110	64	2	64		
4	16		0.60	0.82	530.31	100	96	110	110	64	2	64		
5	20		0.60	0.82	532.52	100	96	110	110	64	2	64		25.925
6	24		0.55	0.75	534.62	100	96	110	110	64	2	64		
7	28		0.70	0.95	536.94	100	96	110	110	64	2	64		
8	32		0.70	0.95	539.20	100	96	110	110	64	2	64		
9	36		0.55	0.75	541.35	100	96	110	110	63	2	63		
10	40		0.54	0.74	543.31	100	97	110	110	63	2	63		
11	44		0.60	0.82	545.47	100	97	110	110	63	2	63		
12	48	184N	0.60	0.82	547.72	100	97	110	110	63	2	65		
			Avg Delta P 0.57750	Avg Delta H 0.78541	Total Volume 50.910	Avg Ts 100	Avg Tm 98.5	Min/Max 110/111	Min/Max 110/111	Max 67	2	63		
			Avg Sqrt Delta P 0.75906	Avg Sqrt Del H 0.88519	Comments:									EPA Method 0010 from EPA SW-846

WESTON
SOLUTI0NS

106.7 150

23/100 direct

MM

ISOKINETIC FIELD DATA SHEET

Client Chemours
W.O.# 15418.002.016

Project ID Chemours % Moisture
Mode/Source ID VE South - Scrubber Impinger Vol (ml)

Samp. Loc. ID STK Silica gel (g)

Run No.ID 2 CO₂, % by Vol

Test Method ID M0010 O₂, % by Vol

Date ID 15JUL2019 Temperature (°F)

Source/Location VE South Stack Meter Temp (°F)

Sample Date 7/17/19 Static Press (in H₂O)

Baro. Press (in Hg) 30.07 AT LOCATION

Operator NPK WINKLER Ambient Temp (°F)

Stack Conditions

Assumed Actual

~~2~~

~~2~~

~~0.10~~

~~20.1~~

~~85~~

~~2.5~~

~~24~~

EPA Method 0010 - HFPO Dimer Acid

Meter Box ID 77

Meter Box Y

Meter Box Del H

1,0008 ✓

1,8830

6-

Probe ID / Length

P6045

Probe Material

Boro

Pitot / Thermocouple ID

695

Pitot Coefficient

0.84

Nozzle ID

G-190

Nozzle Measurements

0.191 0.190 0.190

Avg Nozzle Dia (in)

0.190

Area of Stack (ft²)

9.62 ✓

Sample Time

96 ✓

Total Traverse Pts

24 ✓

Page 1 of 1

K Factor	Initial	Mid-Point	Final
1.23	0.001	0.001	0.001
✓	✓	✓	✓
yes / no	yes / no	yes / no	yes / no
yes / no	yes / no	yes / no	yes / no
yes / no	yes / no	yes / no	yes / no
Pre-Test Set	83	92	92
	84	92	92
Pass / Fail	Pass / Fail	Pass / Fail	Pass / Fail
yes / no	yes / no	yes / no	yes / no

TRAVERSE POINT NO.	SAMPLE TIME (min)	CLOCK TIME (plant time)	VELOCITY PRESSURE Delta P (in H ₂ O)	ORIFICE PRESSURE Delta H (in H ₂ O)	DRY GAS METER READING (ft ³)	STACK TEMP (°F)	DGM OUTLET TEMP (°F)	PROBE TEMP (°F)	FILTER BOX TEMP (F)	IMPINGER EXIT TEMP (°F)	SAMPLE TRAIN VAC (in Hg)	XAD EXIT TEMP (F)	COMMENTS	
A 1	0	0905	0.60	0.81	548.100	100	85-	110	110	67	2	67		
2	4	0.60	0.80	0.81	550.58	100	85	110	110	66	2	66		
3	8	0.60	0.81	0.75	552.85	100	86	110	110	66	2	66		
4	12	0.56	0.75	0.75	554.55	97	86	110	110	66	2	66		
5	16	0.56	0.75	0.75	556.30	97	86	110	110	66	2	66		
6	20	0.60	0.81	0.81	558.51	96	86	110	110	66	2	66		
7	24	0.60	0.81	0.81	560.94	96	86	110	110	66	2	66		
8	28	0.56	0.75	0.75	562.700	96	86	110	110	66	2	66		
9	32	0.56	0.75	0.75	564.81	96	86	110	110	66	2	66		
10	36	0.56	0.75	0.75	566.85	96	86	110	110	66	2	66		
11	40	0.60	0.81	0.81	568.86	96	86	110	110	66	2	66		
12	44	0.56	0.81	0.81	571.05	96	87	110	110	66	2	66	← 1.45 New	
	48	0953	0.56	0.81	573.200	96	87	109	109	66	2	66	K-PATRON	
		01010			573.800									
B 1	4	0.60	0.89	575.42	96	87	109	109	66	2	66			
2	8	0.60	0.87	577.43	100	90	110	110	66	2	66		reaktion	
3	12	0.60	0.81	579.89	98	90	110	110	66	2	66		← 1.35	
4	16	0.62	0.84	582.10	98	90	109	109	66	2	66			
5	20	0.62	0.84	584.01	98	90	109	109	66	2	65		24.250	
6	24	0.55	0.74	587.31	98	90	109	109	66	2	65			
7	28	0.55	0.74	589.20	98	90	110	110	66	2	66			
8	32	0.56	0.75	591.00	98	90	110	110	66	2	66			
9	36	0.56	0.75	593.00	98	90	110	110	66	2	66			
10	40	0.55	0.74	594.20	98	90	110	110	66	2	66			
11	44	0.55	0.71	596.32	98	90	110	110	66	2	66			
12	48	1D58	0.55	0.71	598.225	98	90	110	110	66	2	66		
		J Avg Delta P	Avg Delta H	Total Volume	Avg Ts	Avg Tm	Min/Max	Min/Max	Max	Max Vac	Min/Max			
		0.57625	0.78542	49.350	97	87	109/110	109/110	67	2	66/67			
		Avg Sqrt Delta P	Avg Sqrt Del H	Comments:		87.9							EPA Method 0010 from EPA SW-846	
		0.75894	0.88591	49.525									AMM d	

WESTON
SOLUTIONS

ISOKINETIC FIELD DATA SHEET

Client	Chemours	Stack Conditions
W.O.#	15418.002.016	Assumed
Project ID	Chemours	% Moisture
Mode/Source ID	VE South - Stack	Impinger Vol (ml)
Samp. Loc. ID	STK	Silica gel (g)
Run No.ID	3	CO2, % by Vol
Test Method ID	M0010	O2, % by Vol
Date ID	15JUL2019	Temperature (°F)
Source/Location	VE South Stack	Meter Temp (°F)
Sample Date	7/17/19 ✓	Static Press (in H ₂ O)
Baro. Press (in Hg)	30.07 ✓	Ambient Temp (°F)
Operator	WINKELER	Total Traverse Pts

EPA Method 0010 - HFPO Dimer Acid

Meter Box ID	27	Sample Train (ft ³)
Meter Box Y	1.0060	Leak Check @ (in Hg)
Meter Box Del H	1.8330	Pitot leak check good
Probe ID / Length	P695	Pitot Inspection good
Probe Material	695	Method 3 System good
Pitot / Thermocouple ID	0.84 ✓	Temp Check
Pitot Coefficient	C-190	Meter Box Temp
Nozzle ID	0.190 0.190 0.190	Reference Temp
Nozzle Measurements	0.190 0.190 0.190	Pass/Fail (+/- °)
Avg Nozzle Dia (in)	0.190	Temp Change Response
Area of Stack (ft ²)	0.190	
Sample Time	96 ✓	
Total Traverse Pts	84 ✓	

Page 1 of 1

K Factor	1.35	Initial	Mid-Point	Final
Pre-Test Set	97	0.20	0.221	0.221
	88	✓	✓	✓
Post-Test Set	100	✓	✓	✓
Pass / Fail	Pass	Pass	Pass	Pass
Fail / Fall	Fail	Fail	Fail	Fail
Es / no	Es	Es	Es	Es

TRAVERSE POINT NO.	SAMPLE TIME (min)	CLOCK TIME (plant time)	VELOCITY PRESSURE Delta P (in H ₂ O)	ORIFICE PRESSURE Delta H (in H ₂ O)	DRY GAS METER READING (ft ³)	STACK TEMP (°F)	DGM OUTLET TEMP (°F)	PROBE TEMP (°F)	FILTER BOX TEMP (F)	IMPINGER EXIT TEMP (°F)	SAMPLE TRAIN VAC (in Hg)	XAD EXIT TEMP (F)		COMMENTS	
AB 1	0	1250 ✓	598.742												
2	4	0.63	0.85	601.32	101	99	110	110	66	2	66				
3	8	0.63	0.85	603.42	101	99	110	110	66	2	66				
4	12	0.60	0.81	605.99	101	99	110	110	66	2	66			24,863	
5	16	0.60	0.81	607.20	101	99	110	110	66	2	66				
6	20	0.53	0.74	609.52	101	99	110	110	66	2	66				
7	24	0.53	0.74	611.43	101	99	110	110	66	2	64				
8	28	0.55	0.74	613.55	101	99	110	110	64	2	64				
9	32	0.52	0.70	615.61	100	99	110	109	64	2	64				
10	36	0.52	0.70	618.01	100	99	109	109	64	2	64				
11	40	0.58	0.70	619.65	100	99	109	109	64	2	64				
12	44	0.52	0.70	621.60	100	99	109	109	64	2	64				
13	48	1338	0.52	623.605	100	99	109	109	64	2	64				
		1414		623.700											
BA 1	4	0.60	0.81	625.93	100	99	109	109	67	2	66				
2	8	0.60	0.81	627.95	100	99	110	110	66	2	66			25,400	
3	12	0.63	0.85	630.72	100	99	110	110	66	2	66				
4	16	0.63	0.85	632.15	100	99	110	110	66	2	66				
5	20	0.57	0.76	634.55	100	99	110	110	66	2	66				
6	24	0.57	0.76	636.61	100	99	110	110	66	2	66				
7	28	0.57	0.76	638.70	100	99	110	110	64	2	64				
8	32	0.60	0.70	641.09	100	99	110	110	64	2	64				
9	36	0.56	0.75	642.80	100	99	110	110	64	2	64				
10	40	0.56	0.75	644.90	100	99	110	110	64	2	64				
11	44	0.57	0.76	647.00	101	99	110	110	64	2	64				
12	48	1502	0.55	649.10	101	99	110	110	64	2	64				
			Avg Delta P	Avg Delta H	Total Volume	Avg Ts	Avg Tm	Min/Max	Min/Max	Max	Max Vac	Min/Max			
WESTON	0.57167	0.75569	0.57250	0.76416	50.263	100 ✓	99.0 ✓	109 / 110	109 / 110	67	2	64			
			Avg Sqrt Delta P	Avg Sqrt Del H	Comments:										
			0.75625	0.87366											

EPA Method 0010 from EPA SW-846

SAMPLE RECOVERY FIELD DATA

EPA Method 0010 - HFPO Dimer Acid

Client Location/Plant	Chemours Fayetteville, NC	W.O. # Source & Location	15418.002.016 VE South Stack											
Run No.	1	Sample Date	7/17/19											
Sample I.D.	Chemours - VE South - Scrubber - STK - 1 - M0010 -	Analyst	JM											
		Filter Number	100											
Impinger														
Contents	Empty	HPLC H2O	HPLC H2O	1	2	3	4	5	6	7	Imp.Total	8	Total	
Final	33	100	98	2								Silica Gel		
Initial	0	100	100	0								300		
Gain	33	0	-2	2							33	125	458	
Impinger Color	Clean				Labeled?	✓				✓	✓			
Silica Gel Condition	Good				Sealed?	✓								
Run No.	2	Sample Date	7/17/19	Recovery Date	2019									
Sample I.D.	Chemours - VE South - Scrubber - STK - 2 - M0010 -	Analyst	JM	Filter Number	100									
				Impinger	1	2	3	4	5	6	7	Imp.Total	8	Total
Contents	Empty	HPLC H2O	HPLC H2O	12	98	113	8						Silica Gel	
Final	12	98	113	8									JM	
Initial	0	100	100	0									300	
Gain	12	-2	13	8								11	(4) 451	
Impinger Color	Clean				Labeled?	✓				✓	✓			
Silica Gel Condition	Good				Sealed?	✓								
Run No.	3	Sample Date	7/17/19	Recovery Date	2019									
Sample I.D.	Chemours - VE South - Scrubber - STK - 3 - M0010 -	Analyst	JM	Filter Number	100									
				Impinger	1	2	3	4	5	6	7	Imp.Total	8	Total
Contents	Empty	HPLC H2O	HPLC H2O	22	100	88	6						Silica Gel	
Final	22	100	88	6									3128	
Initial	0	100	100	0									300	
Gain	22	2	81	6								29	108	419
Impinger Color	Clean				Labeled?	✓				✓	✓			
Silica Gel Condition	Good				Sealed?	✓								

Check COC for Sample IDs of Media Blanks



METHODS AND ANALYZERS

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **16 Jul 2019**

File: C:\DATA\Chemours\July 2019\071619 VE South Run 1redo.cem
Program Version: 2.1, built 19 May 2017 **File Version:** 2.02
Computer: WSWCAIRSERVICES **Trailer:** 27
Analog Input Device: Keithley KUSB-3108

Channel 1

Analyte	O₂
Method	EPA 3A, Using Bias
Analyzer Make, Model & Serial No.	Servomex 4900
Full-Scale Output, mv	10000
Analyzer Range, %	25.0
Span Concentration, %	21.0

Channel 2

Analyte	CO₂
Method	EPA 3A, Using Bias
Analyzer Make, Model & Serial No.	Servomex 4900
Full-Scale Output, mv	10000
Analyzer Range, %	20.0
Span Concentration, %	17.1

CALIBRATION DATA

Number 1

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **16 Jul 2019**

Start Time: 11:37

O₂

Method: EPA 3A

Calibration Type: Linear Zero and High Span

Calibration Standards

%	Cylinder ID
12.1	ALM053372
21.0	CC112489

Calibration Results

Zero	14 mv
Span, 21.0 %	8025 mv

Curve Coefficients

Slope	Intercept
381.8	14

CO₂

Method: EPA 3A

Calibration Type: Linear Zero and High Span

Calibration Standards

%	Cylinder ID
9.0	ALM053372
17.1	CC112489

Calibration Results

Zero	-1 mv
Span, 17.1 %	8545 mv

Curve Coefficients

Slope	Intercept
501.2	-1

CALIBRATION ERROR DATA

Number 1

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Calibration 1

Project Number: **15418**
Operator: **SDR**
Date: **16 Jul 2019**

Start Time: 11:37

O₂

Method: EPA 3A
Span Conc. 21.0 %

Slope 381.8 **Intercept** 14.0

Standard	Result	Difference	Error	Status
%	%	%	%	
Zero	0.0	0.0	0.0	Pass
12.1	12.0	-0.1	-0.5	Pass
21.0	21.0	0.0	0.0	Pass

CO₂

Method: EPA 3A
Span Conc. 17.1 %

Slope 501.2 **Intercept** -1.0

Standard	Result	Difference	Error	Status
%	%	%	%	
Zero	0.0	0.0	0.0	Pass
9.0	9.0	0.0	0.0	Pass
17.0	17.0	0.0	0.0	Pass

BIAS

Number 1

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Calibration 1

Project Number: **15418**
Operator: **SDR**
Date: **16 Jul 2019**

Start Time: 11:45

O₂

Method: EPA 3A
Span Conc. 21.0 %

Bias Results					
Standard	Cal.	Bias	Difference	Error	Status
Gas	%	%	%	%	
Zero	0.0	0.4	0.4	1.9	Pass
Span	12.0	12.1	0.1	0.5	Pass

CO₂

Method: EPA 3A
Span Conc. 17.1 %

Bias Results					
Standard	Cal.	Bias	Difference	Error	Status
Gas	%	%	%	%	
Zero	0.0	0.1	0.1	0.6	Pass
Span	9.0	8.7	-0.3	-1.8	Pass

RUN DATA

Number 1

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **16 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
15:51	20.7	0.1
15:52	20.7	0.1
15:53	20.7	0.1
15:54	20.7	0.1
15:55	20.7	0.1
15:56	20.7	0.1
15:57	20.7	0.1
15:58	20.7	0.1
15:59	20.7	0.1
16:00	20.7	0.1
16:01	20.7	0.1
16:02	20.7	0.1
16:03	20.7	0.1
16:04	20.7	0.1
16:05	20.7	0.1
16:06	20.6	0.1
16:07	20.6	0.1
16:08	20.6	0.2
16:09	20.6	0.2
16:10	20.6	0.2
16:11	20.6	0.2
16:12	20.6	0.2
16:13	20.6	0.2
16:14	20.6	0.2
16:15	20.6	0.2
16:16	20.6	0.2
16:17	20.6	0.2
16:18	20.6	0.2
16:19	20.6	0.2
16:20	20.6	0.2
16:21	20.6	0.2
16:22	20.6	0.2
16:23	20.6	0.2
16:24	20.6	0.2
16:25	20.6	0.2
16:26	20.6	0.2
16:27	20.6	0.2
16:28	20.6	0.2
16:29	20.6	0.2
16:30	20.6	0.2

RUN DATA

Number 1

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **16 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
16:31	20.6	0.2
16:32	20.6	0.2
16:33	20.6	0.2
16:34	20.6	0.2
16:35	20.6	0.2
16:36	20.6	0.2
16:37	20.6	0.2
16:38	20.6	0.2
16:39	20.6	0.2
16:40	20.6	0.2
16:41	20.6	0.2
16:42	20.6	0.2
16:43	20.6	0.2
16:44	20.6	0.2
16:45	20.6	0.2
16:46	20.6	0.2
16:47	20.6	0.2
16:48	20.6	0.2
16:49	20.6	0.2
16:50	20.6	0.2
16:51	20.6	0.2
16:52	20.6	0.2
16:53	20.6	0.2
16:54	20.6	0.2
16:55	20.6	0.1
16:56	20.6	0.1
16:57	20.6	0.1
16:58	20.6	0.1
16:59	20.6	0.1
17:00	20.6	0.1
17:01	20.6	0.1
17:02	20.6	0.1
17:03	20.6	0.1
17:04	20.6	0.1
17:05	20.6	0.1
17:06	20.6	0.1
17:07	20.6	0.1
17:08	20.6	0.1
17:09	20.6	0.1
17:10	20.6	0.1

RUN DATA

Number 1

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **16 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
17:11	20.6	0.1
17:12	20.6	0.1
17:13	20.6	0.1
17:14	20.6	0.1
17:15	20.6	0.1
17:16	20.6	0.1
17:17	20.6	0.1
17:18	20.6	0.1
17:19	20.6	0.1
17:20	20.6	0.1
17:21	20.6	0.1
17:22	20.6	0.1
17:23	20.6	0.1
17:24	20.6	0.1
17:25	20.6	0.1
17:26	20.6	0.1
17:27	20.6	0.1
17:28	20.6	0.1
17:29	20.6	0.1
17:30	20.6	0.1
17:31	20.6	0.1
17:32	20.6	0.1
17:33	20.6	0.1
17:34	20.6	0.1
17:35	20.6	0.1
17:36	20.6	0.1
17:37	20.6	0.1
17:38	20.6	0.1
17:39	20.6	0.1
17:40	20.7	0.1
17:41	20.7	0.1
17:42	20.6	0.1
17:43	20.6	0.1
17:44	20.7	0.1
17:45	20.7	0.1
17:46	20.7	0.1
17:47	20.7	0.1
17:48	20.7	0.1
17:49	20.7	0.1
17:50	20.6	0.1

RUN DATA

Number 1

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **16 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
17:51	20.6	0.1
17:52	20.6	0.1
17:53	20.6	0.1
17:54	20.6	0.1
17:55	20.6	0.2
17:56	20.6	0.2
17:57	20.6	0.2
17:58	20.6	0.1
17:59	20.6	0.1
18:00	20.6	0.2
18:01	20.6	0.1
18:02	20.6	0.1
18:03	20.6	0.1
18:04	20.6	0.1
18:05	20.6	0.1
18:06	20.6	0.1
18:07	20.6	0.1
18:08	20.6	0.1
18:09	20.6	0.1
18:10	20.6	0.1
18:11	20.6	0.1
18:12	20.6	0.1
18:13	20.6	0.1
18:14	20.6	0.1
18:15	20.6	0.1
18:16	20.6	0.1
18:17	20.6	0.1
18:18	20.6	0.1
18:19	20.6	0.1
18:20	20.6	0.1
18:21	20.6	0.1
18:22	20.6	0.1
18:23	20.6	0.1
18:24	20.6	0.1
18:25	20.6	0.1
18:26	20.6	0.1
18:27	20.6	0.1
18:28	20.6	0.1
18:29	20.6	0.1
18:30	20.6	0.1

RUN DATA

Number 1

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **16 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
18:31	20.6	0.1
18:32	20.6	0.1
18:33	20.6	0.1
18:34	20.6	0.1
18:35	20.6	0.1
18:36	20.6	0.1
18:37	20.6	0.1
18:38	20.6	0.1
18:39	20.6	0.1
18:40	20.6	0.1
18:41	20.6	0.1
18:42	20.6	0.1
18:43	20.6	0.1
18:44	20.6	0.1
18:45	20.6	0.1
18:46	20.6	0.1
18:47	20.6	0.1
18:48	20.6	0.1
18:49	20.6	0.1
18:50	20.6	0.1
18:51	20.6	0.1
18:52	20.6	0.1
18:53	20.6	0.1
18:54	20.6	0.1
18:55	20.6	0.1
18:56	20.6	0.1
18:57	20.6	0.1
18:58	20.6	0.1
18:59	20.6	0.1
19:00	20.6	0.1
19:01	20.6	0.1
19:02	20.6	0.1
19:03	20.6	0.1
19:04	20.6	0.1
19:05	20.6	0.1
19:06	20.6	0.1
19:07	20.6	0.1
19:08	20.6	0.1
19:09	20.6	0.1
19:10	20.6	0.1

RUN DATA

Number 1

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **16 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
19:11	20.6	0.1
Avg s	20.6	0.1

RUN SUMMARY

Number 1

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Calibration 1

Project Number: **15418**
Operator: **SDR**
Date: **16 Jul 2019**

Method	O ₂ EPA 3A %	CO ₂ EPA 3A %
Conc. Units		

Time: 15:50 to 19:11

Run Averages

20.6 0.1

Pre-run Bias at 11:45

Zero Bias	0.4	0.1
Span Bias	12.1	8.7
Span Gas	12.1	9.0

Post-run Bias at 19:14

Zero Bias	0.3	0.1
Span Bias	12.0	8.8
Span Gas	12.1	9.0

Run averages corrected for the average of the pre-run and post-run bias

20.9 0.0

BIAS AND CALIBRATION DRIFT

Number 2

Client: Chemours
Location: Fayetteville
Source: VE South

Project Number: 15418
Operator: SDR
Date: 16 Jul 2019

Calibration 1

Start Time: 19:14

O₂
Method: EPA 3A
Span Conc. 21.0 %

Standard	Cal.	Bias Results			Status
		Bias	Difference	Error	
Gas	%	%	%	%	
Zero	0.0	0.3	0.3	1.4	Pass
Span	12.0	12.0	0.0	0.0	Pass

Standard	Initial*	Calibration Drift			Status
		Final	Difference	Drift	
Gas	%	%	%	%	
Zero	0.4	0.3	-0.1	-0.5	Pass
Span	12.1	12.0	-0.1	-0.5	Pass

*Bias No. 1

CO₂
Method: EPA 3A
Span Conc. 17.1 %

Standard	Cal.	Bias Results			Status
		Bias	Difference	Error	
Gas	%	%	%	%	
Zero	0.0	0.1	0.1	0.6	Pass
Span	9.0	8.8	-0.2	-1.2	Pass

Standard	Initial*	Calibration Drift			Status
		Final	Difference	Drift	
Gas	%	%	%	%	
Zero	0.1	0.1	0.0	0.0	Pass
Span	8.7	8.8	0.1	0.6	Pass

*Bias No. 1

METHODS AND ANALYZERS

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

File: C:\DATA\Chemours\July 2019\071719 VE South Runs 2 and 3.cem

Program Version: 2.1, built 19 May 2017 **File Version:** 2.02

Computer: WSWCAIRSERVICES **Trailer:** 27

Analog Input Device: Keithley KUSB-3108

Channel 1

Analyte	O₂
Method	EPA 3A, Using Bias
Analyzer Make, Model & Serial No.	Servomex 4900
Full-Scale Output, mv	10000
Analyzer Range, %	25.0
Span Concentration, %	21.0

Channel 2

Analyte	CO₂
Method	EPA 3A, Using Bias
Analyzer Make, Model & Serial No.	Servomex 4900
Full-Scale Output, mv	10000
Analyzer Range, %	20.0
Span Concentration, %	17.1

CALIBRATION DATA

Number 1

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Start Time: 06:28

O₂

Method: EPA 3A

Calibration Type: Linear Zero and High Span

Calibration Standards

%	Cylinder ID
12.1	ALM053372
21.0	CC112489

Calibration Results

Zero	10 mv
Span, 21.0 %	7984 mv

Curve Coefficients

Slope	Intercept
380.1	10

CO₂

Method: EPA 3A

Calibration Type: Linear Zero and High Span

Calibration Standards

%	Cylinder ID
9.0	ALM053372
17.1	CC112489

Calibration Results

Zero	-4 mv
Span, 17.1 %	8535 mv

Curve Coefficients

Slope	Intercept
500.8	-4

CALIBRATION ERROR DATA

Number 1

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Calibration 1

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Start Time: 06:28

O₂

Method: EPA 3A
Span Conc. 21.0 %

Slope 380.1 **Intercept** 10.0

Standard	Result	Difference	Error	Status
%	%	%	%	
Zero	0.0	0.0	0.0	Pass
12.1	12.0	-0.1	-0.5	Pass
21.0	21.0	0.0	0.0	Pass

CO₂

Method: EPA 3A
Span Conc. 17.1 %

Slope 500.8 **Intercept** -4.0

Standard	Result	Difference	Error	Status
%	%	%	%	
Zero	0.0	0.0	0.0	Pass
9.0	9.0	0.0	0.0	Pass
17.0	17.0	0.0	0.0	Pass

BIAS

Number 1

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Calibration 1

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Start Time: 06:37

O₂

Method: EPA 3A
Span Conc. 21.0 %

Bias Results					
Standard	Cal.	Bias	Difference	Error	Status
Gas	%	%	%	%	
Zero	0.0	0.0	0.0	0.0	Pass
Span	12.0	12.0	0.0	0.0	Pass

CO₂

Method: EPA 3A
Span Conc. 17.1 %

Bias Results					
Standard	Cal.	Bias	Difference	Error	Status
Gas	%	%	%	%	
Zero	0.0	0.0	0.0	0.0	Pass
Span	9.0	8.9	-0.1	-0.6	Pass

RUN DATA

Number 2

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
09:05	20.8	0.0
09:06	20.8	0.0
09:07	20.8	0.1
09:08	20.8	0.1
09:09	20.8	0.1
09:10	20.8	0.1
09:11	20.8	0.1
09:12	20.8	0.1
09:13	20.8	0.1
09:14	20.8	0.1
09:15	20.8	0.1
09:16	20.8	0.1
09:17	20.8	0.1
09:18	20.8	0.1
09:19	20.8	0.1
09:20	20.8	0.1
09:21	20.8	0.1
09:22	20.8	0.1
09:23	20.8	0.1
09:24	20.8	0.1
09:25	20.8	0.1
09:26	20.8	0.1
09:27	20.8	0.1
09:28	20.8	0.1
09:29	20.8	0.1
09:30	20.8	0.1
09:31	20.8	0.1
09:32	20.8	0.1
09:33	20.8	0.1
09:34	20.8	0.1
09:35	20.8	0.1
09:36	20.8	0.1
09:37	20.8	0.1
09:38	20.8	0.1
09:39	20.8	0.1
09:40	20.8	0.1
09:41	20.8	0.1
09:42	20.8	0.1
09:43	20.8	0.1
09:44	20.8	0.1

RUN DATA

Number 2

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
09:45	20.8	0.1
09:46	20.8	0.1
09:47	20.8	0.1
09:48	20.8	0.1
09:49	20.8	0.1
09:50	20.8	0.1
09:51	20.8	0.1
09:52	20.8	0.1
09:53	20.8	0.1
09:54	20.8	0.1
09:55	20.8	0.1
09:56	20.8	0.0
09:57	20.8	0.0
09:58	20.8	0.0
09:59	20.8	0.0
10:00	20.8	0.0
10:01	20.8	0.0
10:02	20.8	0.0
10:03	20.8	0.0
10:04	20.8	0.0
10:05	20.8	0.0
10:06	20.8	0.0
10:07	20.8	0.0
10:08	20.8	0.0
10:09	20.8	0.0
10:10	20.8	0.0
10:11	20.8	0.0
10:12	20.8	0.1
10:13	20.8	0.1
10:14	20.8	0.1
10:15	20.8	0.1
10:16	20.8	0.1
10:17	20.8	0.1
10:18	20.8	0.1
10:19	20.8	0.1
10:20	20.8	0.1
10:21	20.8	0.1
10:22	20.8	0.1
10:23	20.8	0.1
10:24	20.8	0.1

RUN DATA

Number 2

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
10:25	20.8	0.1
10:26	20.8	0.1
10:27	20.8	0.1
10:28	20.8	0.1
10:29	20.8	0.1
10:30	20.8	0.1
10:31	20.8	0.1
10:32	20.8	0.1
10:33	20.8	0.1
10:34	20.8	0.1
10:35	20.8	0.1
10:36	20.8	0.1
10:37	20.8	0.1
10:38	20.8	0.1
10:39	20.8	0.1
10:40	20.8	0.1
10:41	20.8	0.1
10:42	20.8	0.1
10:43	20.8	0.1
10:44	20.8	0.1
10:45	20.8	0.1
10:46	20.8	0.1
10:47	20.8	0.1
10:48	20.8	0.1
10:49	20.8	0.1
10:50	20.8	0.1
10:51	20.8	0.1
10:52	20.8	0.1
10:53	20.8	0.1
10:54	20.8	0.1
10:55	20.8	0.1
10:56	20.8	0.1
10:57	20.8	0.1
10:58	20.8	0.1
10:59	20.8	0.1
11:00	20.8	0.0
11:01	20.8	0.0
11:02	20.8	0.0
11:03	20.8	0.0
11:04	20.8	0.0

RUN DATA

Number 2

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
11:05	20.8	0.0
11:06	20.8	0.0
11:07	20.8	0.0
11:08	20.8	0.0
11:09	20.8	0.0
11:10	20.8	0.0
11:11	20.8	0.0
11:12	20.8	0.0
11:13	20.8	0.0
11:14	20.8	0.0
11:15	20.8	0.0
11:16	20.8	0.0
11:17	20.8	0.0
11:18	20.8	0.0
11:19	20.8	0.0
11:20	20.8	0.0
11:21	20.8	0.0
Avg	20.8	0.1

RUN SUMMARY

Number 2

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Calibration 1

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Method	O ₂ EPA 3A %	CO ₂ EPA 3A %
Conc. Units		

Time: 09:04 to 11:21

Run Averages

20.8 0.1

Pre-run Bias at 06:37

Zero Bias	0.0	0.0
Span Bias	12.0	8.9
Span Gas	12.1	9.0

Post-run Bias at 11:22

Zero Bias	0.1	0.1
Span Bias	11.9	8.8
Span Gas	12.1	9.0

Run averages corrected for the average of the pre-run and post-run bias

21.0 0.0

BIAS AND CALIBRATION DRIFT

Number 2

Client: Chemours
Location: Fayetteville
Source: VE South

Project Number: 15418
Operator: SDR
Date: 17 Jul 2019

Calibration 1

Start Time: 11:22

O₂
Method: EPA 3A
Span Conc. 21.0 %

Standard	Cal.	Bias Results			Status
		Bias	Difference	Error	
Gas	%	%	%	%	
Zero	0.0	0.1	0.1	0.5	Pass
Span	12.0	11.9	-0.1	-0.5	Pass

Standard	Initial*	Calibration Drift			Status
		Final	Difference	Drift	
Gas	%	%	%	%	
Zero	0.0	0.1	0.1	0.5	Pass
Span	12.0	11.9	-0.1	-0.5	Pass

*Bias No. 1

CO₂
Method: EPA 3A
Span Conc. 17.1 %

Standard	Cal.	Bias Results			Status
		Bias	Difference	Error	
Gas	%	%	%	%	
Zero	0.0	0.1	0.1	0.6	Pass
Span	9.0	8.8	-0.2	-1.2	Pass

Standard	Initial*	Calibration Drift			Status
		Final	Difference	Drift	
Gas	%	%	%	%	
Zero	0.0	0.1	0.1	0.6	Pass
Span	8.9	8.8	-0.1	-0.6	Pass

*Bias No. 1

RUN DATA

Number 3

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
12:50	20.9	0.1
12:51	20.9	0.1
12:52	20.8	0.1
12:53	20.8	0.1
12:54	20.8	0.1
12:55	20.8	0.1
12:56	20.8	0.1
12:57	20.8	0.1
12:58	20.8	0.1
12:59	20.8	0.1
13:00	20.8	0.1
13:01	20.8	0.1
13:02	20.8	0.1
13:03	20.8	0.1
13:04	20.8	0.1
13:05	20.8	0.1
13:06	20.8	0.1
13:07	20.8	0.1
13:08	20.8	0.1
13:09	20.8	0.1
13:10	20.8	0.1
13:11	20.8	0.1
13:12	20.8	0.1
13:13	20.8	0.1
13:14	20.8	0.1
13:15	20.8	0.1
13:16	20.8	0.1
13:17	20.8	0.1
13:18	20.8	0.1
13:19	20.8	0.1
13:20	20.8	0.1
13:21	20.8	0.1
13:22	20.8	0.1
13:23	20.8	0.1
13:24	20.8	0.1
13:25	20.8	0.1
13:26	20.8	0.1
13:27	20.8	0.1
13:28	20.8	0.1
13:29	20.8	0.1

RUN DATA

Number 3

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
13:30	20.8	0.1
13:31	20.8	0.1
13:32	20.8	0.1
13:33	20.8	0.1
13:34	20.8	0.1
13:35	20.8	0.1
13:36	20.8	0.1
13:37	20.8	0.1
13:38	20.8	0.1
13:39	20.8	0.1
13:40	20.9	0.1
13:41	20.9	0.1
13:42	20.9	0.1
13:43	20.8	0.1
13:44	20.9	0.1
13:45	20.8	0.0
13:46	20.9	0.1
13:47	20.8	0.1
13:48	20.8	0.1
13:49	20.9	0.1
13:50	20.9	0.1
13:51	20.9	0.1
13:52	20.9	0.1
13:53	20.9	0.1
13:54	20.9	0.1
13:55	20.9	0.1
13:56	20.9	0.1
13:57	20.9	0.1
13:58	20.9	0.1
13:59	20.9	0.1
14:00	20.9	0.1
14:01	20.9	0.1
14:02	20.8	0.1
14:03	20.9	0.1
14:04	20.9	0.1
14:05	20.9	0.1
14:06	20.9	0.1
14:07	20.9	0.1
14:08	20.8	0.1
14:09	20.8	0.1

RUN DATA

Number 3

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
14:10	20.8	0.1
14:11	20.8	0.1
14:12	20.8	0.1
14:13	20.8	0.1
14:14	20.8	0.1
14:15	20.8	0.1
14:16	20.8	0.1
14:17	20.8	0.1
14:18	20.8	0.1
14:19	20.8	0.1
14:20	20.8	0.1
14:21	20.8	0.1
14:22	20.8	0.1
14:23	20.8	0.1
14:24	20.8	0.1
14:25	20.8	0.1
14:26	20.8	0.1
14:27	20.8	0.1
14:28	20.8	0.1
14:29	20.8	0.1
14:30	20.8	0.1
14:31	20.8	0.1
14:32	20.8	0.1
14:33	20.8	0.1
14:34	20.8	0.1
14:35	20.8	0.1
14:36	20.8	0.1
14:37	20.8	0.1
14:38	20.8	0.1
14:39	20.8	0.1
14:40	20.8	0.1
14:41	20.8	0.1
14:42	20.8	0.1
14:43	20.8	0.1
14:44	20.8	0.1
14:45	20.8	0.1
14:46	20.8	0.1
14:47	20.8	0.1
14:48	20.8	0.1
14:49	20.8	0.1

RUN DATA

Number 3

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
14:50	20.8	0.1
14:51	20.8	0.1
14:52	20.8	0.1
14:53	20.8	0.1
14:54	20.8	0.1
14:55	20.8	0.1
14:56	20.8	0.1
14:57	20.8	0.1
14:58	20.8	0.1
14:59	20.8	0.1
15:00	20.8	0.1
15:01	20.8	0.1
15:02	20.8	0.1
15:03	20.8	0.1
15:04	20.8	0.1
15:05	20.8	0.1
15:06	20.8	0.1
15:07	20.8	0.1
15:08	20.8	0.1
15:09	20.8	0.1
15:10	20.8	0.1
15:11	20.8	0.1
15:12	20.8	0.1
15:13	20.8	0.1
15:14	20.8	0.1
15:15	20.8	0.1
15:16	20.8	0.1
15:17	20.8	0.1
15:18	20.8	0.1
15:19	20.8	0.1
15:20	20.8	0.1
15:21	20.8	0.1
15:22	20.8	0.1
15:23	20.8	0.1
15:24	20.8	0.1
15:25	20.8	0.1
15:26	20.8	0.1
15:27	20.8	0.1
15:28	20.8	0.1
15:29	20.8	0.1

RUN DATA

Number 3

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Calibration 1

Time	O ₂ %	CO ₂ %
15:30	20.8	0.1
15:31	20.8	0.1
15:32	20.8	0.1
15:33	20.8	0.1
15:34	20.8	0.1
15:35	20.8	0.1
15:36	20.8	0.1
Avg s	20.8	0.1

RUN SUMMARY

Number 3

Client: **Chemours**
Location: **Fayetteville**
Source: **VE South**

Calibration 1

Project Number: **15418**
Operator: **SDR**
Date: **17 Jul 2019**

Method	O ₂ EPA 3A %	CO ₂ EPA 3A %
Conc. Units		

Time: 12:49 to 15:36

Run Averages

20.8 0.1

Pre-run Bias at 11:22

Zero Bias	0.1	0.1
Span Bias	11.9	8.8
Span Gas	12.1	9.0

Post-run Bias at 15:38

Zero Bias	0.1	0.0
Span Bias	12.0	8.8
Span Gas	12.1	9.0

Run averages corrected for the average of the pre-run and post-run bias

21.1 0.1

BIAS AND CALIBRATION DRIFT

Number 3

Client: Chemours
Location: Fayetteville
Source: VE South

Project Number: 15418
Operator: SDR
Date: 17 Jul 2019

Calibration 1

Start Time: 15:38

O₂
Method: EPA 3A
Span Conc. 21.0 %

Standard	Cal.	Bias Results			Status
		Bias	Difference	Error	
Gas	%	%	%	%	
Zero	0.0	0.1	0.1	0.5	Pass
Span	12.0	12.0	0.0	0.0	Pass

Standard	Initial*	Calibration Drift			Status
		Final	Difference	Drift	
Gas	%	%	%	%	
Zero	0.1	0.1	0.0	0.0	Pass
Span	11.9	12.0	0.1	0.5	Pass

*Bias No. 2

CO₂
Method: EPA 3A
Span Conc. 17.1 %

Standard	Cal.	Bias Results			Status
		Bias	Difference	Error	
Gas	%	%	%	%	
Zero	0.0	0.0	0.0	0.0	Pass
Span	9.0	8.8	-0.2	-1.2	Pass

Standard	Initial*	Calibration Drift			Status
		Final	Difference	Drift	
Gas	%	%	%	%	
Zero	0.1	0.0	-0.1	-0.6	Pass
Span	8.8	8.8	0.0	0.0	Pass

*Bias No. 2

APPENDIX C
LABORATORY ANALYTICAL REPORT



Environment Testing TestAmerica

ANALYTICAL REPORT

Job Number: 140-16060-1

Job Description: VE South Carbon Bed Inlet - M0010

Contract Number: LBIO-67048

For:

Chemours Company FC, LLC The
c/o AECOM
Sabre Building, Suite 300
4051 Ogletown Road
Newark, DE 19713

Attention: Michael Aucoin

Approved for release.
Courtney M Adkins
Project Manager I
7/29/2019 4:09 PM

Courtney M Adkins, Project Manager I
5815 Middlebrook Pike, Knoxville, TN, 37921
(865)291-3000
courtney.adkins@testamericainc.com
07/29/2019

This report may not be reproduced except in full, and with written approval from the laboratory. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

Eurofins TestAmerica, Knoxville

5815 Middlebrook Pike, Knoxville, TN 37921

Tel (865) 291-3000 Fax (865) 584-4315 www.testamericainc.com

Table of Contents

Cover Title Page	1
Data Summaries	4
Definitions	4
Method Summary	5
Sample Summary	6
Case Narrative	7
QC Association	8
Client Sample Results	10
Default Detection Limits	13
Surrogate Summary	14
QC Sample Results	15
Chronicle	17
Certification Summary	21
Manual Integration Summary	23
Organic Sample Data	24
LCMS	24
8321A_HFPO_Du	24
8321A_HFPO_Du QC Summary	25
8321A_HFPO_Du Sample Data	29
Standards Data	41
8321A_HFPO_Du ICAL Data	41
8321A_HFPO_Du CCAL Data	64
Raw QC Data	76
8321A_HFPO_Du Tune Data	76
8321A_HFPO_Du Blank Data	81
8321A_HFPO_Du LCS/LCSD Data	89

Table of Contents

8321A_HFPO_Du Run Logs	98
8321A_HFPO_Du Prep Data	100
Method DV-LC-0012	107
Method DV-LC-0012 QC Summary	108
Method DV-LC-0012 Sample Data	113
Standards Data	149
Method DV-LC-0012 CCAL Data	149
Raw QC Data	167
Method DV-LC-0012 Tune Data	167
Method DV-LC-0012 Blank Data	172
Method DV-LC-0012 LCS/LCSD Data	180
Method DV-LC-0012 Run Logs	188
Method DV-LC-0012 Prep Data	190
Shipping and Receiving Documents	201
Client Chain of Custody	202

Definitions/Glossary

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Inlet - M0010

Job ID: 140-16060-1

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
☒	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

Method Summary

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Inlet - M0010

Job ID: 140-16060-1

Method	Method Description	Protocol	Laboratory
8321A	HFPO-DA	SW846	TAL DEN
8321A	PFOA and PFOS	SW846	TAL DEN
None	Leaching Procedure	TAL SOP	TAL DEN
None	Leaching Procedure for Condensate	TAL SOP	TAL DEN
None	Leaching Procedure for XAD	TAL SOP	TAL DEN

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

TAL SOP = TestAmerica Laboratories, Standard Operating Procedure

Laboratory References:

TAL DEN = Eurofins TestAmerica, Denver, 4955 Yarrow Street, Arvada, CO 80002, TEL (303)736-0100

Sample Summary

Client: Chemours Company FC, LLC The
 Project/Site: VE South Carbon Bed Inlet - M0010

Job ID: 140-16060-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received	Asset ID
140-16060-1	G-2347,2348 VES CARBON BED INLET R1 M0010 FH	Air	07/16/19 00:00	07/17/19 20:00	
140-16060-2	G-2349,2350,2352 VES CARBON BED INLET R1 M0010 BH	Air	07/16/19 00:00	07/17/19 20:00	
140-16060-3	G-2351 VES CARBON BED INLET R1 M0010 IM 1,2&3 CONDENSATE	Air	07/16/19 00:00	07/17/19 20:00	
140-16060-4	G-2353 VES CARBON BED INLET R1 M0010 BREAKTHROUGH XAD-2 RESIN TUBE	Air	07/16/19 00:00	07/17/19 20:00	
140-16060-5	G-2354,2355 VES CARBON BED INLET R2 M0010 FH	Air	07/17/19 00:00	07/17/19 20:00	
140-16060-6	G-2356,2357,2359 VES CARBON BED INLET R2 M0010 BH	Air	07/17/19 00:00	07/17/19 20:00	
140-16060-7	G-2358 VES CARBON BED INLET R2 M0010 IM 1,2&3 CONDENSATE	Air	07/17/19 00:00	07/17/19 20:00	
140-16060-8	G-2360 VES CARBON BED INLET R2 M0010 BREAKTHROUGH XAD-2 RESIN TUBE	Air	07/17/19 00:00	07/17/19 20:00	
140-16060-9	G-2361,2362 VES CARBON BED INLET R3 M0010 FH	Air	07/17/19 00:00	07/17/19 20:00	
140-16060-10	G-2363,2364,2366 VES CARBON BED INLET R3 M0010 BH	Air	07/17/19 00:00	07/17/19 20:00	
140-16060-11	G-2365 VES CARBON BED INLET R3 M0010 IM 1,2&3 CONDENSATE	Air	07/17/19 00:00	07/17/19 20:00	
140-16060-12	G-2367 VES CARBON BED INLET R3 M0010 BREAKTHROUGH XAD-2 RESIN TUBE	Air	07/17/19 00:00	07/17/19 20:00	

**Job Narrative
140-16060-1**

Sample Receipt

The samples were received on July 17, 2019 at 8:00 PM in good condition and properly preserved. The temperature of the cooler at receipt was 0.4° C.

Quality Control and Data Interpretation

Unless otherwise noted, all holding times, and QC criteria were met and the test results shown in this report meet all applicable NELAC requirements.

Method 0010/Method 3542 Sampling Train Preparation

Train fractions were extracted and prepared for analysis in TestAmerica's Knoxville laboratory. Extracts and condensate samples were forwarded to the Denver laboratory for HFPO-DA analysis. All results are reported in "Total ug" per sample.

LCMS

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

Organic Prep

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

Comments

Reporting Limits (RLs) and Method Detection Limits (MDLs) for the HFPO-DA used in this report were derived in Denver for reporting soils and water samples. Method 0010 sampling train matrix specific RLs and MDLs have not been established for HFPO-DA. The soil and water limits are expected to be reasonable approximations of the actual matrix specific limits, under these conditions.

Breakthrough from the Modified Method 0010 Sampling Train for PFAS compounds will be measured by the percentage (%) concentration of a specific PFAS target analyte determined to be present in the Breakthrough XAD-2 resin module of a test run. If the concentration of a specific PFAS compound is ≤30% of the sum of the concentrations determined for the other three (3) fractions of the sampling train, then sampling breakthrough is determined not to have occurred. Also, no breakthrough will be determined to have occurred if < 250 µg of a target analyte is collected on all fractions of a sampling train. Breakthrough the sampling train implies that sample loss through the train has occurred and results in a negative bias to the sample results.

QC Association Summary

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Inlet - M0010

Job ID: 140-16060-1

LCMS

Analysis Batch: 464589

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
DLCK 280-464589/13	Lab Control Sample	Total/NA	Air	8321A	

Prep Batch: 465107

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16060-3	G-2351 VES CARBON BED INLET R1 M0010 IM	Total/NA	Air	None	
140-16060-7	G-2358 VES CARBON BED INLET R2 M0010 IM	Total/NA	Air	None	
140-16060-11	G-2365 VES CARBON BED INLET R3 M0010 IM	Total/NA	Air	None	
MB 280-465107/1-A	Method Blank	Total/NA	Air	None	
LCS 280-465107/2-A	Lab Control Sample	Total/NA	Air	None	

Prep Batch: 465193

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16060-2	G-2349,2350,2352 VES CARBON BED INLET R1 M0010 BF	Total/NA	Air	None	
140-16060-4	G-2353 VES CARBON BED INLET R1 M0010 BF	Total/NA	Air	None	
140-16060-6	G-2356,2357,2359 VES CARBON BED INLET R1 M0010 BF	Total/NA	Air	None	
140-16060-8	G-2360 VES CARBON BED INLET R2 M0010 BF	Total/NA	Air	None	
140-16060-10	G-2363,2364,2366 VES CARBON BED INLET R2 M0010 BF	Total/NA	Air	None	
140-16060-12	G-2367 VES CARBON BED INLET R3 M0010 BF	Total/NA	Air	None	
MB 280-465193/1-A	Method Blank	Total/NA	Air	None	
LCS 280-465193/2-A	Lab Control Sample	Total/NA	Air	None	

Prep Batch: 465251

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16060-1	G-2347,2348 VES CARBON BED INLET R1 M0010 BF	Total/NA	Air	None	
140-16060-5	G-2354,2355 VES CARBON BED INLET R2 M0010 BF	Total/NA	Air	None	
140-16060-9	G-2361,2362 VES CARBON BED INLET R3 M0010 BF	Total/NA	Air	None	
MB 280-465251/1-A	Method Blank	Total/NA	Air	None	
LCS 280-465251/2-A	Lab Control Sample	Total/NA	Air	None	

Analysis Batch: 465647

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16060-3	G-2351 VES CARBON BED INLET R1 M0010 IM	Total/NA	Air	8321A	465107
140-16060-7	G-2358 VES CARBON BED INLET R2 M0010 IM	Total/NA	Air	8321A	465107
140-16060-11	G-2365 VES CARBON BED INLET R3 M0010 IM	Total/NA	Air	8321A	465107
MB 280-465107/1-A	Method Blank	Total/NA	Air	8321A	465107
LCS 280-465107/2-A	Lab Control Sample	Total/NA	Air	8321A	465107

Analysis Batch: 465648

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16060-1	G-2347,2348 VES CARBON BED INLET R1 M0010 BF	Total/NA	Air	8321A	465251
140-16060-5	G-2354,2355 VES CARBON BED INLET R2 M0010 BF	Total/NA	Air	8321A	465251
140-16060-9	G-2361,2362 VES CARBON BED INLET R3 M0010 BF	Total/NA	Air	8321A	465251
MB 280-465251/1-A	Method Blank	Total/NA	Air	8321A	465251
LCS 280-465251/2-A	Lab Control Sample	Total/NA	Air	8321A	465251

Analysis Batch: 465777

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16060-2	G-2349,2350,2352 VES CARBON BED INLET R1 M0010 BF	Total/NA	Air	8321A	465193
140-16060-4	G-2353 VES CARBON BED INLET R1 M0010 BF	Total/NA	Air	8321A	465193
140-16060-6	G-2356,2357,2359 VES CARBON BED INLET R1 M0010 BF	Total/NA	Air	8321A	465193
140-16060-8	G-2360 VES CARBON BED INLET R2 M0010 BF	Total/NA	Air	8321A	465193

QC Association Summary

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Inlet - M0010

Job ID: 140-16060-1

LCMS (Continued)

Analysis Batch: 465777 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16060-10	G-2363,2364,2366 VES CARBON BED INLET R:	Total/NA	Air	8321A	465193
140-16060-12	G-2367 VES CARBON BED INLET R3 M0010 BF	Total/NA	Air	8321A	465193
MB 280-465193/1-A	Method Blank	Total/NA	Air	8321A	465193
LCS 280-465193/2-A	Lab Control Sample	Total/NA	Air	8321A	465193

Client Sample Results

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Inlet - M0010

Job ID: 140-16060-1

Client Sample ID: G-2347,2348 VES CARBON BED INLET R1 M0010 FH

Lab Sample ID: 140-16060-1

Date Collected: 07/16/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	1.39		0.126	0.0136	ug/Sample	D	07/22/19 16:15	07/25/19 14:09	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

Client Sample ID: G-2349,2350,2352 VES CARBON BED INLET R1 M0010 BH

Lab Sample ID: 140-16060-2

Date Collected: 07/16/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	36.3		0.275	0.0550	ug/Sample	D	07/22/19 12:45	07/26/19 13:48	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

Client Sample ID: G-2351 VES CARBON BED INLET R1 M0010 IMP 1,2&3 CONDENSATE

Lab Sample ID: 140-16060-3

Date Collected: 07/16/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - HFPO-DA

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	9.68		0.230	0.0117	ug/Sample	D	07/23/19 09:00	07/25/19 13:20	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

Client Sample ID: G-2353 VES CARBON BED INLET R1 M0010 BREAKTHROUGH XAD-2 RESIN TUBE

Lab Sample ID: 140-16060-4

Date Collected: 07/16/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	ND		0.200	0.0400	ug/Sample	D	07/22/19 12:45	07/26/19 13:51	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

Client Sample Results

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Inlet - M0010

Job ID: 140-16060-1

Client Sample ID: G-2354,2355 VES CARBON BED INLET R2 M0010 FH

Lab Sample ID: 140-16060-5

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	2.14		0.151	0.0163	ug/Sample	D	07/22/19 16:15	07/25/19 14:13	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

Client Sample ID: G-2356,2357,2359 VES CARBON BED INLET R2 M0010 BH

Lab Sample ID: 140-16060-6

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	7.65		0.275	0.0550	ug/Sample	D	07/22/19 12:45	07/26/19 13:54	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

Client Sample ID: G-2358 VES CARBON BED INLET R2 M0010 IMP 1,2&3 CONDENSATE

Lab Sample ID: 140-16060-7

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - HFPO-DA

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	ND		0.205	0.0105	ug/Sample	D	07/23/19 09:00	07/25/19 13:24	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

Client Sample ID: G-2360 VES CARBON BED INLET R2 M0010 BREAKTHROUGH XAD-2 RESIN TUBE

Lab Sample ID: 140-16060-8

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	ND		0.200	0.0400	ug/Sample	D	07/22/19 12:45	07/26/19 13:58	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

Client Sample Results

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Inlet - M0010

Job ID: 140-16060-1

Client Sample ID: G-2361,2362 VES CARBON BED INLET R3 M0010 FH

Lab Sample ID: 140-16060-9

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	1.95		0.126	0.0136	ug/Sample	D	07/22/19 16:15	07/25/19 14:16	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

Client Sample ID: G-2363,2364,2366 VES CARBON BED INLET R3 M0010 BH

Lab Sample ID: 140-16060-10

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	1.82		0.300	0.0600	ug/Sample	D	07/22/19 12:45	07/26/19 14:01	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

Client Sample ID: G-2365 VES CARBON BED INLET R3 M0010 IMP 1,2&3 CONDENSATE

Lab Sample ID: 140-16060-11

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - HFPO-DA

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	0.480		0.250	0.0128	ug/Sample	D	07/23/19 09:00	07/25/19 13:27	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

Client Sample ID: G-2367 VES CARBON BED INLET R3 M0010 BREAKTHROUGH XAD-2 RESIN TUBE

Lab Sample ID: 140-16060-12

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	ND		0.200	0.0400	ug/Sample	D	07/22/19 12:45	07/26/19 14:04	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

ANALYTICAL REPORT

Job Number: 140-16059-1

Job Description: VE South Carbon Bed Outlet - M0010

Contract Number: LBIO-67048

For:

Chemours Company FC, LLC The
c/o AECOM
Sabre Building, Suite 300
4051 Ogletown Road
Newark, DE 19713

Attention: Michael Aucoin



Approved for release.
Courtney M Adkins
Project Manager I
7/29/2019 4:06 PM

Courtney M Adkins, Project Manager I
5815 Middlebrook Pike, Knoxville, TN, 37921
(865)291-3000
courtney.adkins@testamericainc.com
07/29/2019

This report may not be reproduced except in full, and with written approval from the laboratory. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

Table of Contents

Cover Title Page	1
Data Summaries	4
Definitions	4
Method Summary	5
Sample Summary	6
Case Narrative	7
QC Association	8
Client Sample Results	10
Default Detection Limits	13
Surrogate Summary	14
QC Sample Results	15
Chronicle	17
Certification Summary	21
Manual Integration Summary	23
Organic Sample Data	24
LCMS	24
8321A_HFPO_Du	24
8321A_HFPO_Du QC Summary	25
8321A_HFPO_Du Sample Data	28
Standards Data	40
8321A_HFPO_Du ICAL Data	40
8321A_HFPO_Du CCAL Data	63
Raw QC Data	72
8321A_HFPO_Du Blank Data	72
8321A_HFPO_Du LCS/LCSD Data	76
8321A_HFPO_Du Run Logs	80

Table of Contents

8321A_HFPO_Du Prep Data	82
Method DV-LC-0012	87
Method DV-LC-0012 QC Summary	88
Method DV-LC-0012 Sample Data	95
Standards Data	131
Method DV-LC-0012 CCAL Data	131
Raw QC Data	149
Method DV-LC-0012 Tune Data	149
Method DV-LC-0012 Blank Data	154
Method DV-LC-0012 LCS/LCSD Data	166
Method DV-LC-0012 Run Logs	179
Method DV-LC-0012 Prep Data	182
Shipping and Receiving Documents	194
Client Chain of Custody	195

Definitions/Glossary

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Outlet - M0010

Job ID: 140-16059-1

Qualifiers

LCMS

Qualifier	Qualifier Description
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
□	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

Method Summary

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Outlet - M0010

Job ID: 140-16059-1

Method	Method Description	Protocol	Laboratory
8321A	HFPO-DA	SW846	TAL DEN
8321A	PFOA and PFOS	SW846	TAL DEN
None	Leaching Procedure	TAL SOP	TAL DEN
None	Leaching Procedure for Condensate	TAL SOP	TAL DEN
None	Leaching Procedure for XAD	TAL SOP	TAL DEN

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

TAL SOP = TestAmerica Laboratories, Standard Operating Procedure

Laboratory References:

TAL DEN = Eurofins TestAmerica, Denver, 4955 Yarrow Street, Arvada, CO 80002, TEL (303)736-0100

Sample Summary

Client: Chemours Company FC, LLC The

Project/Site: VE South Carbon Bed Outlet - M0010

Job ID: 140-16059-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received	Asset ID
140-16059-1	A-5947,5948 VES CARBON BED OUTLET R1 M0010 FH	Air	07/16/19 00:00	07/17/19 20:00	
140-16059-2	A-5949,5950,5952 VES CARBON BED OUTLET R1 M0010 BH	Air	07/16/19 00:00	07/17/19 20:00	
140-16059-3	A-5951 VES CARBON BED OUTLET R1 M0010 IMP 1,2&3 CONDENSATE	Air	07/16/19 00:00	07/17/19 20:00	
140-16059-4	A-5953 VES CARBON BED OUTLET R1 M0010 BREAKTHROUGH XAD-2 RESIN TUBE	Air	07/16/19 00:00	07/17/19 20:00	
140-16059-5	A-5954,5955 VES CARBON BED OUTLET R2 M0010 FH	Air	07/17/19 00:00	07/17/19 20:00	
140-16059-6	A-5956,5957,5959 VES CARBON BED OUTLET R2 M0010 BH	Air	07/17/19 00:00	07/17/19 20:00	
140-16059-7	A-5958 VES CARBON BED OUTLET R2 M0010 IMP 1,2&3 CONDENSATE	Air	07/17/19 00:00	07/17/19 20:00	
140-16059-8	A-5960 VES CARBON BED OUTLET R2 M0010 BREAKTHROUGH XAD-2 RESIN TUBE	Air	07/17/19 00:00	07/17/19 20:00	
140-16059-9	A-5961,5962 VES CARBON BED OUTLET R3 M0010 FH	Air	07/17/19 00:00	07/17/19 20:00	
140-16059-10	A-5963,5964,5966 VES CARBON BED OUTLET R3 M0010 BH	Air	07/17/19 00:00	07/17/19 20:00	
140-16059-11	A-5965 VES CARBON BED OUTLET R3 M0010 IMP 1,2&3 CONDENSATE	Air	07/17/19 00:00	07/17/19 20:00	
140-16059-12	A-5967 VES CARBON BED OUTLET R3 M0010 BREAKTHROUGH XAD-2 RESIN TUBE	Air	07/17/19 00:00	07/17/19 20:00	

**Job Narrative
140-16059-1**

Sample Receipt

The samples were received on July 17, 2019 at 8:00 PM in good condition and properly preserved. The temperature of the cooler at receipt was 0.2° C.

Quality Control and Data Interpretation

Unless otherwise noted, all holding times, and QC criteria were met and the test results shown in this report meet all applicable NELAC requirements.

Method 0010/Method 3542 Sampling Train Preparation

Train fractions were extracted and prepared for analysis in TestAmerica's Knoxville laboratory. Extracts and condensate samples were forwarded to the Denver laboratory for HFPO-DA analysis. All results are reported in "Total ug" per sample.

LCMS

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

Organic Prep

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

Comments

Reporting Limits (RLs) and Method Detection Limits (MDLs) for the HFPO-DA used in this report were derived in Denver for reporting soils and water samples. Method 0010 sampling train matrix specific RLs and MDLs have not been established for HFPO-DA. The soil and water limits are expected to be reasonable approximations of the actual matrix specific limits, under these conditions.

Breakthrough from the Modified Method 0010 Sampling Train for PFAS compounds will be measured by the percentage (%) concentration of a specific PFAS target analyte determined to be present in the Breakthrough XAD-2 resin module of a test run. If the concentration of a specific PFAS compound is ≤30% of the sum of the concentrations determined for the other three (3) fractions of the sampling train, then sampling breakthrough is determined not to have occurred. Also, no breakthrough will be determined to have occurred if < 250 µg of a target analyte is collected on all fractions of a sampling train. Breakthrough the sampling train implies that sample loss through the train has occurred and results in a negative bias to the sample results.

QC Association Summary

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Outlet - M0010

Job ID: 140-16059-1

LCMS

Analysis Batch: 464589

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
DLCK 280-464589/13	Lab Control Sample	Total/NA	Air	8321A	

Prep Batch: 465059

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16059-2	A-5949,5950,5952 VES CARBON BED OUTLET	Total/NA	Air	None	
140-16059-4	A-5953 VES CARBON BED OUTLET R1 M0010	Total/NA	Air	None	
140-16059-6	A-5956,5957,5959 VES CARBON BED OUTLET	Total/NA	Air	None	
140-16059-8	A-5960 VES CARBON BED OUTLET R2 M0010	Total/NA	Air	None	
140-16059-10	A-5963,5964,5966 VES CARBON BED OUTLET	Total/NA	Air	None	
140-16059-12	A-5967 VES CARBON BED OUTLET R3 M0010	Total/NA	Air	None	
MB 280-465059/13-A	Method Blank	Total/NA	Air	None	
MB 280-465059/1-A	Method Blank	Total/NA	Air	None	
LCS 280-465059/2-A	Lab Control Sample	Total/NA	Air	None	

Prep Batch: 465107

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16059-3	A-5951 VES CARBON BED OUTLET R1 M0010	Total/NA	Air	None	
140-16059-7	A-5958 VES CARBON BED OUTLET R2 M0010	Total/NA	Air	None	
140-16059-11	A-5965 VES CARBON BED OUTLET R3 M0010	Total/NA	Air	None	
MB 280-465107/1-A	Method Blank	Total/NA	Air	None	
LCS 280-465107/2-A	Lab Control Sample	Total/NA	Air	None	

Prep Batch: 465251

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16059-1	A-5947,5948 VES CARBON BED OUTLET R1 M	Total/NA	Air	None	
140-16059-5	A-5954,5955 VES CARBON BED OUTLET R2 M	Total/NA	Air	None	
140-16059-9	A-5961,5962 VES CARBON BED OUTLET R3 M	Total/NA	Air	None	
MB 280-465251/1-A	Method Blank	Total/NA	Air	None	
LCS 280-465251/2-A	Lab Control Sample	Total/NA	Air	None	

Analysis Batch: 465646

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16059-2	A-5949,5950,5952 VES CARBON BED OUTLET	Total/NA	Air	8321A	465059
140-16059-4	A-5953 VES CARBON BED OUTLET R1 M0010	Total/NA	Air	8321A	465059
140-16059-6	A-5956,5957,5959 VES CARBON BED OUTLET	Total/NA	Air	8321A	465059
140-16059-8	A-5960 VES CARBON BED OUTLET R2 M0010	Total/NA	Air	8321A	465059
140-16059-10	A-5963,5964,5966 VES CARBON BED OUTLET	Total/NA	Air	8321A	465059
140-16059-12	A-5967 VES CARBON BED OUTLET R3 M0010	Total/NA	Air	8321A	465059
MB 280-465059/13-A	Method Blank	Total/NA	Air	8321A	465059
MB 280-465059/1-A	Method Blank	Total/NA	Air	8321A	465059
LCS 280-465059/2-A	Lab Control Sample	Total/NA	Air	8321A	465059

Analysis Batch: 465647

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16059-3	A-5951 VES CARBON BED OUTLET R1 M0010	Total/NA	Air	8321A	465107
140-16059-7	A-5958 VES CARBON BED OUTLET R2 M0010	Total/NA	Air	8321A	465107
140-16059-11	A-5965 VES CARBON BED OUTLET R3 M0010	Total/NA	Air	8321A	465107
MB 280-465107/1-A	Method Blank	Total/NA	Air	8321A	465107
LCS 280-465107/2-A	Lab Control Sample	Total/NA	Air	8321A	465107

QC Association Summary

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Outlet - M0010

Job ID: 140-16059-1

LCMS

Analysis Batch: 465648

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16059-1	A-5947,5948 VES CARBON BED OUTLET R1 M	Total/NA	Air	8321A	465251
140-16059-5	A-5954,5955 VES CARBON BED OUTLET R2 M	Total/NA	Air	8321A	465251
140-16059-9	A-5961,5962 VES CARBON BED OUTLET R3 M	Total/NA	Air	8321A	465251
MB 280-465251/1-A	Method Blank	Total/NA	Air	8321A	465251
LCS 280-465251/2-A	Lab Control Sample	Total/NA	Air	8321A	465251

Client Sample Results

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Outlet - M0010

Job ID: 140-16059-1

**Client Sample ID: A-5947,5948 VES CARBON BED OUTLET R1
M0010 FH**

Lab Sample ID: 140-16059-1

Date Collected: 07/16/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	1.07		0.102	0.0110	ug/Sample	D	07/22/19 16:15	07/25/19 14:00	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

13C3 HFPO-DA 92 50 - 200

**Client Sample ID: A-5949,5950,5952 VES CARBON BED
OUTLET R1 M0010 BH**

Lab Sample ID: 140-16059-2

Date Collected: 07/16/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	4.91		0.300	0.0600	ug/Sample	D	07/19/19 14:50	07/25/19 12:18	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

13C3 HFPO-DA 76 50 - 200

**Client Sample ID: A-5951 VES CARBON BED OUTLET R1
M0010 IMP 1,2&3 CONDENSATE**

Lab Sample ID: 140-16059-3

Date Collected: 07/16/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - HFPO-DA

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	2.01		0.222	0.0113	ug/Sample	D	07/23/19 09:00	07/25/19 13:11	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

13C3 HFPO-DA 79 50 - 200

**Client Sample ID: A-5953 VES CARBON BED OUTLET R1
M0010 BREAKTHROUGH XAD-2 RESIN TUBE**

Lab Sample ID: 140-16059-4

Date Collected: 07/16/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	ND		0.200	0.0400	ug/Sample	D	07/19/19 14:50	07/25/19 12:25	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

13C3 HFPO-DA 75 50 - 200

Client Sample Results

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Outlet - M0010

Job ID: 140-16059-1

**Client Sample ID: A-5954,5955 VES CARBON BED OUTLET R2
M0010 FH**

Lab Sample ID: 140-16059-5

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	1.04		0.126	0.0136	ug/Sample	D	07/22/19 16:15	07/25/19 14:03	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C3 HFPO-DA	85		50 - 200				07/22/19 16:15	07/25/19 14:03	1

**Client Sample ID: A-5956,5957,5959 VES CARBON BED
OUTLET R2 M0010 BH**

Lab Sample ID: 140-16059-6

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	0.983		0.275	0.0550	ug/Sample	D	07/19/19 14:50	07/25/19 12:28	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C3 HFPO-DA	79		50 - 200				07/19/19 14:50	07/25/19 12:28	1

**Client Sample ID: A-5958 VES CARBON BED OUTLET R2
M0010 IMP 1,2&3 CONDENSATE**

Lab Sample ID: 140-16059-7

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - HFPO-DA

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	0.281		0.210	0.0107	ug/Sample	D	07/23/19 09:00	07/25/19 13:14	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C3 HFPO-DA	81		50 - 200				07/23/19 09:00	07/25/19 13:14	1

**Client Sample ID: A-5960 VES CARBON BED OUTLET R2
M0010 BREAKTHROUGH XAD-2 RESIN TUBE**

Lab Sample ID: 140-16059-8

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	ND		0.200	0.0400	ug/Sample	D	07/19/19 14:50	07/25/19 12:31	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C3 HFPO-DA	82		50 - 200				07/19/19 14:50	07/25/19 12:31	1

Eurofins TestAmerica, Knoxville

Client Sample Results

Client: Chemours Company FC, LLC The
Project/Site: VE South Carbon Bed Outlet - M0010

Job ID: 140-16059-1

**Client Sample ID: A-5961,5962 VES CARBON BED OUTLET R3
M0010 FH**

Lab Sample ID: 140-16059-9

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	1.10		0.126	0.0136	ug/Sample	D	07/22/19 16:15	07/25/19 14:06	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

13C3 HFPO-DA 86 50 - 200

**Client Sample ID: A-5963,5964,5966 VES CARBON BED
OUTLET R3 M0010 BH**

Lab Sample ID: 140-16059-10

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	1.34		0.275	0.0550	ug/Sample	D	07/19/19 14:50	07/25/19 12:35	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

13C3 HFPO-DA 82 50 - 200

**Client Sample ID: A-5965 VES CARBON BED OUTLET R3
M0010 IMP 1,2&3 CONDENSATE**

Lab Sample ID: 140-16059-11

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - HFPO-DA

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	0.206	J	0.230	0.0117	ug/Sample	D	07/23/19 09:00	07/25/19 13:17	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

13C3 HFPO-DA 80 50 - 200

**Client Sample ID: A-5967 VES CARBON BED OUTLET R3
M0010 BREAKTHROUGH XAD-2 RESIN TUBE**

Lab Sample ID: 140-16059-12

Date Collected: 07/17/19 00:00

Matrix: Air

Date Received: 07/17/19 20:00

Sample Container: Air Train

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	ND		0.200	0.0400	ug/Sample	D	07/19/19 14:50	07/25/19 12:38	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac

13C3 HFPO-DA 78 50 - 200

ANALYTICAL REPORT

Job Number: 140-16057-1

Job Description: VE South Stack - M0010

Contract Number: LBIO-67048

For:

Chemours Company FC, LLC The
c/o AECOM
Sabre Building, Suite 300
4051 Ogletown Road
Newark, DE 19713

Attention: Michael Aucoin



Approved for release.
Courtney M Adkins
Project Manager I
7/29/2019 4:01 PM

Courtney M Adkins, Project Manager I
5815 Middlebrook Pike, Knoxville, TN, 37921
(865)291-3000
courtney.adkins@testamericainc.com
07/29/2019

This report may not be reproduced except in full, and with written approval from the laboratory. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

Table of Contents

Cover Title Page	1
Data Summaries	4
Definitions	4
Method Summary	5
Sample Summary	6
Case Narrative	7
QC Association	8
Client Sample Results	10
Default Detection Limits	13
Surrogate Summary	14
QC Sample Results	15
Chronicle	17
Certification Summary	22
Manual Integration Summary	24
Organic Sample Data	27
LCMS	27
8321A_HFPO_Du	27
8321A_HFPO_Du QC Summary	28
8321A_HFPO_Du Sample Data	31
Standards Data	45
8321A_HFPO_Du ICAL Data	45
8321A_HFPO_Du CCAL Data	68
Raw QC Data	74
8321A_HFPO_Du Tune Data	74
8321A_HFPO_Du Blank Data	79
8321A_HFPO_Du LCS/LCSD Data	83

Table of Contents

8321A_HFPO_Du Run Logs	87
8321A_HFPO_Du Prep Data	89
Method DV-LC-0012	96
Method DV-LC-0012 QC Summary	97
Method DV-LC-0012 Sample Data	105
Standards Data	142
Method DV-LC-0012 CCAL Data	142
Raw QC Data	163
Method DV-LC-0012 Tune Data	163
Method DV-LC-0012 Blank Data	168
Method DV-LC-0012 LCS/LCSD Data	184
Method DV-LC-0012 Run Logs	201
Method DV-LC-0012 Prep Data	205
Shipping and Receiving Documents	218
Client Chain of Custody	219

Definitions/Glossary

Client: Chemours Company FC, LLC The
Project/Site: VE South Stack - M0010

Job ID: 140-16057-1

Qualifiers

LCMS

Qualifier	Qualifier Description
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Glossary

Abbreviation

These commonly used abbreviations may or may not be present in this report.

□	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

Method Summary

Client: Chemours Company FC, LLC The
Project/Site: VE South Stack - M0010

Job ID: 140-16057-1

Method	Method Description	Protocol	Laboratory
8321A	HFPO-DA	SW846	TAL DEN
8321A	PFOA and PFOS	SW846	TAL DEN
None	Leaching Procedure	TAL SOP	TAL DEN
None	Leaching Procedure for Condensate	TAL SOP	TAL DEN
None	Leaching Procedure for XAD	TAL SOP	TAL DEN

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

TAL SOP = TestAmerica Laboratories, Standard Operating Procedure

Laboratory References:

TAL DEN = Eurofins TestAmerica, Denver, 4955 Yarrow Street, Arvada, CO 80002, TEL (303)736-0100

Sample Summary

Client: Chemours Company FC, LLC The
Project/Site: VE South Stack - M0010

Job ID: 140-16057-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received	Asset ID
140-16057-1	R-2305,2306 VES STK R1 M0010 FH	Air	07/16/19 00:00	07/17/19 20:00	
140-16057-2	R-2307,2308,2310 VES STK R1 M0010 BH	Air	07/16/19 00:00	07/17/19 20:00	
140-16057-3	R-2309 VES STK R1 M0010 IMP 1,2&3 CONDENSATE	Air	07/16/19 00:00	07/17/19 20:00	
140-16057-4	R-2311 VES STK R1 M0010 BREAKTHROUGH XAD-2 RESIN TUBE	Air	07/16/19 00:00	07/17/19 20:00	
140-16057-5	R-2312,2313 VES STK R2 M0010 FH	Air	07/17/19 00:00	07/17/19 20:00	
140-16057-6	R-2314,2315,2317 VES STK R2 M0010 BH	Air	07/17/19 00:00	07/17/19 20:00	
140-16057-7	R-2316 VES STK R2 M0010 IMP 1,2&3 CONDENSATE	Air	07/17/19 00:00	07/17/19 20:00	
140-16057-8	R-2318 VES STK R2 M0010 BREAKTHROUGH XAD-2 RESIN TUBE	Air	07/17/19 00:00	07/17/19 20:00	
140-16057-9	R-2319,2320 VES STK R3 M0010 FH	Air	07/17/19 00:00	07/17/19 20:00	
140-16057-10	R-2321,2322,2324 VES STK R3 M0010 BH	Air	07/17/19 00:00	07/17/19 20:00	
140-16057-11	R-2323 VES STK R3 M0010 IMP 1,2&3 CONDENSATE	Air	07/17/19 00:00	07/17/19 20:00	
140-16057-12	R-2325 VES STK R3 M0010 BREAKTHROUGH XAD-2 RESIN TUBE	Air	07/17/19 00:00	07/17/19 20:00	

**Job Narrative
140-16057-1**

Sample Receipt

The samples were received on July 17, 2019 at 8:00 PM in good condition and properly preserved. The temperatures of the 2 coolers at receipt time were 0.3° C and 0.7° C.

Quality Control and Data Interpretation

Unless otherwise noted, all holding times, and QC criteria were met and the test results shown in this report meet all applicable NELAC requirements.

Method 0010/Method 3542 Sampling Train Preparation

Train fractions were extracted and prepared for analysis in TestAmerica's Knoxville laboratory. Extracts and condensate samples were forwarded to the Denver laboratory for HFPO-DA analysis. All results are reported in "Total ug" per sample.

LCMS

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

Organic Prep

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

Comments

Reporting Limits (RLs) and Method Detection Limits (MDLs) for the HFPO-DA used in this report were derived in Denver for reporting soils and water samples. Method 0010 sampling train matrix specific RLs and MDLs have not been established for HFPO-DA. The soil and water limits are expected to be reasonable approximations of the actual matrix specific limits, under these conditions.

Breakthrough from the Modified Method 0010 Sampling Train for PFAS compounds will be measured by the percentage (%) concentration of a specific PFAS target analyte determined to be present in the Breakthrough XAD-2 resin module of a test run. If the concentration of a specific PFAS compound is ≤30% of the sum of the concentrations determined for the other three (3) fractions of the sampling train, then sampling breakthrough is determined not to have occurred. Also, no breakthrough will be determined to have occurred if < 250 µg of a target analyte is collected on all fractions of a sampling train. Breakthrough the sampling train implies that sample loss through the train has occurred and results in a negative bias to the sample results.

QC Association Summary

Client: Chemours Company FC, LLC The
Project/Site: VE South Stack - M0010

Job ID: 140-16057-1

LCMS

Analysis Batch: 464589

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
DLCK 280-464589/13	Lab Control Sample	Total/NA	Air	8321A	

Prep Batch: 465059

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16057-2	R-2307,2308,2310 VES STK R1 M0010 BH	Total/NA	Air	None	
140-16057-4	R-2311 VES STK R1 M0010 BREAKTHROUGH	Total/NA	Air	None	
140-16057-6	R-2314,2315,2317 VES STK R2 M0010 BH	Total/NA	Air	None	
140-16057-8	R-2318 VES STK R2 M0010 BREAKTHROUGH	Total/NA	Air	None	
MB 280-465059/1-A	Method Blank	Total/NA	Air	None	
LCS 280-465059/2-A	Lab Control Sample	Total/NA	Air	None	

Prep Batch: 465107

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16057-3	R-2309 VES STK R1 M0010 IMP 1,2&3 CONDEI	Total/NA	Air	None	
140-16057-7	R-2316 VES STK R2 M0010 IMP 1,2&3 CONDEI	Total/NA	Air	None	
140-16057-11	R-2323 VES STK R3 M0010 IMP 1,2&3 CONDEI	Total/NA	Air	None	
MB 280-465107/1-A	Method Blank	Total/NA	Air	None	
LCS 280-465107/2-A	Lab Control Sample	Total/NA	Air	None	

Prep Batch: 465193

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16057-10	R-2321,2322,2324 VES STK R3 M0010 BH	Total/NA	Air	None	
140-16057-12	R-2325 VES STK R3 M0010 BREAKTHROUGH	Total/NA	Air	None	
MB 280-465193/1-A	Method Blank	Total/NA	Air	None	
LCS 280-465193/2-A	Lab Control Sample	Total/NA	Air	None	

Prep Batch: 465251

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16057-1	R-2305,2306 VES STK R1 M0010 FH	Total/NA	Air	None	
140-16057-5	R-2312,2313 VES STK R2 M0010 FH	Total/NA	Air	None	
140-16057-9	R-2319,2320 VES STK R3 M0010 FH	Total/NA	Air	None	
MB 280-465251/1-A	Method Blank	Total/NA	Air	None	
LCS 280-465251/2-A	Lab Control Sample	Total/NA	Air	None	

Analysis Batch: 465646

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16057-2	R-2307,2308,2310 VES STK R1 M0010 BH	Total/NA	Air	8321A	465059
140-16057-4	R-2311 VES STK R1 M0010 BREAKTHROUGH	Total/NA	Air	8321A	465059
140-16057-6	R-2314,2315,2317 VES STK R2 M0010 BH	Total/NA	Air	8321A	465059
140-16057-8	R-2318 VES STK R2 M0010 BREAKTHROUGH	Total/NA	Air	8321A	465059
MB 280-465059/1-A	Method Blank	Total/NA	Air	8321A	465059
LCS 280-465059/2-A	Lab Control Sample	Total/NA	Air	8321A	465059

Analysis Batch: 465647

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16057-3	R-2309 VES STK R1 M0010 IMP 1,2&3 CONDEI	Total/NA	Air	8321A	465107
140-16057-7	R-2316 VES STK R2 M0010 IMP 1,2&3 CONDEI	Total/NA	Air	8321A	465107
140-16057-11	R-2323 VES STK R3 M0010 IMP 1,2&3 CONDEI	Total/NA	Air	8321A	465107
MB 280-465107/1-A	Method Blank	Total/NA	Air	8321A	465107
LCS 280-465107/2-A	Lab Control Sample	Total/NA	Air	8321A	465107

QC Association Summary

Client: Chemours Company FC, LLC The
Project/Site: VE South Stack - M0010

Job ID: 140-16057-1

LCMS

Analysis Batch: 465648

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16057-1	R-2305,2306 VES STK R1 M0010 FH	Total/NA	Air	8321A	465251
140-16057-5	R-2312,2313 VES STK R2 M0010 FH	Total/NA	Air	8321A	465251
140-16057-9	R-2319,2320 VES STK R3 M0010 FH	Total/NA	Air	8321A	465251
MB 280-465251/1-A	Method Blank	Total/NA	Air	8321A	465251
LCS 280-465251/2-A	Lab Control Sample	Total/NA	Air	8321A	465251

Analysis Batch: 465777

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
140-16057-10	R-2321,2322,2324 VES STK R3 M0010 BH	Total/NA	Air	8321A	465193
140-16057-12	R-2325 VES STK R3 M0010 BREAKTHROUGH	Total/NA	Air	8321A	465193
MB 280-465193/1-A	Method Blank	Total/NA	Air	8321A	465193
LCS 280-465193/2-A	Lab Control Sample	Total/NA	Air	8321A	465193

Client Sample Results

Client: Chemours Company FC, LLC The
Project/Site: VE South Stack - M0010

Job ID: 140-16057-1

Client Sample ID: R-2305,2306 VES STK R1 M0010 FH
Date Collected: 07/16/19 00:00
Date Received: 07/17/19 20:00
Sample Container: Air Train

Lab Sample ID: 140-16057-1
Matrix: Air

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	1.62		0.102	0.0110	ug/Sample	D	07/22/19 16:15	07/25/19 13:43	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C3 HFPO-DA	94		50 - 200				07/22/19 16:15	07/25/19 13:43	1

Client Sample ID: R-2307,2308,2310 VES STK R1 M0010 BH
Date Collected: 07/16/19 00:00
Date Received: 07/17/19 20:00
Sample Container: Air Train

Lab Sample ID: 140-16057-2
Matrix: Air

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	1.91		0.200	0.0400	ug/Sample	D	07/19/19 14:50	07/25/19 11:49	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C3 HFPO-DA	67		50 - 200				07/19/19 14:50	07/25/19 11:49	1

Client Sample ID: R-2309 VES STK R1 M0010 IMP 1,2&3 CONDENSATE
Date Collected: 07/16/19 00:00
Date Received: 07/17/19 20:00
Sample Container: Air Train

Lab Sample ID: 140-16057-3
Matrix: Air

Method: 8321A - HFPO-DA

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	0.278		0.230	0.0117	ug/Sample	D	07/23/19 09:00	07/25/19 12:51	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C3 HFPO-DA	82		50 - 200				07/23/19 09:00	07/25/19 12:51	1

Client Sample ID: R-2311 VES STK R1 M0010 BREAKTHROUGH XAD-2 RESIN TUBE
Date Collected: 07/16/19 00:00
Date Received: 07/17/19 20:00
Sample Container: Air Train

Lab Sample ID: 140-16057-4
Matrix: Air

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	ND		0.200	0.0400	ug/Sample	D	07/19/19 14:50	07/25/19 11:52	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C3 HFPO-DA	77		50 - 200				07/19/19 14:50	07/25/19 11:52	1

Client Sample ID: R-2312,2313 VES STK R2 M0010 FH
Date Collected: 07/17/19 00:00
Date Received: 07/17/19 20:00
Sample Container: Air Train

Lab Sample ID: 140-16057-5
Matrix: Air

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	0.980		0.126	0.0136	ug/Sample	D	07/22/19 16:15	07/25/19 13:46	1

Eurofins TestAmerica, Knoxville

Client Sample Results

Client: Chemours Company FC, LLC The
Project/Site: VE South Stack - M0010

Job ID: 140-16057-1

Client Sample ID: R-2312,2313 VES STK R2 M0010 FH
Date Collected: 07/17/19 00:00
Date Received: 07/17/19 20:00
Sample Container: Air Train

Lab Sample ID: 140-16057-5
Matrix: Air

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
13C3 HFPO-DA	88		50 - 200	07/22/19 16:15	07/25/19 13:46	1

Client Sample ID: R-2314,2315,2317 VES STK R2 M0010 BH
Date Collected: 07/17/19 00:00
Date Received: 07/17/19 20:00
Sample Container: Air Train

Lab Sample ID: 140-16057-6
Matrix: Air

Method: 8321A - PFOA and PFOS						
Analyte	Result	Qualifier	RL	MDL	Unit	D
HFPO-DA	1.54		0.200	0.0400	ug/Sample	D
Surrogate	%Recovery	Qualifier	Limits			
13C3 HFPO-DA	70		50 - 200			
						Prepared
						Analyzed
						Dil Fac
						07/19/19 14:50
						07/25/19 11:56
						1

Client Sample ID: R-2316 VES STK R2 M0010 IMP 1,2&3 CONDENSATE
Date Collected: 07/17/19 00:00
Date Received: 07/17/19 20:00
Sample Container: Air Train

Lab Sample ID: 140-16057-7
Matrix: Air

Method: 8321A - HFPO-DA						
Analyte	Result	Qualifier	RL	MDL	Unit	D
HFPO-DA	0.175	J	0.216	0.0110	ug/Sample	D
Surrogate	%Recovery	Qualifier	Limits			
13C3 HFPO-DA	90		50 - 200			
						Prepared
						Analyzed
						Dil Fac
						07/23/19 09:00
						07/25/19 12:54
						1

Client Sample ID: R-2318 VES STK R2 M0010 BREAKTHROUGH XAD-2 RESIN TUBE
Date Collected: 07/17/19 00:00
Date Received: 07/17/19 20:00
Sample Container: Air Train

Lab Sample ID: 140-16057-8
Matrix: Air

Method: 8321A - PFOA and PFOS						
Analyte	Result	Qualifier	RL	MDL	Unit	D
HFPO-DA	ND		0.200	0.0400	ug/Sample	D
Surrogate	%Recovery	Qualifier	Limits			
13C3 HFPO-DA	76		50 - 200			
						Prepared
						Analyzed
						Dil Fac
						07/19/19 14:50
						07/25/19 11:59
						1

Client Sample ID: R-2319,2320 VES STK R3 M0010 FH
Date Collected: 07/17/19 00:00
Date Received: 07/17/19 20:00
Sample Container: Air Train

Lab Sample ID: 140-16057-9
Matrix: Air

Method: 8321A - PFOA and PFOS						
Analyte	Result	Qualifier	RL	MDL	Unit	D
HFPO-DA	1.28		0.101	0.0109	ug/Sample	D
Surrogate	%Recovery	Qualifier	Limits			
13C3 HFPO-DA	92		50 - 200			
						Prepared
						Analyzed
						Dil Fac
						07/22/19 16:15
						07/25/19 13:50
						1

Eurofins TestAmerica, Knoxville

Client Sample Results

Client: Chemours Company FC, LLC The
Project/Site: VE South Stack - M0010

Job ID: 140-16057-1

Client Sample ID: R-2321,2322,2324 VES STK R3 M0010 BH
Date Collected: 07/17/19 00:00
Date Received: 07/17/19 20:00
Sample Container: Air Train

Lab Sample ID: 140-16057-10
Matrix: Air

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	0.464		0.225	0.0450	ug/Sample	D	07/22/19 12:45	07/26/19 13:38	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C3 HFPO-DA	88		50 - 200				07/22/19 12:45	07/26/19 13:38	1

Client Sample ID: R-2323 VES STK R3 M0010 IMP 1,2&3 CONDENSATE
Date Collected: 07/17/19 00:00
Date Received: 07/17/19 20:00
Sample Container: Air Train

Lab Sample ID: 140-16057-11

Matrix: Air

Method: 8321A - HFPO-DA

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	0.212	J	0.224	0.0114	ug/Sample	D	07/23/19 09:00	07/25/19 12:57	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C3 HFPO-DA	85		50 - 200				07/23/19 09:00	07/25/19 12:57	1

Client Sample ID: R-2325 VES STK R3 M0010 BREAKTHROUGH XAD-2 RESIN TUBE
Date Collected: 07/17/19 00:00
Date Received: 07/17/19 20:00
Sample Container: Air Train

Lab Sample ID: 140-16057-12

Matrix: Air

Method: 8321A - PFOA and PFOS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
HFPO-DA	ND		0.200	0.0400	ug/Sample	D	07/22/19 12:45	07/26/19 13:41	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C3 HFPO-DA	63		50 - 200				07/22/19 12:45	07/26/19 13:41	1

APPENDIX D
SAMPLE CALCULATIONS

**SAMPLE CALCULATIONS FOR
HFPO DIMER ACID (METHOD 0010)**

Client: Chemours
Test Number: Run 1
Test Location: VES CBed Inlet

Plant: Fayetteville, NC
Test Date: 07/16/19
Test Period: 1605-1841

1. HFPO Dimer Acid concentration, lbs/dscf.

$$\text{Conc1} = \frac{W \times 2.2046 \times 10^{-9}}{Vm(\text{std})}$$

$$\text{Conc1} = \frac{47.4 \times 2.2046 \times 10^{-9}}{48.469}$$

$$\text{Conc1} = 2.15E-09$$

Where:

W = Weight of HFPO Dimer Acid collected in sample in ug.

Conc1 = HFPO Dimer Acid concentration, lbs/dscf.

2.2046×10^{-9} = Conversion factor from ug to lbs.

2. HFPO Dimer Acid concentration, ug/dscm.

$$\text{Conc2} = W / (Vm(\text{std}) \times 0.02832)$$

$$\text{Conc2} = 47.4 / (48.469 \times 0.02832)$$

$$\text{Conc2} = 34.5$$

Where:

Conc2 = HFPO Dimer Acid concentration, ug/dscm.

0.02832 = Conversion factor from cubic feet to cubic meters.

3. HFPO Dimer Acid mass emission rate, lbs/hr.

$$MR1_{(Inlet)} = \text{Conc1} \times Qs(\text{std}) \times 60 \text{ min/hr}$$

$$MR1_{(Inlet)} = 2.15E-09 \times 25641 \times 60$$

$$MR1_{(Inlet)} = 3.31E-03$$

Where:

$$MR1_{(Inlet)} = \text{HFPO Dimer Acid mass emission rate, lbs/hr.}$$

4. HFPO Dimer Acid mass emission rate, g/sec.

$$MR2_{(Inlet)} = MR1_{(Inlet)} \times 453.59 / 3600$$

$$MR2_{(Inlet)} = 3.31E-03 \times 453.59 / 3600$$

$$MR2_{(Inlet)} = 4.17E-04$$

Where:

$$MR2_{(Inlet)} = \text{HFPO Dimer Acid mass emission rate, g/sec.}$$

$$453.59 = \text{Conversion factor from pounds to grams.}$$

$$3600 = \text{Conversion factor from hours to seconds.}$$

5. HFPO Dimer Acid Removal Efficiency, %

$$RE = \frac{MR1_{(Inlet)} - MR1_{(Outlet)}}{MR1_{(Inlet)}}$$

$$RE = \frac{(1.00E-01) - (3.60E-04)}{1.00E-01}$$

$$RE = 99.6$$

Where:

$$RE = \text{Carbon Bed Removal Efficiency.}$$

$$MR1_{(Inlet)} = \text{Carbon Bed Inlet HFPO Dimer Acid mass rate, lbs/hr.}$$

$$MR1_{(Outlet)} = \text{Carbon Bed Outlet HFPO Dimer Acid mass rate, lbs/hr.}$$

**EXAMPLE CALCULATIONS FOR
VOLUMETRIC FLOW AND MOISTURE AND ISOKINETICS**

Client: Chemours

Test Number: Run 1

Test Location: VES-Carbon Bed Inlet

Facility: Fayetteville, NC

Test Date: 07/16/19

Test Period: 1605-1841

1. Volume of dry gas sampled at standard conditions (68 deg F, 29.92 in. Hg), dscf.

$$\begin{aligned} \text{Vm(std)} &= \frac{\delta H}{17.64 \times Y \times Vm \times (Pb + \frac{\delta H}{13.6})} \\ &= \frac{0.966}{17.64 \times 1.0066 \times 50.909 \times (30.06 + \frac{0.966}{13.6})} \\ &= \frac{0.966}{101.96 + 460} = 48.469 \end{aligned}$$

Where:

Vm(std) =	Volume of gas sample measured by the dry gas meter, corrected to standard conditions, dscf.
Vm =	Volume of gas sample measured by the dry gas meter at meter conditions, dcf.
Pb =	Barometric Pressure, in Hg.
delta H =	Average pressure drop across the orifice meter, in H ₂ O
Tm =	Average dry gas meter temperature , deg F.
Y =	Dry gas meter calibration factor.
17.64 =	Factor that includes ratio of standard temperature (528 deg R) to standard pressure (29.92 in. Hg), deg R/in. Hg.
13.6 =	Specific gravity of mercury.

2. Volume of water vapor in the gas sample corrected to standard conditions, scf.

$$\begin{aligned} Vw(\text{std}) &= (0.04707 \times Vwc) + (0.04715 \times Wwsg) \\ Vw(\text{std}) &= (0.04707 \times 12.0) + (0.04715 \times 17.5) = 1.39 \end{aligned}$$

Where:

Vw(std) =	Volume of water vapor in the gas sample corrected to standard conditions, scf.
Vwc =	Volume of liquid condensed in impingers, ml.
Wwsg =	Weight of water vapor collected in silica gel, g.
0.04707 =	Factor which includes the density of water (0.002201 lb/ml), the molecular weight of water (18.0 lb/lb-mole), the ideal gas constant 21.85 (in. Hg) (ft ³)/lb-mole)(deg R); absolute temperature at standard conditions (528 deg R), absolute pressure at standard conditions (29.92 in. Hg), ft ³ /ml.
0.04715 =	Factor which includes the molecular weight of water (18.0 lb/lb-mole), the ideal gas constant 21.85 (in. Hg) (ft ³)/lb-mole)(deg R); absolute temperature at standard conditions (528 deg R), absolute pressure at standard conditions (29.92 in. Hg), and 453.6 g/lb, ft ³ /g.

3. Moisture content

$$bws = \frac{Vw(\text{std})}{Vw(\text{std}) + Vm(\text{std})}$$

$$bws = \frac{1.39}{1.39 + 48.469} = 0.028$$

Where:

bws = Proportion of water vapor, by volume, in the gas stream, dimensionless.

4. Mole fraction of dry gas.

$$Md = 1 - bws$$

$$Md = 1 - 0.028 = 0.972$$

Where:

Md = Mole fraction of dry gas, dimensionless.

5. Dry molecular weight of gas stream, lb/lb-mole.

$$MWd = (0.440 \times \% \text{ CO}_2) + (0.320 \times \% \text{ O}_2) + (0.280 \times (\% \text{ N}_2 + \% \text{ CO}))$$

$$MWd = (0.440 \times 0.0) + (0.320 \times 20.9) + (0.280 \times (79.1 + 0.00))$$

$$MWd = 28.84$$

Where:

MWd = Dry molecular weight, lb/lb-mole.

% CO₂ = Percent carbon dioxide by volume, dry basis.

% O₂ = Percent oxygen by volume, dry basis.

% N₂ = Percent nitrogen by volume, dry basis.

% CO = Percent carbon monoxide by volume, dry basis.

0.440 = Molecular weight of carbon dioxide, divided by 100.

0.320 = Molecular weight of oxygen, divided by 100.

0.280 = Molecular weight of nitrogen or carbon monoxide, divided by 100.

6. Actual molecular weight of gas stream (wet basis), lb/lb-mole.

$$MWs = (MWd \times Md) + (18 \times (1 - Md))$$

$$MWs = (28.84 \times 0.972) + (18(1 - 0.972)) = 28.53$$

Where:

MWs = Molecular weight of wet gas, lb/lb-mole.

18 = Molecular weight of water, lb/lb-mole.

7. Average velocity of gas stream at actual conditions, ft/sec.

$$Vs = \frac{85.49 \times Cp \times ((\Delta p)^{1/2}) \text{avg} \times (\frac{Ts(\text{avg})}{Ps \times MWs})^{1/2}}{}$$

$$Vs = \frac{85.49 \times 0.84 \times 1.13927 \times (\frac{560}{29.66 \times 28.53})^{1/2}}{66.5}$$

Where:

Vs =	Average gas stream velocity, ft/sec. $(lb/lb\text{-mole})(in. Hg)^{1/2}$
85.49 =	Pitot tube constant, ft/sec x ----- (deg R)(in H ₂ O)
Cp =	Pitot tube coefficient, dimensionless.
Ts =	Absolute gas stream temperature, deg R = Ts, deg F + 460. P(static)
Ps =	Absolute gas stack pressure, in. Hg. = Pb + ----- 13.6
Δp =	Velocity head of stack, in. H ₂ O.

8. Average gas stream volumetric flow rate at actual conditions, wacf/min.

$$Qs(\text{act}) = 60 \times Vs \times As$$

$$Qs(\text{act}) = 60 \times 66.5 \times 7.07 = 28214$$

Where:

Qs(act) =	Volumetric flow rate of wet stack gas at actual conditions, wacf/min.
As =	Cross-sectional area of stack, ft ² .
60 =	Conversion factor from seconds to minutes.

9. Average gas stream dry volumetric flow rate at standard conditions, dscf/min.

$$Qs(\text{std}) = \frac{Ps}{17.64 \times Md \times \frac{Ts}{}} \times Qs(\text{act})$$

$$Qs(\text{std}) = \frac{29.66}{17.64 \times 0.972 \times \frac{559.6}{}} \times 28214$$

$$Qs(\text{std}) = 25641$$

Where:

Qs(std) =	Volumetric flow rate of dry stack gas at standard conditions, dscf/min.
-----------	--

10. Isokinetic variation calculated from intermediate values, percent.

$$I = \frac{17.327 \times Ts \times Vm(\text{std})}{Vs \times O \times Ps \times Md \times (Dn)^2}$$

$$I = \frac{17.327 \times 560 \times 48.469}{66.5 \times 96 \times 29.66 \times 0.972 \times (0.160)^2} = 99.7$$

Where:

I =	Percent of isokinetic sampling.
O =	Total sampling time, minutes.
Dn =	Diameter of nozzle, inches.
17.327 =	Factor which includes standard temperature (528 deg R), standard pressure (29.92 in. Hg), the formula for calculating area of circle $D^{2/4}$, conversion of square feet to square inches (144), conversion of seconds to minutes (60), and conversion to percent (100), $\frac{(\text{in. Hg})(\text{in}^2)(\text{min})}{(\text{deg R})(\text{ft}^2)(\text{sec})}$

**SAMPLE CALCULATIONS FOR
HFPO DIMER ACID (METHOD 0010)**

Client: Chemours
Test Number: Run 1
Test Location: VES CBed Outlet

Plant: Fayetteville, NC
Test Date: 07/16/19
Test Period: 1605-1841

1. HFPO Dimer Acid concentration, lbs/dscf.

$$\text{Conc1} = \frac{W \times 2.2046 \times 10^{-9}}{Vm(\text{std})}$$

$$\text{Conc1} = \frac{8.0 \times 2.2046 \times 10^{-9}}{55.427}$$

$$\text{Conc1} = 3.18E-10$$

Where:

W = Weight of HFPO Dimer Acid collected in sample in ug.

Conc1 = HFPO Dimer Acid concentration, lbs/dscf.

2.2046×10^{-9} = Conversion factor from ug to lbs.

2. HFPO Dimer Acid concentration, ug/dscm.

$$\text{Conc2} = W / (Vm(\text{std}) \times 0.02832)$$

$$\text{Conc2} = 8.0 / (55.427 \times 0.02832)$$

$$\text{Conc2} = 5.1$$

Where:

Conc2 = HFPO Dimer Acid concentration, ug/dscm.

0.02832 = Conversion factor from cubic feet to cubic meters.

3. HFPO Dimer Acid mass emission rate, lbs/hr.

$$MR1_{(Inlet)} = \text{Conc1} \times Qs(\text{std}) \times 60 \text{ min/hr}$$

$$MR1_{(Inlet)} = 3.18E-10 \times 25043 \times 60$$

$$MR1_{(Inlet)} = 4.78E-04$$

Where:

$$MR1_{(Inlet)} = \text{HFPO Dimer Acid mass emission rate, lbs/hr.}$$

4. HFPO Dimer Acid mass emission rate, g/sec.

$$MR2_{(Inlet)} = MR1_{(Inlet)} \times 453.59 / 3600$$

$$MR2_{(Inlet)} = 4.78E-04 \times 453.59 / 3600$$

$$MR2_{(Inlet)} = 6.01E-05$$

Where:

$$MR2_{(Inlet)} = \text{HFPO Dimer Acid mass emission rate, g/sec.}$$

$$453.59 = \text{Conversion factor from pounds to grams.}$$

$$3600 = \text{Conversion factor from hours to seconds.}$$

5. HFPO Dimer Acid Removal Efficiency, %

$$RE = \frac{MR1_{(Inlet)} - MR1_{(Outlet)}}{MR1_{(Inlet)}}$$

$$RE = \frac{(3.31E-03) - (4.78E-04)}{3.31E-03}$$

$$RE = 85.6$$

Where:

$$RE = \text{Carbon Bed Removal Efficiency.}$$

$$MR1_{(Inlet)} = \text{Carbon Bed Inlet HFPO Dimer Acid mass rate, lbs/hr.}$$

$$MR1_{(Outlet)} = \text{Carbon Bed Outlet HFPO Dimer Acid mass rate, lbs/hr.}$$

**EXAMPLE CALCULATIONS FOR
VOLUMETRIC FLOW AND MOISTURE AND ISOKINETICS**

Client: Chemours

Test Number: Run 1

Test Location: VES-Carbon Bed Outlet

Facility: Fayetteville, NC

Test Date: 07/16/19

Test Period: 1605-1841

1. Volume of dry gas sampled at standard conditions (68 deg F, 29.92 in. Hg), dscf.

$$\begin{aligned} \text{Vm(std)} &= \frac{\delta H}{17.64 \times Y \times Vm \times (Pb + \frac{\delta H}{13.6})} \\ &= \frac{1.260}{17.64 \times 1.0069 \times 58.439 \times (30.06 + \frac{1.260}{13.6})} \\ &= \frac{1.260}{17.64 \times 1.0069 \times 58.439 \times (30.06 + \frac{1.260}{13.6})} = 55.427 \end{aligned}$$

Where:

Vm(std) =	Volume of gas sample measured by the dry gas meter, corrected to standard conditions, dscf.
Vm =	Volume of gas sample measured by the dry gas meter at meter conditions, dcf.
Pb =	Barometric Pressure, in Hg.
delta H =	Average pressure drop across the orifice meter, in H ₂ O
Tm =	Average dry gas meter temperature , deg F.
Y =	Dry gas meter calibration factor.
17.64 =	Factor that includes ratio of standard temperature (528 deg R) to standard pressure (29.92 in. Hg), deg R/in. Hg.
13.6 =	Specific gravity of mercury.

2. Volume of water vapor in the gas sample corrected to standard conditions, scf.

$$\begin{aligned} Vw(\text{std}) &= (0.04707 \times Vwc) + (0.04715 \times Wwsg) \\ Vw(\text{std}) &= (0.04707 \times 20.0) + (0.04715 \times 14.0) = 1.60 \end{aligned}$$

Where:

Vw(std) =	Volume of water vapor in the gas sample corrected to standard conditions, scf.
Vwc =	Volume of liquid condensed in impingers, ml.
Wwsg =	Weight of water vapor collected in silica gel, g.
0.04707 =	Factor which includes the density of water (0.002201 lb/ml), the molecular weight of water (18.0 lb/lb-mole), the ideal gas constant 21.85 (in. Hg) (ft ³)/lb-mole(deg R); absolute temperature at standard conditions (528 deg R), absolute pressure at standard conditions (29.92 in. Hg), ft ³ /ml.
0.04715 =	Factor which includes the molecular weight of water (18.0 lb/lb-mole), the ideal gas constant 21.85 (in. Hg) (ft ³)/lb-mole(deg R); absolute temperature at standard conditions (528 deg R), absolute pressure at standard conditions (29.92 in. Hg), and 453.6 g/lb, ft ³ /g.

3. Moisture content

$$bws = \frac{Vw(\text{std})}{Vw(\text{std}) + Vm(\text{std})}$$

$$bws = \frac{1.60}{1.60 + 55.427} = 0.028$$

Where:

bws = Proportion of water vapor, by volume, in the gas stream, dimensionless.

4. Mole fraction of dry gas.

$$Md = 1 - bws$$

$$Md = 1 - 0.028 = 0.972$$

Where:

Md = Mole fraction of dry gas, dimensionless.

5. Dry molecular weight of gas stream, lb/lb-mole.

$$MWd = (0.440 \times \% \text{ CO}_2) + (0.320 \times \% \text{ O}_2) + (0.280 \times (\% \text{ N}_2 + \% \text{ CO}))$$

$$MWd = (0.440 \times 0.0) + (0.320 \times 20.9) + (0.280 \times (79.1 + 0.00))$$

$$MWd = 28.84$$

Where:

MWd = Dry molecular weight, lb/lb-mole.

% CO₂ = Percent carbon dioxide by volume, dry basis.

% O₂ = Percent oxygen by volume, dry basis.

% N₂ = Percent nitrogen by volume, dry basis.

% CO = Percent carbon monoxide by volume, dry basis.

0.440 = Molecular weight of carbon dioxide, divided by 100.

0.320 = Molecular weight of oxygen, divided by 100.

0.280 = Molecular weight of nitrogen or carbon monoxide, divided by 100.

6. Actual molecular weight of gas stream (wet basis), lb/lb-mole.

$$MWs = (MWd \times Md) + (18 \times (1 - Md))$$

$$MWs = (28.84 \times 0.972) + (18(1 - 0.972)) = 28.53$$

Where:

MWs = Molecular weight of wet gas, lb/lb-mole.

18 = Molecular weight of water, lb/lb-mole.

7. Average velocity of gas stream at actual conditions, ft/sec.

$$Vs = \frac{85.49 \times Cp \times ((\Delta p)^{1/2}) \text{avg} \times (\frac{Ts(\text{avg})}{Ps \times MWs})^{1/2}}$$

$$Vs = \frac{85.49 \times 0.84 \times 0.83005 \times (\frac{560}{30.24 \times 28.53})^{1/2}}{48.0}$$

Where:

Vs =	Average gas stream velocity, ft/sec. $(\text{lb/lb-mole})(\text{in. Hg})^{1/2}$
85.49 =	Pitot tube constant, ft/sec x $\frac{\text{deg R}}{(\text{deg R})(\text{in H}_2\text{O})}$
Cp =	Pitot tube coefficient, dimensionless.
Ts =	Absolute gas stream temperature, deg R = Ts, deg F + 460. P(static)
Ps =	Absolute gas stack pressure, in. Hg. = Pb + $\frac{13.6}{\text{Velocity head of stack, in. H}_2\text{O}}$
Δp =	Velocity head of stack, in. H ₂ O.

8. Average gas stream volumetric flow rate at actual conditions, wacf/min.

$$Qs(\text{act}) = 60 \times Vs \times As$$

$$Qs(\text{act}) = 60 \times 48.0 \times 9.39 = 27061$$

Where:

Qs(act) =	Volumetric flow rate of wet stack gas at actual conditions, wacf/min.
As =	Cross-sectional area of stack, ft ² .
60 =	Conversion factor from seconds to minutes.

9. Average gas stream dry volumetric flow rate at standard conditions, dscf/min.

$$Qs(\text{std}) = \frac{Ps}{17.64 \times Md \times \frac{Ts}{Ts}}$$

$$Qs(\text{std}) = \frac{30.24}{17.64 \times 0.972 \times \frac{560.2}{560.2}} \times 27061$$

$$Qs(\text{std}) = 25043$$

Where:

Qs(std) =	Volumetric flow rate of dry stack gas at standard conditions, dscf/min.
-----------	---

10. Isokinetic variation calculated from intermediate values, percent.

$$I = \frac{17.327 \times Ts \times Vm(\text{std})}{Vs \times O \times Ps \times Md \times (Dn)^2}$$

$$I = \frac{17.327 \times 560 \times 55.427}{48.0 \times 96 \times 30.24 \times 0.972 \times (0.202)^2} = 97.3$$

Where:

I =	Percent of isokinetic sampling.
O =	Total sampling time, minutes.
Dn =	Diameter of nozzle, inches.
17.327 =	Factor which includes standard temperature (528 deg R), standard pressure (29.92 in. Hg), the formula for calculating area of circle $D^{2/4}$, conversion of square feet to square inches (144), conversion of seconds to minutes (60), and conversion to percent (100), $\frac{(\text{in. Hg})(\text{in}^2)(\text{min})}{(\text{deg R})(\text{ft}^2)(\text{sec})}$

**SAMPLE CALCULATIONS FOR
HFPO DIMER ACID (METHOD 0010)**

Client: Chemours
Test Number: Run 3
Test Location: VE South Stack

Plant: Fayetteville, NC
Test Date: 07/17/19
Test Period: 1250-1502

1. HFPO Dimer Acid concentration, lbs/dscf.

$$\text{Conc1} = \frac{W \times 2.2046 \times 10^{-9}}{Vm(\text{std})}$$

$$\text{Conc1} = \frac{2.0 \times 2.2046 \times 10^{-9}}{47.822}$$

$$\text{Conc1} = 9.02E-11$$

Where:

W = Weight of HFPO Dimer Acid collected in sample in ug.

Conc1 = Division Stack HFPO Dimer Acid concentration, lbs/dscf.

2.2046×10^{-9} = Conversion factor from ug to lbs.

2. HFPO Dimer Acid concentration, ug/dscm.

$$\text{Conc2} = W / (Vm(\text{std}) \times 0.02832)$$

$$\text{Conc2} = 2.0 / (47.822 \times 0.02832)$$

$$\text{Conc2} = 1.44$$

Where:

Conc2 = Division Stack HFPO Dimer Acid concentration, ug/dscm.

0.02832 = Conversion factor from cubic feet to cubic meters.

3. HFPO Dimer Acid mass emission rate, lbs/hr.

$$MR1_{(\text{Outlet})} = \text{Conc1} \times Qs(\text{std}) \times 60 \text{ min/hr}$$

$$MR1_{(\text{Outlet})} = 9.02E-11 \times 23134 \times 60$$

$$MR1_{(\text{Outlet})} = 1.25E-04$$

Where:

MR1_(Outlet) = Division Stack HFPO Dimer Acid mass emission rate, lbs/hr.

4. HFPO Dimer Acid mass emission rate, g/sec.

$$MR2_{(\text{Outlet})} = PMR1 \times 453.59 / 3600$$

$$MR2_{(\text{Outlet})} = 1.25E-04 \times 453.59 / 3600$$

$$MR2_{(\text{Outlet})} = 1.58E-05$$

Where:

MR2_(Outlet) = Division Stack HFPO Dimer Acid mass emission rate, g/sec.

453.6 = Conversion factor from pounds to grams.

3600 = Conversion factor from hours to seconds.

**EXAMPLE CALCULATIONS FOR
VOLUMETRIC FLOW AND MOISTURE AND ISOKINETICS**

Client: Chemours

Test Number: Run 3

Test Location: VE South Stack

Facility: Fayetteville, NC

Test Date: 07/17/19

Test Period: 1250-1502

1. Volume of dry gas sampled at standard conditions (68 deg F, 29.92 in. Hg), dscf.

$$\begin{aligned} V_{m(\text{std})} &= \frac{17.64 \times Y \times V_m \times (P_b + \frac{\Delta H}{13.6})}{(T_m + 460)} \\ V_{m(\text{std})} &= \frac{17.64 \times 1.0008 \times 50.263 \times (30.07 + \frac{0.764}{13.6})}{99.00 + 460} = 47.822 \end{aligned}$$

Where:

V _{m(std)} =	Volume of gas sample measured by the dry gas meter, corrected to standard conditions, dscf.
V _m =	Volume of gas sample measured by the dry gas meter at meter conditions, dcf.
P _b =	Barometric Pressure, in Hg.
ΔH =	Average pressure drop across the orifice meter, in H ₂ O
T _m =	Average dry gas meter temperature , deg F.
Y =	Dry gas meter calibration factor.
17.64 =	Factor that includes ratio of standard temperature (528 deg R) to standard pressure (29.92 in. Hg), deg R/in. Hg.
13.6 =	Specific gravity of mercury.

2. Volume of water vapor in the gas sample corrected to standard conditions, scf.

$$\begin{aligned} V_{w(\text{std})} &= (0.04707 \times V_{wc}) + (0.04715 \times W_{ws}) \\ V_{w(\text{std})} &= (0.04707 \times 29.0) + (0.04715 \times 12.9) = 1.97 \end{aligned}$$

Where:

V _{w(std)} =	Volume of water vapor in the gas sample corrected to standard conditions, scf.
V _{wc} =	Volume of liquid condensed in impingers, ml.
W _{ws} =	Weight of water vapor collected in silica gel, g.
0.04707 =	Factor which includes the density of water (0.002201 lb/ml), the molecular weight of water (18.0 lb/lb-mole), the ideal gas constant 21.85 (in. Hg) (ft ³)/lb-mole(deg R); absolute temperature at standard conditions (528 deg R), absolute pressure at standard conditions (29.92 in. Hg), ft ³ /ml.
0.04715 =	Factor which includes the molecular weight of water (18.0 lb/lb-mole), the ideal gas constant 21.85 (in. Hg) (ft ³)/lb-mole(deg R); absolute temperature at standard conditions (528 deg R), absolute pressure at standard conditions (29.92 in. Hg), and 453.6 g/lb, ft ³ /g.

3. Moisture content

$$bws = \frac{Vw(\text{std})}{Vw(\text{std}) + Vm(\text{std})}$$

$$bws = \frac{1.97}{1.97 + 47.822} = 0.040$$

Where:

bws = Proportion of water vapor, by volume, in the gas stream, dimensionless.

4. Mole fraction of dry gas.

$$Md = 1 - bws$$

$$Md = 1 - 0.040 = 0.960$$

Where:

Md = Mole fraction of dry gas, dimensionless.

5. Dry molecular weight of gas stream, lb/lb-mole.

$$MWd = (0.440 \times \% \text{ CO}_2) + (0.320 \times \% \text{ O}_2) + (0.280 \times (\% \text{ N}_2 + \% \text{ CO}))$$

$$MWd = (0.440 \times 0.0) + (0.320 \times 20.9) + (0.280 \times (79.1 + 0.00))$$

$$MWd = 28.84$$

Where:

MWd = Dry molecular weight, lb/lb-mole.

% CO₂ = Percent carbon dioxide by volume, dry basis.

% O₂ = Percent oxygen by volume, dry basis.

% N₂ = Percent nitrogen by volume, dry basis.

% CO = Percent carbon monoxide by volume, dry basis.

0.440 = Molecular weight of carbon dioxide, divided by 100.

0.320 = Molecular weight of oxygen, divided by 100.

0.280 = Molecular weight of nitrogen or carbon monoxide, divided by 100.

6. Actual molecular weight of gas stream (wet basis), lb/lb-mole.

$$MWs = (MWd \times Md) + (18 \times (1 - Md))$$

$$MWs = (28.84 \times 0.960) + (18 \times (1 - 0.960)) = 28.41$$

Where:

MWs = Molecular weight of wet gas, lb/lb-mole.

18 = Molecular weight of water, lb/lb-mole.

7. Average velocity of gas stream at actual conditions, ft/sec.

$$Vs = \frac{85.49 \times Cp \times ((\Delta p)^{1/2}) \text{avg} \times (\frac{\text{Ts (avg)}}{Ps \times MWs})^{1/2}}$$

$$Vs = \frac{85.49 \times 0.84 \times 0.75569 \times (\frac{560}{30.25 \times 28.41})^{1/2}}{43.8}$$

Where:

$$\begin{aligned} Vs &= \text{Average gas stream velocity, ft/sec.} \\ 85.49 &= \frac{(\text{lb/lb-mole})(\text{in. Hg})^{1/2}}{\text{Pitot tube constant, ft/sec} \times (\text{deg R})(\text{in H}_2\text{O})} \\ Cp &= \text{Pitot tube coefficient, dimensionless.} \\ Ts &= \text{Absolute gas stream temperature, deg R} = \text{Ts, deg F} + 460. \\ Ps &= \text{Absolute gas stack pressure, in. Hg.} = Pb + \frac{13.6}{P(\text{static})} \\ \Delta p &= \text{Velocity head of stack, in. H}_2\text{O.} \end{aligned}$$

8. Average gas stream volumetric flow rate at actual conditions, wacf/min.

$$Qs(\text{act}) = 60 \times Vs \times As$$

$$Qs(\text{act}) = 60 \times 43.8 \times 9.62 = 25293$$

Where:

$$\begin{aligned} Qs(\text{act}) &= \text{Volumetric flow rate of wet stack gas at actual} \\ &\quad \text{conditions, wacf/min.} \\ As &= \text{Cross-sectional area of stack, ft}^2. \\ 60 &= \text{Conversion factor from seconds to minutes.} \end{aligned}$$

9. Average gas stream dry volumetric flow rate at standard conditions, dscf/min.

$$Qs(\text{std}) = \frac{Ps}{17.64 \times Md \times \frac{Ts}{Ts}}$$

$$Qs(\text{std}) = \frac{30.25}{17.64 \times 0.960 \times \frac{560.4}{560}} \times 25293$$

$$Qs(\text{std}) = 23134$$

Where:

$$Qs(\text{std}) = \text{Volumetric flow rate of dry stack gas at standard} \\ \text{conditions, dscf/min.}$$

10. Isokinetic variation calculated from intermediate values, percent.

$$I = \frac{17.327 \times Ts \times Vm(\text{std})}{Vs \times O \times Ps \times Md \times (Dn)^2}$$

$$I = \frac{17.327 \times 560 \times 47.822}{43.8 \times 96 \times 30.25 \times 0.960 \times (0.190)^2} = 105.2$$

Where:

I =	Percent of isokinetic sampling.
O =	Total sampling time, minutes.
Dn =	Diameter of nozzle, inches.
17.327 =	Factor which includes standard temperature (528 deg R), standard pressure (29.92 in. Hg), the formula for calculating area of circle $D^{2/4}$, conversion of square feet to square inches (144), conversion of seconds to minutes (60), and conversion to percent (100), $\frac{(\text{in. Hg})(\text{in}^2)(\text{min})}{(\text{deg R})(\text{ft}^2)(\text{sec})}$

APPENDIX E
EQUIPMENT CALIBRATION RECORDS

INTERFERENCE CHECK

Date: 12/4/14-12/5/14

Analyzer Type: Servomex - O₂

Model No: 4900

Serial No: 49000-652921

Calibration Span: 21.09 %

Pollutant: 21.09% O₂ - CC418692

INTERFERENT GAS	ANALYZER RESPONSE		% OF CALIBRATION SPAN ^(a)
	INTERFERENT GAS RESPONSE (%)	INTERFERENT GAS RESPONSE, WITH BACKGROUND POLLUTANT (%)	
CO ₂ (30.17% CC199689)	0.00 .	-0.01	0.00
NO (445 ppm CC346681)	0.00	0.02	0.11
NO ₂ (23.78 ppm CC500749)	NA	NA	NA
N ₂ O (90.4 ppm CC352661)	0.00	0.05	0.24
CO (461.5 ppm XC006064B)	0.00	0.02	0.00
SO ₂ (451.2 ppm CC409079)	0.00	0.05	0.23
CH ₄ (453.1 ppm SG901795)	NA	NA	NA
H ₂ (552 ppm ALM048043)	0.00	0.09	0.44
HCl (45.1 ppm CC17830)	0.00	0.03	0.14
NH ₃ (9.69 ppm CC58181)	0.00	0.01	0.03
TOTAL INTERFERENCE RESPONSE			1.20
METHOD SPECIFICATION			< 2.5%

^(a) The larger of the absolute values obtained for the interferent tested with and without the pollutant present was used in summing the interferences.


Chad Walker

INTERFERENCE CHECK

Date: 12/4/14-12/5/14

Analyzer Type: Servomex - CO₂

Model No: 4900

Serial No: 49000-652921

Calibration Span: 16.65%

Pollutant: 16.65% CO₂ - CC418692

INTERFERENT GAS	ANALYZER RESPONSE		% OF CALIBRATION SPAN ^(a)
	INTERFERENT GAS RESPONSE (%)	INTERFERENT GAS RESPONSE, WITH BACKGROUND POLLUTANT (%)	
CO ₂ (30.17% CC199689)	NA .	NA	NA
NO (445 ppm CC346681)	0.00	0.02	0.10
NO ₂ (23.78 ppm CC500749)	0.00	0.00	0.02
N ₂ O (90.4 ppm CC352661)	0.00	0.01	0.04
CO (461.5 ppm XC006064B)	0.00	0.01	0.00
SO ₂ (451.2 ppm CC409079)	0.00	0.11	0.64
CH ₄ (453.1 ppm SG901795)	0.00	0.07	0.44
H ₂ (552 ppm ALM048043)	0.00	0.04	0.22
HCl (45.1 ppm CC17830)	0.10	0.06	0.60
NH ₃ (9.69 ppm CC58181)	0.00	0.02	0.14
TOTAL INTERFERENCE RESPONSE			2.19
METHOD SPECIFICATION			< 2.5%

^(a) The larger of the absolute values obtained for the interferent tested with and without the pollutant present was used in summing the interferences.


Chad Walker

CERTIFICATE OF ANALYSIS

Grade of Product: EPA Protocol

Part Number: E03NI79E15A00E4
 Cylinder Number: ALM053372
 Laboratory: 124 - Plumsteadville - PA
 PGVP Number: A12019
 Gas Code: CO2,O2,BALN

Reference Number: 160-401424145-1
 Cylinder Volume: 150.5 CF
 Cylinder Pressure: 2015 PSIG
 Valve Outlet: 590
 Certification Date: Feb 26, 2019

Expiration Date: Feb 26, 2027

Certification performed in accordance with "EPA Traceability Protocol for Assay and Certification of Gaseous Calibration Standards (May 2012)" document EPA 600/R-12/531, using the assay procedures listed. Analytical Methodology does not require correction for analytical interference. This cylinder has a total analytical uncertainty as stated below with a confidence level of 95%. There are no significant impurities which affect the use of this calibration mixture. All concentrations are on a volume/volume basis unless otherwise noted.

Do Not Use This Cylinder below 100 psig, i.e. 0.7 megapascals.

ANALYTICAL RESULTS

Component	Requested Concentration	Actual Concentration	Protocol Method	Total Relative Uncertainty	Assay Dates
CARBON DIOXIDE	9.000 %	9.020 %	G1	+/- 0.6% NIST Traceable	02/26/2019
OXYGEN	12.00 %	12.07 %	G1	+/- 0.3% NIST Traceable	02/26/2019
NITROGEN	Balance			-	

CALIBRATION STANDARDS

Type	Lot ID	Cylinder No	Concentration	Uncertainty	Expiration Date
NTRM	061507	K014984	13.94 % CARBON DIOXIDE/NITROGEN	0.57%	Jan 30, 2024
NTRM	16060507	CC401541	23.204 % OXYGEN/NITROGEN	0.2%	Dec 24, 2021

ANALYTICAL EQUIPMENT

Instrument/Make/Model	Analytical Principle	Last Multipoint Calibration
HORIBA VA5011 T5V6VU9P NDIR CO2	NDIR	Feb 12, 2019
SIEMENS OXYMAT 61 S01062 O2	PARAMAGNETIC	Feb 18, 2019

Triad Data Available Upon Request



Signature on file

Approved for Release

138

Page 1 of 160-401424145-1

CERTIFICATE OF ANALYSIS

Grade of Product: EPA Protocol

Part Number:	E03NI62E15A0224	Reference Number:	82-401196512-1
Cylinder Number:	CC112489	Cylinder Volume:	157.2 CF
Laboratory:	124 - Riverton (SAP) - NJ	Cylinder Pressure:	2015 PSIG
PGVP Number:	B52018	Valve Outlet:	590
Gas Code:	CO2,O2,BALN	Certification Date:	May 12, 2018

Expiration Date: May 12, 2026

Certification performed in accordance with "EPA Traceability Protocol for Assay and Certification of Gaseous Calibration Standards (May 2012)" document EPA 600/R-12/531, using the assay procedures listed. Analytical Methodology does not require correction for analytical interference. This cylinder has a total analytical uncertainty as stated below with a confidence level of 95%. There are no significant impurities which affect the use of this calibration mixture. All concentrations are on a volume/volume basis unless otherwise noted.

Do Not Use This Cylinder below 100 psig, i.e. 0.7 megapascals.

ANALYTICAL RESULTS

Component	Requested Concentration	Actual Concentration	Protocol Method	Total Relative Uncertainty	Assay Dates
CARBON DIOXIDE	17.00 %	17.05 %	G1	+/- 0.7% NIST Traceable	05/12/2018
OXYGEN	21.00 %	20.98 %	G1	+/- 0.5% NIST Traceable	05/12/2018
NITROGEN	Balance			-	

CALIBRATION STANDARDS

Type	Lot ID	Cylinder No	Concentration	Uncertainty	Expiration Date
NTRM	13060731	CC413777	16.93% CARBON DIOXIDE/NITROGEN	+/- 0.6%	May 08, 2019
NTRM	09061420	CC273671	22.53% OXYGEN/NITROGEN	+/- 0.4%	Mar 08, 2019

ANALYTICAL EQUIPMENT

Instrument/Make/Model	Analytical Principle	Last Multipoint Calibration
Horiba VIA 510-CO2-19GYCXEG	NDIR	Apr 19, 2018
Horiba MPA 510-O2-7TWMJ041	Paramagnetic	Apr 19, 2018

Triad Data Available Upon Request



Signature on file

Approved for Release

Long Cal and Temperature Cal Datasheet for Standard Dry Gas Meter Console

Calibrator MDW

Meter Box Number 31

Ambient Temp 72

Date 12-Feb-19

Wet Test Meter Number P-2952

Temp Reference Source Thermocouple Simulator

(Accuracy +/- 1°F)

Dry Gas Meter Number 17485128

Setting	Gas Volume		Temperatures				Baro Press, in Hg (Pb)	29.75	
Orifice Manometer	Wet Test Meter	Dry gas Meter	Wet Test Meter		Dry Gas Meter		Calibration Results		
in H ₂ O (ΔH)	ft ³ (Vw)	ft ³ (Vd)	°F (Tw)	Outlet, °F (Td _o)	Inlet, °F (Td _i)	Average, °F (Td)	Time, min (O)	Y	ΔH
0.5	5.0	616.970	72.0	76.00	76.00	76.5	12.8	1.0092	1.8419
		621.960		77.00	77.00				
		4.990		76.50	76.50				
1.0	5.0	623.935	72.0	77.00	77.00	77.0	9.3	1.0079	1.9429
		628.930		77.00	77.00				
		4.995		77.00	77.00				
1.5	10.0	629.910	72.0	77.00	77.00	77.0	15.3	1.0067	1.9719
		639.900		77.00	77.00				
		9.990		77.00	77.00				
2.0	10.0	640.885	72.0	77.00	77.00	77.0	13.3	1.0054	1.9868
		650.875		77.00	77.00				
		9.990		77.00	77.00				
3.0	10.0	651.915	70.0	78.00	78.00	78.0	11.0	1.0036	2.0195
		661.955		78.00	78.00				
		10.040		78.00	78.00				
							Average	1.0066	1.9526

Vw - Gas Volume passing through the wet test meter

Vd - Gas Volume passing through the dry gas meter

Tw - Temp of gas in the wet test meter

Tdi - Temp of the inlet gas of the dry gas meter

Tdo - Temp of the outlet gas of the dry gas meter

Td - Average temp of the gas in the dry gas meter

0 - Time of calibration run

Pb - Barometric Pressure

ΔH - Pressure differential across orifice

Y - Ratio of accuracy of wet test meter to dry gas meter

$$Y = \frac{Vw * Pb * (td + 460)}{Vd * \left[Pb + \frac{(\Delta H)}{13.6} \right] * (tw + 460)}$$

$$\Delta H = \left[\frac{0.0317 * \Delta H}{Pb * (td + 460)} \right] * \left[\frac{(tw + 460) * O}{Vw} \right]^2$$

Reference Temperature	Temperature Reading from Individual Thermocouple Input ¹						Average Temperature Reading	Temp Difference ² (%)
	Channel Number							
Select Temperature	1	2	3	4	5	6	Average Temperature Reading	Temp Difference ² (%)
○ °C	32	32	32	32	32			
32	32	32	32	32	32		32.0	0.0%
212	212	213	213	212	212		212.4	-0.1%
932	932	933	933	932	932		932.4	0.0%
1832	1832	1833	1833	1832	1832		1832.4	0.0%

1 - Channel Temps must agree with +/- 5°F or 3°C

2 - Acceptable Temperature Difference less than 1.5 %

$$\text{Temp Diff} = \left[\frac{(\text{Reference Temp } ^\circ F + 460) - (\text{Test Temp } ^\circ F + 460)}{\text{Reference Temp } ^\circ F + 460} \right]$$

Y Factor Calibration Check Calculation

MODIFIED METHOD 0010 TEST TRAIN

VES CARBON BED INLET

METER BOX NO. 31

07/16/19 and 07/17/19

	Run 1	Run 2	Run 3
MWd = Dry molecular weight source gas, lb/lb-mole.			
0.32 = Molecular weight of oxygen, divided by 100.			
0.44 = Molecular weight of carbon dioxide, divided by 100.			
0.28 = Molecular weight of nitrogen or carbon monoxide, divided by 100.			
% CO ₂ = Percent carbon dioxide by volume, dry basis.	0.0	0.0	0.0
% O ₂ = Percent oxygen by volume, dry basis.	20.9	20.9	20.9

$$MWd = (0.32 * O_2) + (0.44 * CO_2) + (0.28 * (100 - (CO_2 + O_2)))$$

$$MWd = (0.32 * 20.9) + (0.44 * 0) + (0.28 * (100 - (0 + 20.9)))$$

$$MWd = (6.69) + (0.00) + (22.15)$$

$$MWd = \quad \quad \quad 28.84 \quad \quad \quad 28.84 \quad \quad \quad 28.84$$

Tma = Source Temperature, absolute(°R)			
Tm = Average dry gas meter temperature , deg F.	102.0	93.6	102.8

$$Tma = Ts + 460$$

$$Tma = 101.96 + 460$$

$$Tma = \quad \quad \quad 561.96 \quad \quad \quad 553.58 \quad \quad \quad 562.75$$

Ps = Absolute meter pressure, inches Hg.			
13.60 = Specific gravity of mercury.			
delta H = Avg pressure drop across the orifice meter during sampling, in H ₂ O	0.97	1.00	1.02
Pb = Barometric Pressure, in Hg.	30.06	30.09	30.06

$$Pm = Pb + (\Delta H / 13.6)$$

$$Pm = 30.06 + (0.96625 / 13.6)$$

$$Pm = \quad \quad \quad 30.13 \quad \quad \quad 30.16 \quad \quad \quad 30.13$$

Yqa = dry gas meter calibration check value, dimensionless.			
0.03 = (29.92/528)(0.75)2 (in. Hg/°R) cfm2			
29.00 = dry molecular weight of air, lb/lb-mole.			
Vm = Volume of gas sample measured by the dry gas meter at meter conditions, dcf.	50.909	51.412	51.767
Y = Dry gas meter calibration factor (based on full calibration)	1.0066	1.0066	1.0066
Delta H@ = Dry Gas meter orifice calibration coefficient, in. H ₂ O.	1.9530	1.9530	1.9530
avg SQRT Delta H = Avg SQRT press. drop across the orifice meter during sampling , in. H ₂ O	0.9656	0.9758	0.9859
O = Total sampling time, minutes.	96	96	96

$$Yqa = (O / Vm) * SQRT (0.0319 * Tma * 29) / (Delta H@ * Pm * MWd) * avg SQRT Delta H$$

$$Yqa = (96.00 / 50.91) * SQRT (0.0319 * 561.96 * 29) / (1.95 * 30.13 * 28.84) * 0.97$$

$$Yqa = 1.886 * SQRT 519.868 / 1,696.822 * 0.97$$

$$Yqa = \quad \quad \quad 1.008 \quad \quad \quad 1.000 \quad \quad \quad 1.013$$

Diff = Absolute difference between Yqa and Y	0.14	0.66	0.64
--	------	------	------

$$Diff = ((Y - Yqa) / Y) * 100$$

$$Diff = ((1.0066 - 1.008) / 1.0066) * 100$$

$$\text{Average Diff} = 0.48$$

$$\text{Allowable} = 5.0$$

Long Cal and Temperature Cal Datasheet for Standard Dry Gas Meter Console

Calibrator MDW

Meter Box Number 12

Ambient Temp 72

Date 10-Sep-18

Wet Test Meter Number P-2952

Temp Reference Source Thermocouple Simulator

(Accuracy +/- 1°F)

Dry Gas Meter Number 14244707

Baro Press, in Hg (Pb)	29.96
---------------------------------	--------------

Setting	Gas Volume		Temperatures		Calibration Results		
	Orifice Manometer	Wet Test Meter	Dry gas Meter	Wet Test Meter	Dry Gas Meter		
in H ₂ O (ΔH)	ft ³ (Vw)	ft ³ (Vd)	°F (Tw)	Outlet, °F (Td _o)	Time, min (O)	Y	ΔH
0.5	5.0	885.853	73.0	75.00	12.60	1.0097	1.7823
		890.822		76.00			
		4.969		75.50			
1.0	5.0	892.810	73.0	76.00	9.1	1.0071	1.8559
		897.795		77.00			
		4.985		76.50			
1.5	10.0	898.799	73.0	77.00	15.20	1.0036	1.9381
		908.810		78.00			
		10.011		77.50			
2.0	10.0	915.870	73.0	78.00	13.1	1.0094	1.9158
		925.830		79.00			
		9.960		78.50			
3.0	10.0	926.870	73.0	79.00	10.70	1.0048	1.9137
		936.870		80.00			
		10.000		79.50			
						1.0069	1.8812

Vw - Gas Volume passing through the wet test meter

Vd - Gas Volume passing through the dry gas meter

Tw - Temp of gas in the wet test meter

Tdi - Temp of the inlet gas of the dry gas meter

Tdo - Temp of the outlet gas of the dry gas meter

Td - Average temp of the gas in the dry gas meter

O - Time of calibration run

Pb - Barometric Pressure

ΔH - Pressure differential across orifice

Y - Ratio of accuracy of wet test meter to dry gas meter

$$Y = \frac{Vw * Pb * (td + 460)}{Vd * \left[Pb + \frac{(\Delta H)}{13.6} \right] * (tw + 460)}$$

$$\Delta H = \left[\frac{0.0317 * \Delta H}{Pb * (td + 460)} \right] * \left[\frac{(tw + 460) * O}{Vw} \right]^2$$

Reference Temperature	Temperature Reading from Individual Thermocouple Input ¹						Average Temperature Reading	Temp Difference ² (%)	
	Channel Number								
Select Temperature	1	2	3	4	5	6			
○ °C	32	32	32	32	32	32	32.0	0.0%	
● °F	212	212	212	212	212	212	212.0	0.0%	
932	932	932	932	932	932	932	932.0	0.0%	
1832	1834	1834	1834	1834	1834	1834	1834.0	-0.1%	

1 - Channel Temps must agree with +/- 5°F or 3°C

2 - Acceptable Temperature Difference less than 1.5 %

$$\text{Temp Diff} = \left[\frac{(\text{Reference Temp } ^\circ F + 460) - (\text{Test Temp } ^\circ F + 460)}{\text{Reference Temp } ^\circ F + 460} \right]$$



Y Factor Calibration Check Calculation

MODIFIED METHOD 0010 TEST TRAIN

VES CARBON BED OUTLET

METER BOX NO. 12

07/16/19 and 07/17/19

	Run 1	Run 2	Run 3
MWd = Dry molecular weight source gas, lb/lb-mole.			
0.32 = Molecular weight of oxygen, divided by 100.			
0.44 = Molecular weight of carbon dioxide, divided by 100.			
0.28 = Molecular weight of nitrogen or carbon monoxide, divided by 100.			
% CO ₂ = Percent carbon dioxide by volume, dry basis.	0.0	0.0	0.0
% O ₂ = Percent oxygen by volume, dry basis.	20.9	20.9	20.9

$$MWd = (0.32 * O_2) + (0.44 * CO_2) + (0.28 * (100 - (CO_2 + O_2)))$$

$$MWd = (0.32 * 20.9) + (0.44 * 0) + (0.28 * (100 - (0 + 20.9)))$$

$$MWd = (6.69) + (0.00) + (22.15)$$

$$MWd = \quad \quad \quad 28.84 \quad \quad \quad 28.84 \quad \quad \quad 28.84$$

Tma = Source Temperature, absolute(°R)			
Tm = Average dry gas meter temperature, deg F.	104.7	96.0	107.1

$$Tma = Ts + 460$$

$$Tma = 104.67 + 460$$

$$Tma = \quad \quad \quad 564.67 \quad \quad \quad 556.04 \quad \quad \quad 567.13$$

Ps = Absolute meter pressure, inches Hg.			
13.60 = Specific gravity of mercury.			
delta H = Avg pressure drop across the orifice meter during sampling, in H ₂ O	1.26	1.31	1.32
Pb = Barometric Pressure, in Hg.	30.06	30.09	30.06

$$Pm = Pb + (\delta H / 13.6)$$

$$Pm = 30.06 + (1.26 / 13.6)$$

$$Pm = \quad \quad \quad 30.15 \quad \quad \quad 30.19 \quad \quad \quad 30.16$$

Yqa = dry gas meter calibration check value, dimensionless.			
0.03 = (29.92/528)(0.75)2 (in. Hg/°R) cfm2.			
29.00 = dry molecular weight of air, lb/lb-mole.			
Vm = Volume of gas sample measured by the dry gas meter at meter conditions, dcf.	58.439	58.943	59.828
Y = Dry gas meter calibration factor (based on full calibration)	1.0069	1.0069	1.0069
Delta H@ = Dry Gas meter orifice calibration coefficient, in. H ₂ O.	1.8812	1.8812	1.8812
avg SQRT Delta H = Avg SQRT press. drop across the orifice meter during sampling, in. H ₂ O	1.1102	1.1322	1.1367
O = Total sampling time, minutes.	96	96	96

$$Yqa = (O / Vm) * SQRT (0.0319 * Tma * 29) / (Delta H@ * Pm * MWd) * avg SQRT Delta H$$

$$Yqa = (96.00 / 58.44) * SQRT (0.0319 * 564.67 * 29) / (1.88 * 30.15 * 28.84) * 1.11$$

$$Yqa = 1.643 * SQRT 522.373 / 1,635.525 * 1.11$$

$$Yqa = \quad \quad \quad 1.031 \quad \quad \quad 1.033 \quad \quad \quad 1.033$$

Diff = Absolute difference between Yqa and Y	2.39	2.59	2.59
--	------	------	------

$$Diff = ((Y - Yqa) / Y) * 100$$

$$Diff = ((1.0069 - 1.031) / 1.0069) * 100$$

$$\text{Average Diff} = 2.52$$

$$\text{Allowable} = 5.0$$

Long Cal and Temperature Cal Datasheet for Standard Dry Gas Meter Console

Calibrator MDW

Meter Box Number 27

Ambient Temp 72

Date 12-Jul-19

Wet Test Meter Number P-2952

Temp Reference Source

Thermocouple Simulator
(Accuracy +/- 1°F)

Dry Gas Meter Number 16787479

Setting	Gas Volume		Temperatures				Baro Press, in Hg (Pb)	29.76	
Orifice Manometer	Wet Test Meter	Dry gas Meter	Wet Test Meter		Dry Gas Meter		Calibration Results		
in H ₂ O (ΔH)	ft ³ (Vw)	ft ³ (Vd)	°F (Tw)	Outlet, °F (Td _o)	Inlet, °F (Td _i)	Average, °F (Td)	Time, min (O)	Y	ΔH
0.5	5.0	449.945	72.0	76.00	76.00	76.0	12.8	1.0035	1.8430
		454.959		76.00	76.00				
		5.014		76.00	76.00				
1.0	5.0	456.064	72.0	76.00	76.00	76.0	9.0	0.9998	1.8223
		461.090		76.00	76.00				
		5.026		76.00	76.00				
1.5	10.0	462.195	72.0	76.00	76.00	76.0	15.1	1.0033	1.9237
		472.200		76.00	76.00				
		10.005		76.00	76.00				
2.0	10.0	474.425	72.0	77.00	77.00	77.0	13.0	1.0044	1.8975
		484.425		77.00	77.00				
		10.000		77.00	77.00				
3.0	10.0	486.010	72.0	77.00	77.00	77.0	10.7	0.9930	1.9283
		496.100		77.00	77.00				
		10.090		77.00	77.00				
							Average	1.0008	1.8830

Vw - Gas Volume passing through the wet test meter

Vd - Gas Volume passing through the dry gas meter

Tw - Temp of gas in the wet test meter

Tdi - Temp of the inlet gas of the dry gas meter

Tdo - Temp of the outlet gas of the dry gas meter

Td - Average temp of the gas in the dry gas meter

O - Time of calibration run

Pb - Barometric Pressure

ΔH - Pressure differential across orifice

Y - Ratio of accuracy of wet test meter to dry gas meter

$$Y = \frac{Vw * Pb * (td + 460)}{Vd * \left[Pb + \frac{(\Delta H)}{13.6} \right] * (tw + 460)}$$

$$\Delta H = \left[\frac{0.0317 * \Delta H}{Pb * (td + 460)} \right] * \left[\frac{(tw + 460) * O}{Vw} \right]^2$$

Reference Temperature	Temperature Reading from Individual Thermocouple Input ¹						Average Temperature Reading	Temp Difference ² (%)
	Channel Number							
Select Temperature	1	2	3	4	5	6	Average Temperature Reading	Temp Difference ² (%)
○ °C	32	32	32	31	31			
32	32	32	32	31	31		31.6	0.1%
212	212	212	212	211	211		211.6	0.1%
932	932	932	932	931	931		931.6	0.0%
1832	1831	1831	1831	1830	1830		1830.6	0.1%

1 - Channel Temps must agree with +/- 5°F or 3°C

2 - Acceptable Temperature Difference less than 1.5 %

$$\text{Temp Diff} = \left[\frac{(\text{Reference Temp } ^\circ F + 460) - (\text{Test Temp } ^\circ F + 460)}{\text{Reference Temp } ^\circ F + 460} \right]$$

Y Factor Calibration Check Calculation

MODIFIED METHOD 0010 TEST TRAIN

VE SOUTH STACK

METER BOX NO. 27

07/16/2019 & 07/17/2019

	Run 1	Run 2	Run 3
MWd = Dry molecular weight source gas, lb/lb-mole.			
0.32 = Molecular weight of oxygen, divided by 100.			
0.44 = Molecular weight of carbon dioxide, divided by 100.			
0.28 = Molecular weight of nitrogen or carbon monoxide, divided by 100.			
% CO ₂ = Percent carbon dioxide by volume, dry basis.	0.0	0.0	0.0
% O ₂ = Percent oxygen by volume, dry basis.	20.9	20.9	20.9

$$MWd = (0.32 * O_2) + (0.44 * CO_2) + (0.28 * (100 - (CO_2 + O_2)))$$

$$MWd = (0.32 * 20.9) + (0.44 * 0) + (0.28 * (100 - (0 + 20.9)))$$

$$MWd = (6.69) + (0.00) + (22.15)$$

$$MWd = \quad \quad \quad 28.84 \quad \quad \quad 28.84 \quad \quad \quad 28.84$$

Tma = Source Temperature, absolute(°R)			
Tm = Average dry gas meter temperature , deg F.	98.5	87.9	99.0

$$Tma = Ts + 460$$

$$Tma = 98.46 + 460$$

$$Tma = \quad \quad \quad 558.46 \quad \quad \quad 547.88 \quad \quad \quad 559.00$$

Ps = Absolute meter pressure, inches Hg.			
13.60 = Specific gravity of mercury.			
delta H = Avg pressure drop across the orifice meter during sampling, in H ₂ O	0.79	0.79	0.76
Pb = Barometric Pressure, in Hg.	30.00	30.07	30.07

$$Pm = Pb + (\Delta H / 13.6)$$

$$Pm = 30 + (0.78541666666667 / 13.6)$$

$$Pm = \quad \quad \quad 30.06 \quad \quad \quad 30.13 \quad \quad \quad 30.13$$

Yqa = dry gas meter calibration check value, dimensionless.			
0.03 = (29.92/528)(0.75)2 (in. Hg/°R) cfm2			
29.00 = dry molecular weight of air, lb/lb-mole.			
Vm = Volume of gas sample measured by the dry gas meter at meter conditions, dcf.	50.910	49.525	50.263
Y = Dry gas meter calibration factor (based on full calibration)	1.0008	1.0008	1.0008
Delta H@ = Dry Gas meter orifice calibration coefficient, in. H ₂ O.	1.8330	1.8330	1.8330
avg SQRT Delta H = Avg SQRT press. drop across the orifice meter during sampling , in. H ₂ O	0.8852	0.8859	0.8737
O = Total sampling time, minutes.	96	96	96

$$Yqa = (O / Vm) * SQRT (0.0319 * Tma * 29) / (Delta H@ * Pm * MWd) * avg SQRT Delta H$$

$$Yqa = (96.00 / 50.91) * SQRT (0.0319 * 558.46 * 29) / (1.83 * 30.06 * 28.84) * 0.89$$

$$Yqa = 1.886 * SQRT 516.630 / 1,588.863 * 0.89$$

$$Yqa = \quad \quad \quad 0.9518 \quad \quad \quad 0.9688 \quad \quad \quad 0.9509$$

Diff = Absolute difference between Yqa and Y	4.90	3.20	4.99
--	------	------	------

$$Diff = ((Y - Yqa) / Y) * 100$$

$$Diff = ((1.0008 - 0.952) / 1.0008) * 100$$

$$\text{Average Diff} = 4.36$$

$$\text{Allowable} = 5.0$$

Type S Pitot Tube Inspection Data Form

Pitot Tube Identification Number: P-706

Inspection Date 2/19/19 Individual Conducting Inspection KS


If all Criteria PASS
Cp is equal to 0.84

PASS/FAIL

PASS

PASS

Pitot OD (D_t) - inches 0.375




Distance to A Plane (PA) - inches 0.45

Distance to B Plane (PB) - inches 0.45

$1.05 D_t < P < 1.5 D_t$


PA must Equal PB



Are Open Faces Aligned
Perpendicular to the Tube Axis

YES NO

PASS

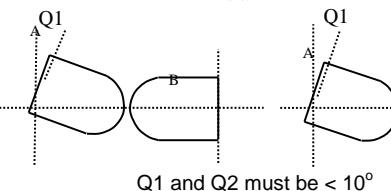


Angle of Q1 from vertical A Tube-
degrees (absolute) 0

Angle of Q2 from vertical B Tube-
degrees (absolute) 0

Q1 and Q2 must be $\leq 10^\circ$

PASS

PASS

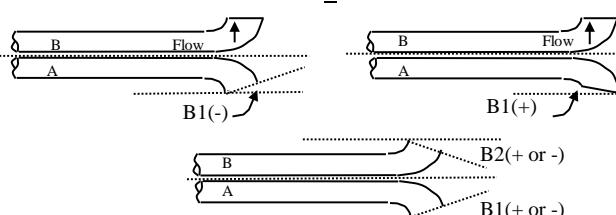


Angle of B1 from
vertical A Tube-
degrees (absolute) 0

Angle of B1 from
vertical B Tube-
degrees (absolute) 0

B1 or B2 must be $\leq 5^\circ$

PASS

PASS

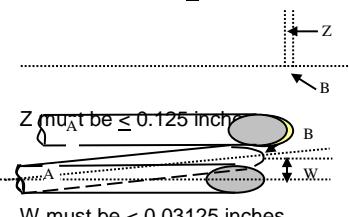


Horizontal offset between A and
B Tubes (Z) - inches 0.006

PASS


Vertical offset between A and B
Tubes (W) - inches 0.012

PASS

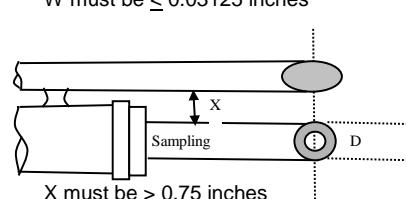


Distance between Sample
Nozzle and Pitot (X) - inches 0.79

PASS

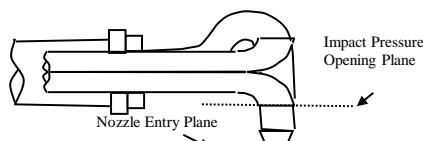

Impact Pressure
Opening Plane is
above the Nozzle
Entry Plane

YES NO
 NA

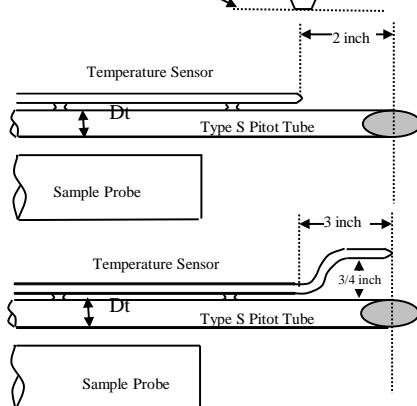

Thermocouple meets
the Distance Criteria
in the adjacent figure

YES NO
 NA

Thermocouple meets
the Distance Criteria
in the adjacent figure

YES NO
 NA

Type S Pitot Tube Inspection Data Form

Pitot Tube Identification Number: P-376

Inspection Date 2/19/18 Individual Conducting Inspection KS


If all Criteria PASS
Cp is equal to 0.84

PASS/FAIL

PASS

PASS

Pitot OD (D_t) - inches 0.375




Distance to A Plane (PA) - inches 0.417

Distance to B Plane (PB) - inches 0.417

$1.05 D_t < P < 1.5 D_t$


PA must Equal PB



Are Open Faces Aligned
Perpendicular to the Tube Axis


YES NO

PASS




Angle of Q1 from vertical A Tube-
degrees (absolute) 2

Angle of Q2 from vertical B Tube-
degrees (absolute) 1



Angle of B1 from
vertical A Tube-
degrees (absolute) 2

B1 or B2 must be $\leq 5^\circ$



Angle of B1 from
vertical B Tube-
degrees (absolute) 2

PASS


PASS

Horizontal offset between A and
B Tubes (Z) - inches 0.028

PASS


Vertical offset between A and B
Tubes (W) - inches 0.012

PASS

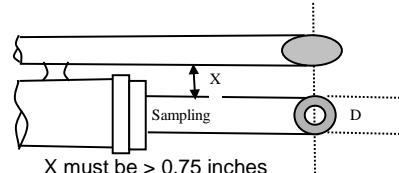

Distance between Sample
Nozzle and Pitot (X) - inches 0.984


PASS

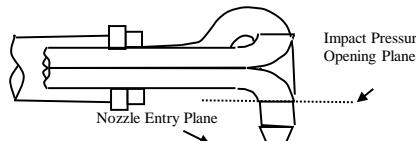

Impact Pressure
Opening Plane is
above the Nozzle
Entry Plane

YES NO

NA

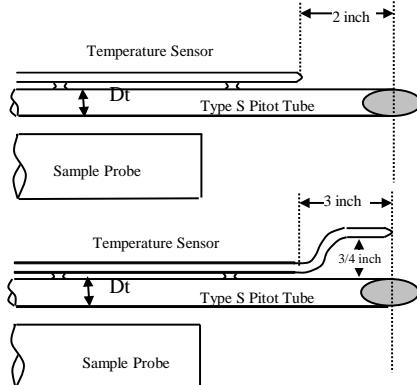

Thermocouple meets
the Distance Criteria
in the adjacent figure

YES NO

NA

Thermocouple meets
the Distance Criteria
in the adjacent figure

YES NO

NA

Type S Pitot Tube Inspection Data Form

Pitot Tube Identification Number: P-700

Inspection Date 2/19/19 Individual Conducting Inspection ks


If all Criteria PASS
Cp is equal to 0.84

PASS/FAIL

PASS

PASS

Pitot OD (D_t) - inches 0.375




Distance to A Plane (PA) - inches 0.459

Distance to B Plane (PB) - inches 0.459

$1.05 D_t < P < 1.5 D_t$


PA must Equal PB



Are Open Faces Aligned
Perpendicular to the Tube Axis


YES NO

PASS

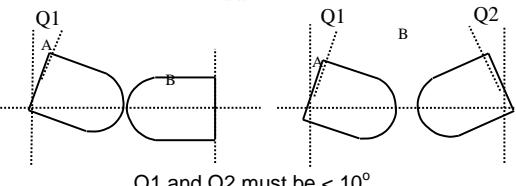

Angle of Q1 from vertical A Tube-
degrees (absolute) 0

Angle of Q2 from vertical B Tube-
degrees (absolute) 0

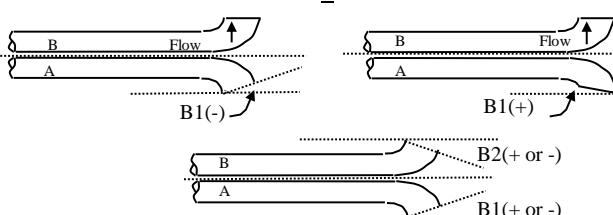

Angle of B1 from
vertical A Tube-
degrees (absolute) 0

Angle of B1 from
vertical B Tube-
degrees (absolute) 0

PASS

PASS

Q1 and Q2 must be $\leq 10^\circ$

B1 or B2 must be $\leq 5^\circ$

Horizontal offset between A and
B Tubes (Z) - inches 0.003

PASS

Vertical offset between A and B
Tubes (W) - inches 0.012

PASS

Distance between Sample
Nozzle and Pitot (X) - inches 0.93

PASS

Impact Pressure
Opening Plane is
above the Nozzle
Entry Plane

YES NO
 NA

Thermocouple meets
the Distance Criteria
in the adjacent figure

YES NO
 NA

Thermocouple meets
the Distance Criteria
in the adjacent figure

YES NO
 NA

148

Type S Pitot Tube Inspection Data Form

Pitot Tube Identification Number: P-695

Inspection Date 2/19/19 Individual Conducting Inspection ks


If all Criteria PASS
Cp is equal to 0.84

PASS/FAIL

PASS

PASS

Pitot OD (D_t) - inches 0.375




Distance to A Plane (PA) - inches 0.46

Distance to B Plane (PB) - inches 0.46

$1.05 D_t < P < 1.5 D_t$


PA must Equal PB



Are Open Faces Aligned
Perpendicular to the Tube Axis


YES NO

PASS

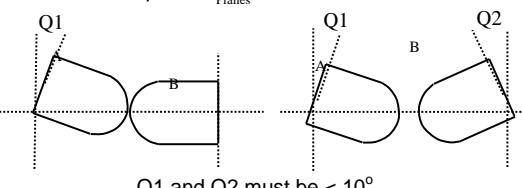

Angle of Q1 from vertical A Tube-
degrees (absolute) 0


Angle of Q2 from vertical B Tube-
degrees (absolute) 1

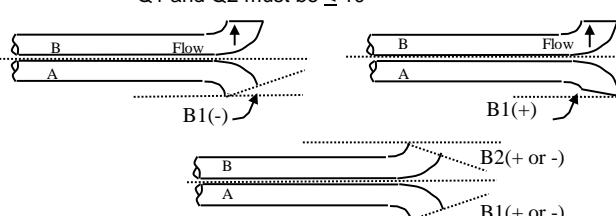

Angle of B1 from
vertical A Tube-
degrees (absolute) 0

Angle of B1 from
vertical B Tube-
degrees (absolute) 0

B1 or B2 must be ≤ 5°

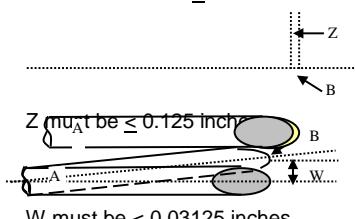


Horizontal offset between A and
B Tubes (Z) - inches 0.006

PASS


Vertical offset between A and B
Tubes (W) - inches 0.018

PASS

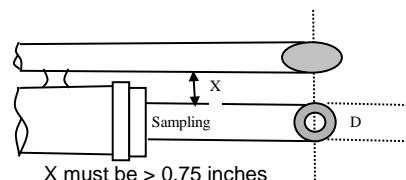


Distance between Sample
Nozzle and Pitot (X) - inches 0.78

PASS

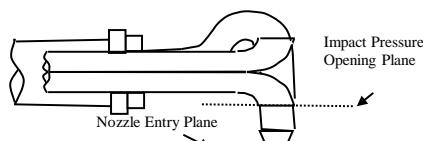

Impact Pressure
Opening Plane is
above the Nozzle
Entry Plane

YES NO
 NA

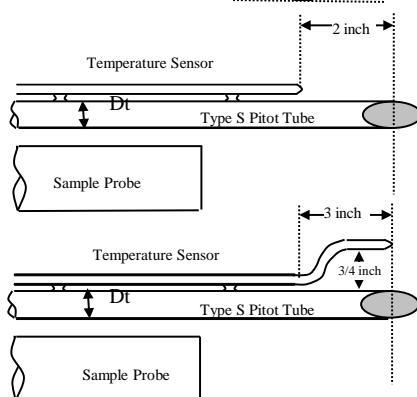

Thermocouple meets
the Distance Criteria
in the adjacent figure

YES NO
 NA

Thermocouple meets
the Distance Criteria
in the adjacent figure

YES NO
 NA

APPENDIX F
LIST OF PROJECT PARTICIPANTS

The following WESTON employees participated in this project.

Paul Meeter	Senior Project Manager
Jeff O'Neill	Team Member
Matt Winkeler	Team Member
Nick Guarino	Team Member
Kris Ansley	Team Member
Paul Greene	Team Member
Steve Rathfon	Team Member
Jack Mills	Team Member
Colin Mihalak	Team Member